

## **PROBLEM SUMMARY**

#### Sample Rating Trend




# BUSCH VM10 / VP-1 (S/N 2512909)

Component **Pump** Fluid

**USPI VAC 100 (--- GAL)** 



#### **COMPONENT CONDITION SUMMARY**

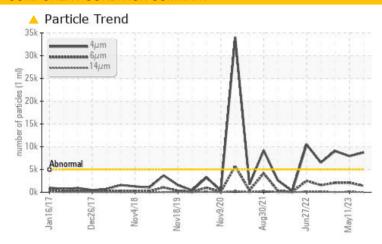

#### RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ATTENTION	ATTENTION	ATTENTION				
Particles >4µm	ASTM D7647	>5000	<b>A</b> 8743	<b>△</b> 7938	<b>△</b> 9038				
Particles >6µm	ASTM D7647	>1300	<b>1379</b>	<u>^</u> 2108	<u>^</u> 2083				
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>20/18/13</b>	<b>2</b> 0/18/14	<b>2</b> 0/18/13				

Customer Id: IBPDAK01 Sample No.: USPM29262 Lab Number: 05928291 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

#### **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

#### HISTORICAL DIAGNOSIS

### 11 May 2023 Diag: Doug Bogart

ISO



Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



#### 26 Jan 2023 Diag: Jonathan Hester

150



Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



#### 03 Oct 2022 Diag: Doug Bogart

ISO



Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





## **OIL ANALYSIS REPORT**

Sample Rating Trend



BUSCH VM10 / VP-1 (S/N 2512909)

Component

**Pump** 

**USPI VAC 100 (--- GAL)** 

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Woor

All component wear rates are normal.

#### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

m2017 Des2017 New2015 New2015 New2020 Aug2021 Jun2022 Many2023								
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2		
Sample Number		Client Info		USPM29262	USPM28902	USPM26240		
Sample Date		Client Info		19 Aug 2023	11 May 2023	26 Jan 2023		
Machine Age	hrs	Client Info		0	0	0		
Oil Age	hrs	Client Info		0	0	0		
Oil Changed		Client Info		N/A	N/A	N/A		
Sample Status				ATTENTION	ATTENTION	ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>90	<1	<1	<1		
Chromium	ppm	ASTM D5185m	>5	0	0	0		
Nickel	ppm	ASTM D5185m	>5	0	0	0		
Titanium	ppm	ASTM D5185m	>3	0	0	0		
Silver	ppm	ASTM D5185m	>3	0	0	0		
Aluminum	ppm	ASTM D5185m	>7	2	0	1		
Lead	ppm	ASTM D5185m	>12	0	0	0		
Copper	ppm	ASTM D5185m	>30	0	0	0		
Tin	ppm	ASTM D5185m	>9	<1	<1	<1		
Vanadium	ppm	ASTM D5185m		<1	0	0		
Cadmium	ppm	ASTM D5185m		0	0	0		
ADDITIVES		method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m	0	0	0	0		
Barium	ppm	ASTM D5185m	0	0	2	0		
Molybdenum	ppm	ASTM D5185m	0	0	0	0		
Manganese	ppm	ASTM D5185m		0	0	0		
Magnesium	ppm	ASTM D5185m	0	<1	<1	0		
Calcium	ppm	ASTM D5185m	0	2	4	2		
Phosphorus	ppm	ASTM D5185m	1800	1261	1237	1252		
Zinc	ppm	ASTM D5185m	0	0	1	3		
Sulfur	ppm	ASTM D5185m	0	14	6	31		
CONTAMINANTS		method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>60	4	3	2		
Sodium	ppm	ASTM D5185m		<1	0	0		
Potassium	ppm	ASTM D5185m	>20	2	1	0		
Water	%	ASTM D6304		0.051	0.057	0.026		
ppm Water	ppm	ASTM D6304	>.1	518.8	574.0	262.9		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2		
Particles >4µm		ASTM D7647	>5000	<u>A</u> 8743	<u>^</u> 7938	<u></u> 9038		
Particles >6µm		ASTM D7647	>1300	<u> </u>	<u>^</u> 2108	<u>▲</u> 2083		
Particles >14μm		ASTM D7647	>160	74	91	64		
Particles >21µm		ASTM D7647	>40	26	13	8		
Particles >38µm		ASTM D7647	>10	2	2	1		
Particles >71µm		ASTM D7647	>3	1	1	0		
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<u>^</u> 20/18/13	<b>2</b> 0/18/14	<b>2</b> 0/18/13		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045	0.05	0.36	0.30	0.26		



## **OIL ANALYSIS REPORT**

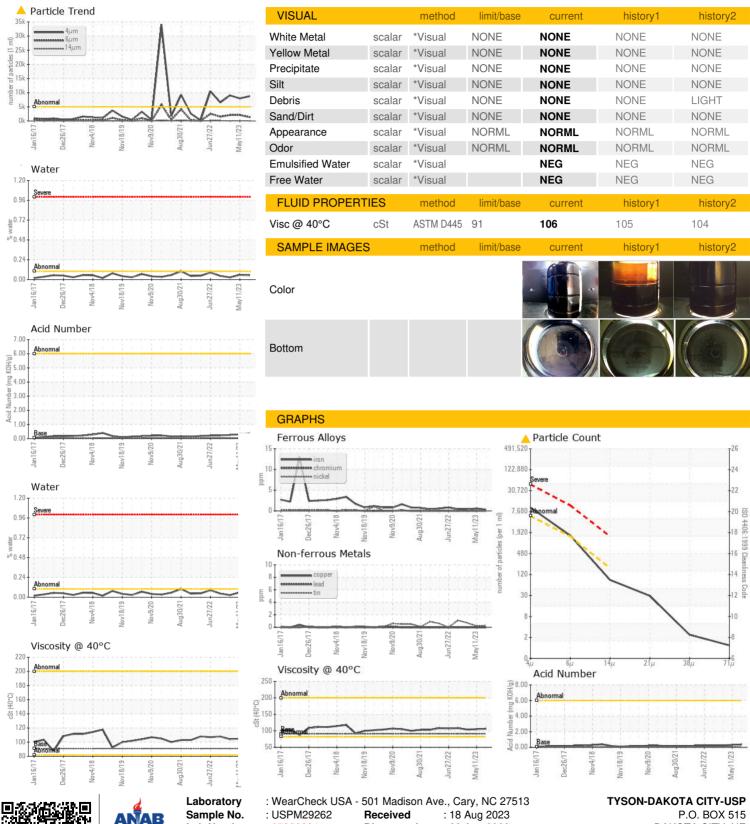





Certificate L2367

Lab Number **Unique Number** 

Test Package

: 05928291

: IND 2

: 10608238

Diagnosed Diagnostician

: 22 Aug 2023 : Doug Bogart

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

DAKOTA CITY, NE US 68731

Contact: RICHARD KOCH

Contact/Location: RICHARD KOCH - IBPDAK01

T: (605)235-2396 F: (605)235-2960