




# OIL ANALYSIS REPORT

Sample Rating Trend

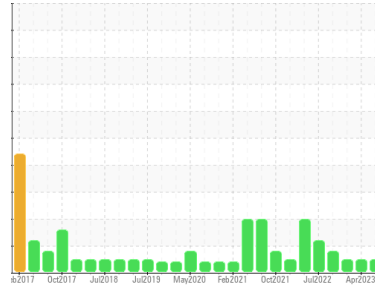

**NORMAL**



Area  
**PLATE FREEZER**  
Machine Id  
**PLATE FRZR 2-4**

Component  
**Hydraulic System**  
Fluid  
**LUBRIPLATE L0867-062 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USP0000575</b>	USP248830	USP05751442
Sample Date	Client Info	<b>19 Aug 2023</b>	19 Apr 2023	25 Jan 2023
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>20	<b>3</b>	3	2
Chromium	ppm	ASTM D5185m	>20	<b>4</b>	4	3
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>20	<b>10</b>	11	10
Tin	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		<b>85</b>	85	90
Barium	ppm	ASTM D5185m		<b>3</b>	2	1
Molybdenum	ppm	ASTM D5185m		<b>0</b>	<1	<1
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m		<b>4</b>	4	2
Calcium	ppm	ASTM D5185m		<b>95</b>	93	96
Phosphorus	ppm	ASTM D5185m		<b>215</b>	211	219
Zinc	ppm	ASTM D5185m		<b>18</b>	15	14
Sulfur	ppm	ASTM D5185m		<b>1128</b>	1173	1213

## CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>15	<b>1</b>	1	<1
Sodium	ppm	ASTM D5185m		<b>1</b>	<1	1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Water	%	ASTM D6304	>0.05	<b>0.034</b>	0.026	0.020
ppm Water	ppm	ASTM D6304	>500	<b>341.7</b>	269.1	204.2

## FLUID CLEANLINESS






method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>5000	<b>4057</b>	3990	1814
Particles >6µm	ASTM D7647	>1300	<b>615</b>	846	96
Particles >14µm	ASTM D7647	>160	<b>83</b>	116	7
Particles >21µm	ASTM D7647	>40	<b>36</b>	35	2
Particles >38µm	ASTM D7647	>10	<b>3</b>	3	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>19/16/14</b>	19/17/14	18/14/10

## FLUID DEGRADATION

method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>1.00</b>	1.00	0.84




# OIL ANALYSIS REPORT

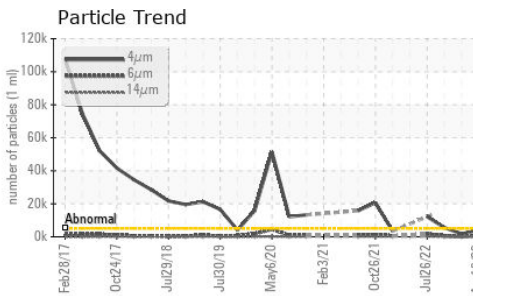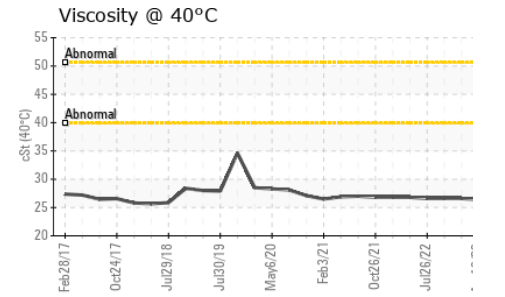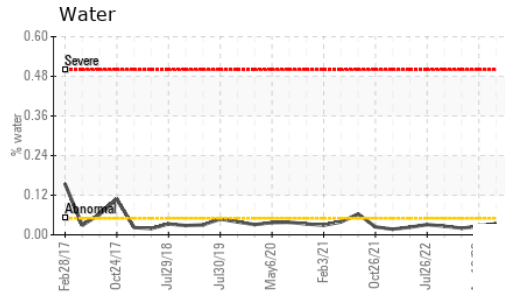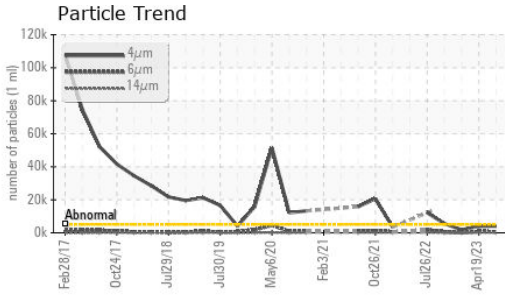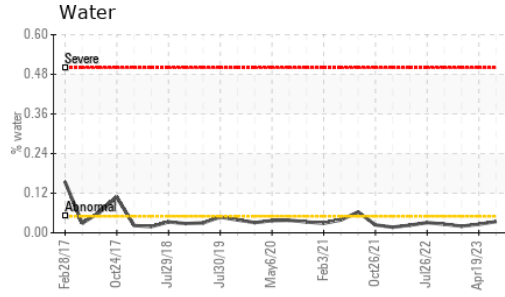






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	26.2	26.4	26.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

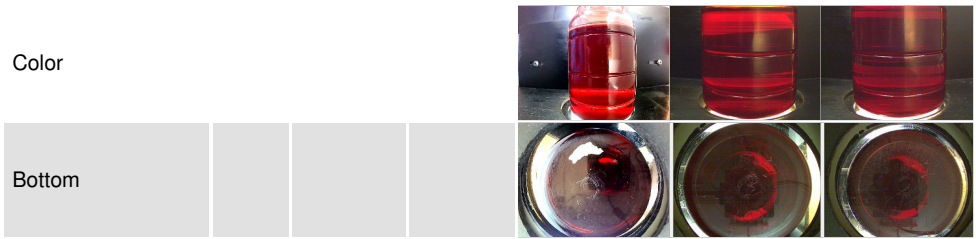

## GRAPHS

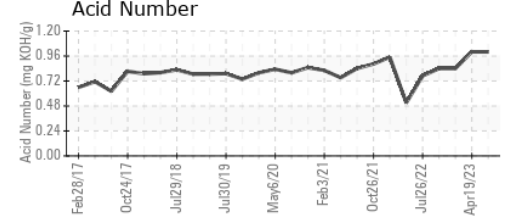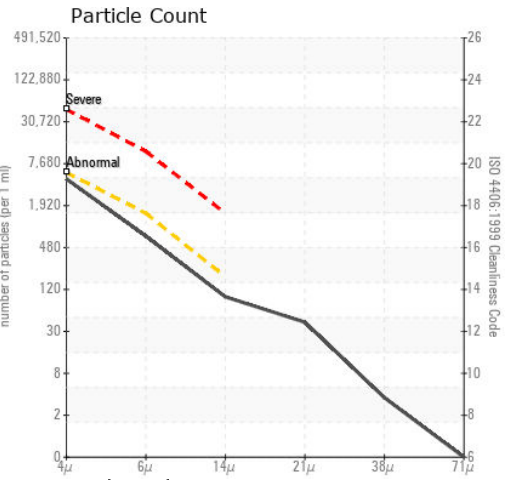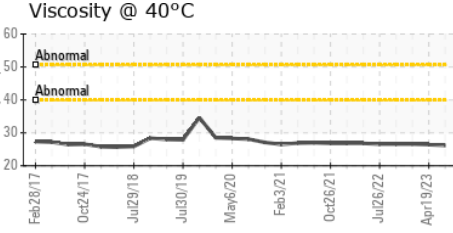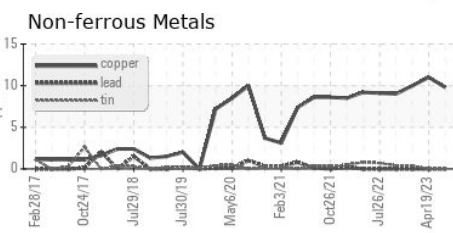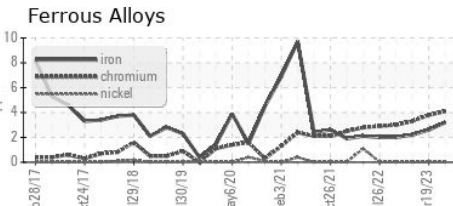

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0000575 **Received** : 18 Aug 2023  
**Lab Number** : 05928349 **Diagnosed** : 21 Aug 2023  
**Unique Number** : 10608296 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**CONAGRA FROZEN FOODS CO**  
 RUSSELLVILLE, AR  
 US  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: