




# OIL ANALYSIS REPORT

Sample Rating Trend

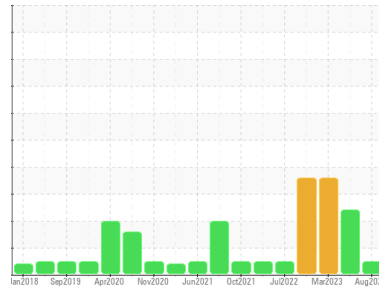

**NORMAL**



Machine Id  
**AC-3 (S/N S515963)**  
 Component  
**Air Compressor**  
 Fluid  
**USPI MAX FG AIR 46 (31 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USP242379</b>	USPM27005	USP242335
Sample Date	Client Info	<b>19 Aug 2023</b>	18 Jun 2023	06 Mar 2023
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	ABNORMAL	SEVERE

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>0</b>	4	0
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >4	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m >20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >40	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m >5	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 0	<b>0</b>	0	1
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 0	<b>0</b>	0	0

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	1
Water	%	ASTM D6304 >0.6	<b>0.012</b>	0.149	0.025
ppm Water	ppm	ASTM D6304 >6000	<b>128.8</b>	1490	254.6

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>388</b>	---	138
Particles >6µm	ASTM D7647 >2500	<b>89</b>	---	58
Particles >14µm	ASTM D7647 >320	<b>11</b>	---	11
Particles >21µm	ASTM D7647 >80	<b>3</b>	---	3
Particles >38µm	ASTM D7647 >20	<b>0</b>	---	0
Particles >71µm	ASTM D7647 >4	<b>0</b>	---	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	<b>16/14/11</b>	---	14/13/11

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.16	<b>0.54</b>	▲ 1.89	● 4.24




# OIL ANALYSIS REPORT

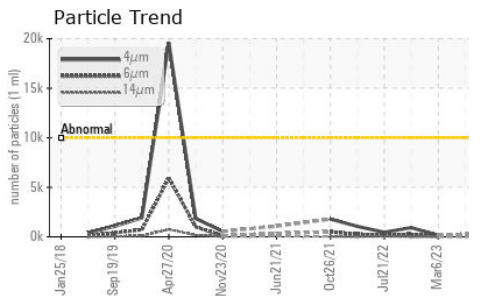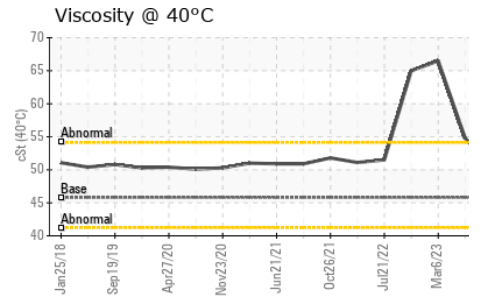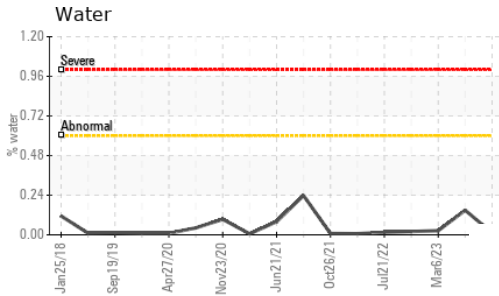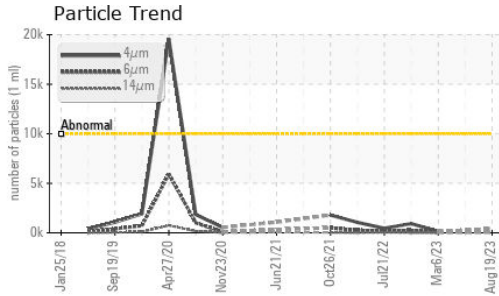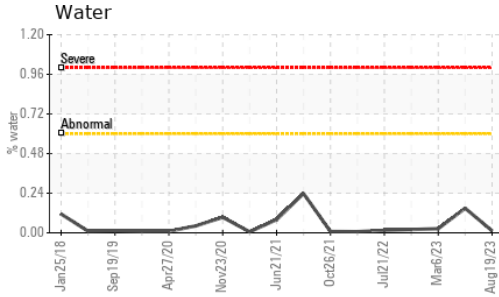






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	▲ HEAVY	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	45.8	50.3	▲ 54.8	▲ 66.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

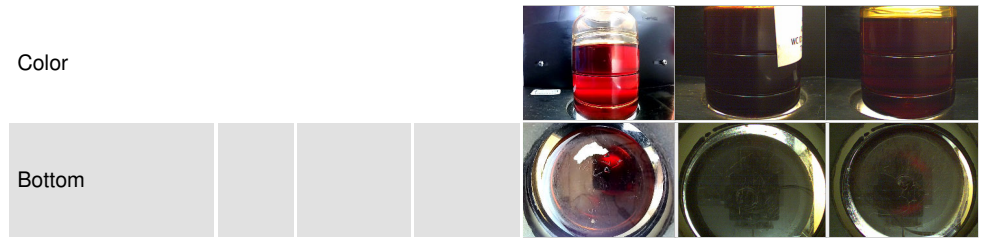

## GRAPHS

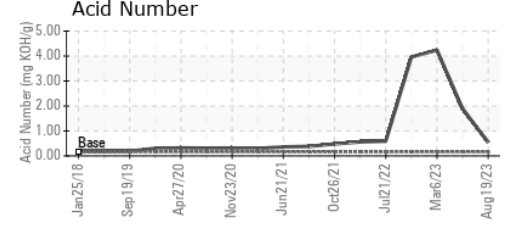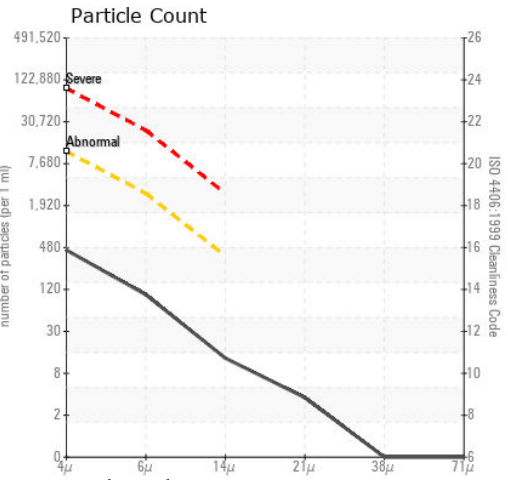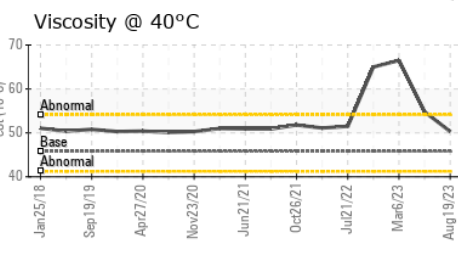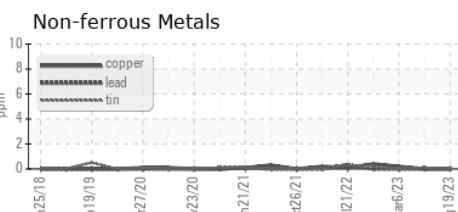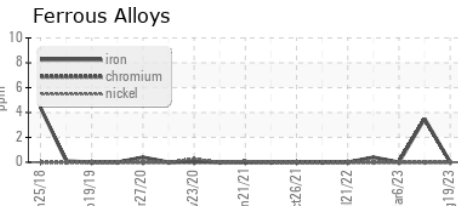

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP242379 **Received** : 18 Aug 2023  
**Lab Number** : 05928363 **Diagnosed** : 21 Aug 2023  
**Unique Number** : 10608310 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**TYSON HILLSHIRE - SAINT JOSEPH**  
 5807 MITCHELL AVE  
 SAINT JOSEPH, MO  
 US 64507  
 Contact:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: