




# OIL ANALYSIS REPORT

Sample Rating Trend

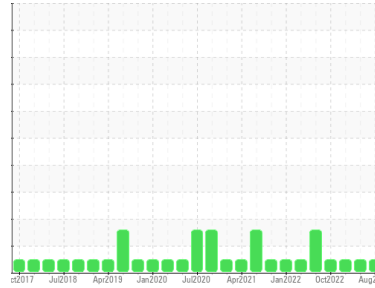

**NORMAL**



Machine Id  
**TYSWILFS B-34 (NEW FRICK)**

Component  
**Refrigeration Compressor**  
Fluid  
**USPI ALT-68 SC (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a trace of moisture present in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION |             | method      | limit/base | current            | history1    | history2    |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number      | Client Info |             |            | <b>USP0000551</b>  | USP248863   | USP2457007  |
| Sample Date        | Client Info |             |            | <b>09 Aug 2023</b> | 17 Apr 2023 | 05 Jan 2023 |
| Machine Age        | hrs         | Client Info |            | <b>0</b>           | 0           | 0           |
| Oil Age            | hrs         | Client Info |            | <b>0</b>           | 0           | 0           |
| Oil Changed        | Client Info |             |            | <b>N/A</b>         | N/A         | N/A         |
| Sample Status      |             |             |            | <b>NORMAL</b>      | NORMAL      | NORMAL      |

| WEAR METALS |     | method      | limit/base | current  | history1 | history2 |
|-------------|-----|-------------|------------|----------|----------|----------|
| Iron        | ppm | ASTM D5185m | >8         | <b>3</b> | 3        | 3        |
| Chromium    | ppm | ASTM D5185m | >2         | <b>0</b> | 0        | 0        |
| Nickel      | ppm | ASTM D5185m |            | <b>0</b> | 0        | 0        |
| Titanium    | ppm | ASTM D5185m |            | <b>0</b> | 0        | 0        |
| Silver      | ppm | ASTM D5185m | >2         | <b>0</b> | 0        | 0        |
| Aluminum    | ppm | ASTM D5185m | >3         | <b>0</b> | 0        | 0        |
| Lead        | ppm | ASTM D5185m | >2         | <b>0</b> | 0        | 0        |
| Copper      | ppm | ASTM D5185m | >8         | <b>0</b> | 0        | 0        |
| Tin         | ppm | ASTM D5185m | >4         | <b>0</b> | 0        | 0        |
| Vanadium    | ppm | ASTM D5185m |            | <b>0</b> | 0        | 0        |
| Cadmium     | ppm | ASTM D5185m |            | <b>0</b> | 0        | 0        |

| ADDITIVES  |     | method      | limit/base | current      | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron      | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Barium     | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Molybdenum | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Manganese  | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Magnesium  | ppm | ASTM D5185m |            | <b>&lt;1</b> | 0        | 0        |
| Calcium    | ppm | ASTM D5185m |            | <b>1</b>     | 0        | <1       |
| Phosphorus | ppm | ASTM D5185m |            | <b>0</b>     | <1       | 0        |
| Zinc       | ppm | ASTM D5185m |            | <b>2</b>     | 0        | 0        |
| Sulfur     | ppm | ASTM D5185m | 50         | <b>2</b>     | 2        | 0        |






| CONTAMINANTS |     | method      | limit/base | current      | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon      | ppm | ASTM D5185m | >15        | <b>0</b>     | <1       | 2        |
| Sodium       | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Potassium    | ppm | ASTM D5185m | >20        | <b>0</b>     | 0        | <1       |
| Water        | %   | ASTM D6304  | >0.01      | <b>0.012</b> | 0.008    | 0.005    |
| ppm Water    | ppm | ASTM D6304  | >100       | <b>122.4</b> | 81.1     | 55.4     |

| FLUID CLEANLINESS |  | method       | limit/base | current         | history1 | history2 |
|-------------------|--|--------------|------------|-----------------|----------|----------|
| Particles >4µm    |  | ASTM D7647   | >10000     | <b>208</b>      | 1427     | 312      |
| Particles >6µm    |  | ASTM D7647   | >2500      | <b>68</b>       | 182      | 82       |
| Particles >14µm   |  | ASTM D7647   | >320       | <b>8</b>        | 12       | 10       |
| Particles >21µm   |  | ASTM D7647   | >80        | <b>3</b>        | 2        | 6        |
| Particles >38µm   |  | ASTM D7647   | >20        | <b>0</b>        | 0        | 0        |
| Particles >71µm   |  | ASTM D7647   | >4         | <b>0</b>        | 0        | 0        |
| Oil Cleanliness   |  | ISO 4406 (c) | >20/18/15  | <b>15/13/10</b> | 18/15/11 | 15/14/10 |

| FLUID DEGRADATION |          | method    | limit/base | current      | history1 | history2 |
|-------------------|----------|-----------|------------|--------------|----------|----------|
| Acid Number (AN)  | mg KOH/g | ASTM D974 | 0.005      | <b>0.015</b> | 0.014    | 0.014    |




# OIL ANALYSIS REPORT

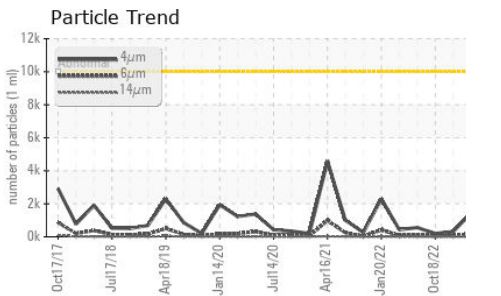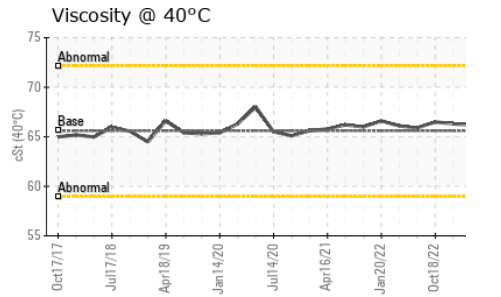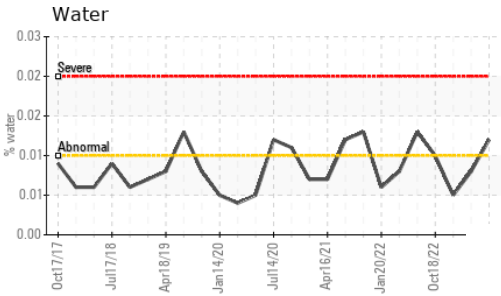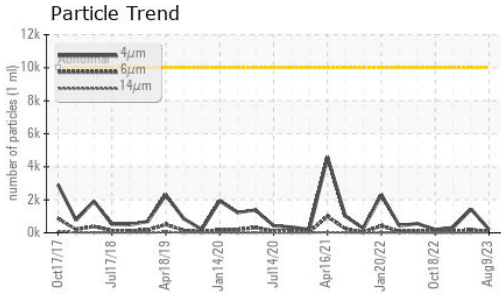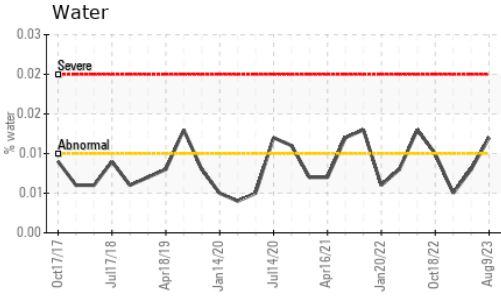






| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | NONE     | NONE     |
| Debris           | scalar | *Visual    | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.01   | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C      | cSt    | ASTM D445  | 65.6    | 66.1     | 66.2     |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

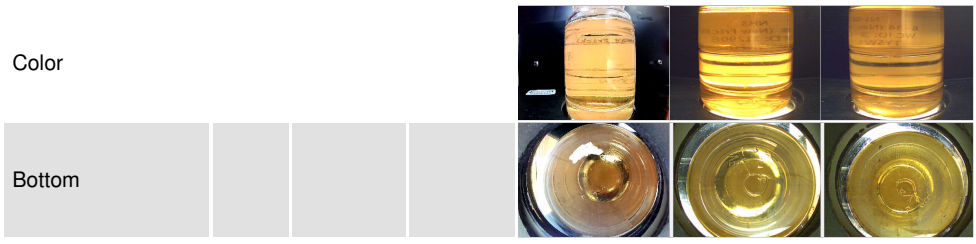

## GRAPHS

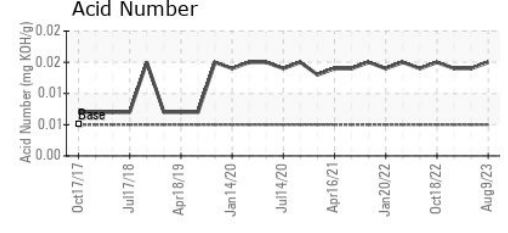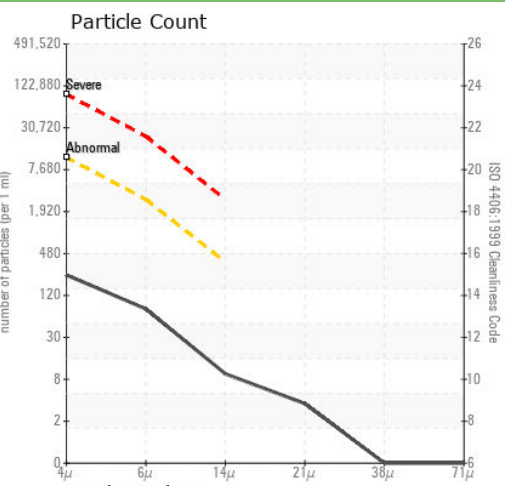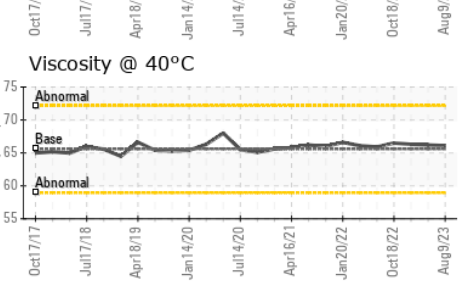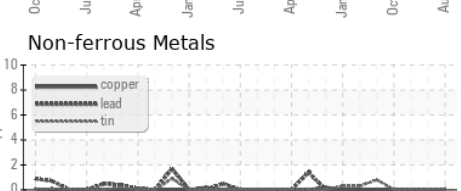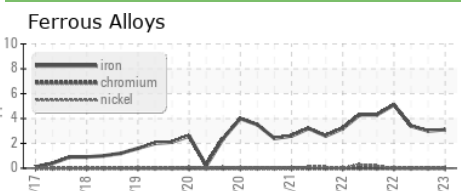

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0000551  
**Lab Number** : 05928372  
**Unique Number** : 10608319  
**Test Package** : IND 2

**TYSON FOOD SERVICE PLT - WILKESBORO-USP**  
 706 FACTORY ST  
 WILKESBORO, NC  
 US 28697  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: