




OIL ANALYSIS REPORT

Sample Rating Trend

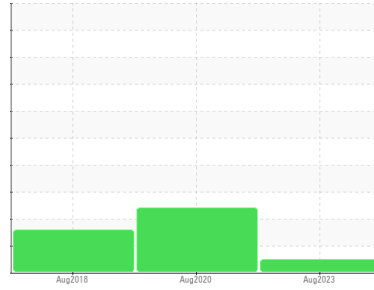

NORMAL



Machine Id

C-8

Component

Refrigeration Compressor

Fluid

CAMCO 717 HT (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0814245	WC0484360	WCI2339827
Sample Date	Client Info		16 Aug 2023	13 Aug 2020	29 Aug 2018
Machine Age	hrs	Client Info	1841	85832	72530
Oil Age	hrs	Client Info	1841	34828	72530
Oil Changed	Client Info		Not Chngd	Not Chngd	N/A
Sample Status			NORMAL	ABNORMAL	MARGINAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	0	▲ 73	15
Chromium	ppm	ASTM D5185m >2	0	<1	0
Nickel	ppm	ASTM D5185m	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m >2	0	<1	0
Aluminum	ppm	ASTM D5185m >3	0	0	0
Lead	ppm	ASTM D5185m >2	0	0	0
Copper	ppm	ASTM D5185m >8	0	<1	0
Tin	ppm	ASTM D5185m >4	0	0	0
Antimony	ppm	ASTM D5185m	---	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	1	<1
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m	<1	0	0
Calcium	ppm	ASTM D5185m	<1	0	0
Phosphorus	ppm	ASTM D5185m	1	4	2
Zinc	ppm	ASTM D5185m	2	8	9
Sulfur	ppm	ASTM D5185m	0	16	20

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<1	2	2
Sodium	ppm	ASTM D5185m	0	<1	<1
Potassium	ppm	ASTM D5185m >20	0	0	<1
Water	%	ASTM D6304 >0.01	0.001	▲ 0.047	▲ 0.028
ppm Water	ppm	ASTM D6304 >100	8.8	▲ 472.1	▲ 280

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	4154	2834	8787
Particles >6µm	ASTM D7647	>2500	806	225	1938
Particles >14µm	ASTM D7647	>320	33	4	80
Particles >21µm	ASTM D7647	>80	5	0	11
Particles >38µm	ASTM D7647	>20	0	0	0
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	19/17/12	19/15/9	20/18/13

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.007	0.015	0.015	0.007




OIL ANALYSIS REPORT

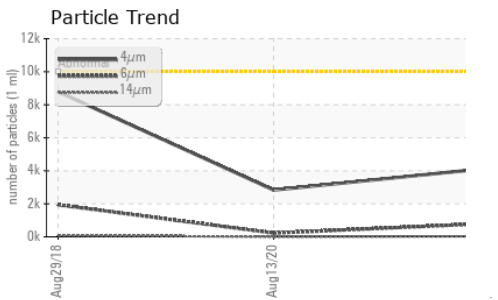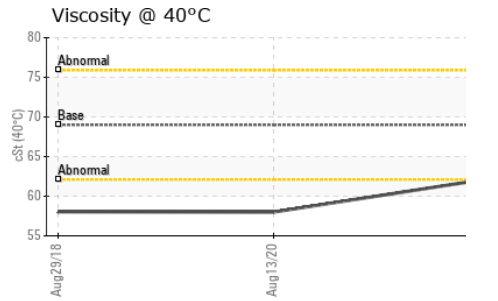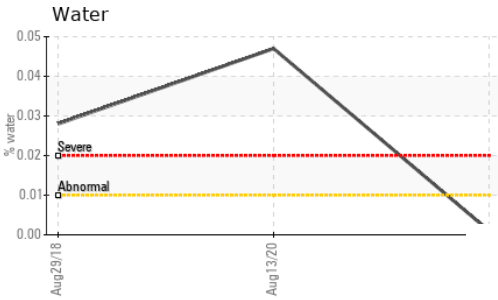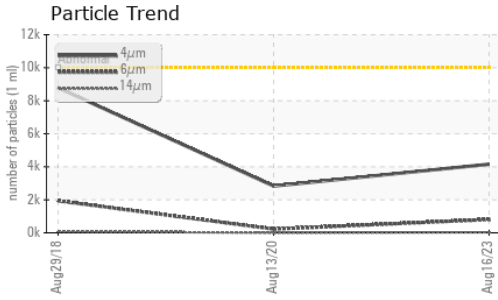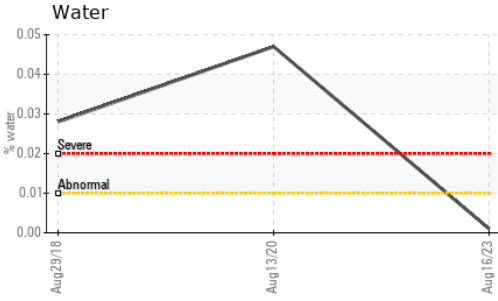





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 69	62.2	58.0	58.04

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

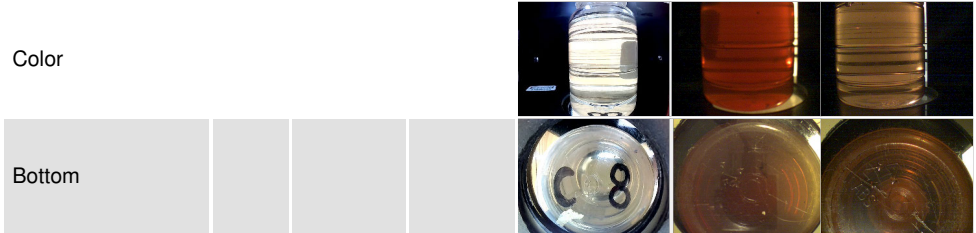

GRAPHS

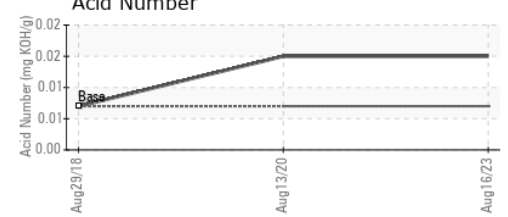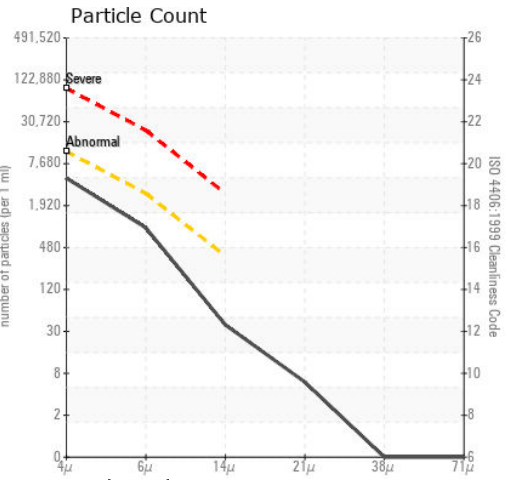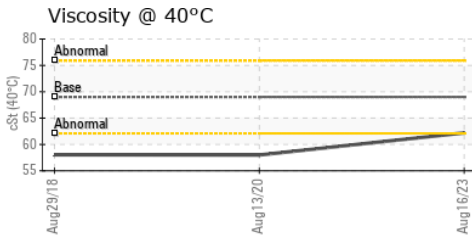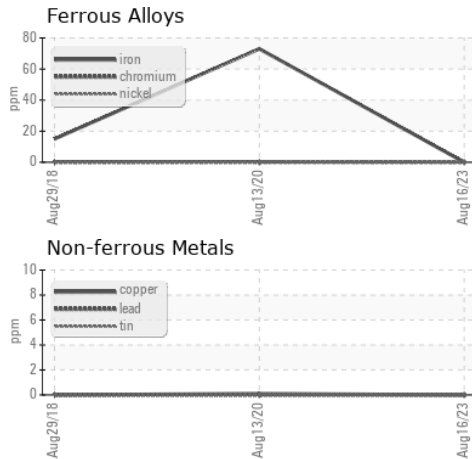

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0814245 **Received** : 18 Aug 2023
Lab Number : 05928378 **Diagnosed** : 21 Aug 2023
Unique Number : 10608325 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: PrtCount)

JENNIE-O TURKEY STORE
 2505 WILLMAR AVE SW
 WILLMAR, MN
 US 56201
 Contact: DEREK THAHLBERG

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (320)841-0741
 F: