

# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Machine Id  
**GREENSCALE AW 46**  
Component  
**New (Unused) Oil**  
Fluid  
**{not provided} (--- GAL)**

**DIAGNOSIS**

**Recommendation**

This is a baseline read-out on the submitted sample.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>BB0000150</b>	---	---
Sample Date	Client Info			<b>19 Aug 2023</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>5	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m	>5	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Tin	ppm	ASTM D5185m	>5	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>8</b>	---	---
Calcium	ppm	ASTM D5185m		<b>16</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>314</b>	---	---
Zinc	ppm	ASTM D5185m		<b>4</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>1248</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>4</b>	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	<b>2996</b>	---	---
Particles >6µm		ASTM D7647	>1300	<b>741</b>	---	---
Particles >14µm		ASTM D7647	>160	<b>54</b>	---	---
Particles >21µm		ASTM D7647	>40	<b>15</b>	---	---
Particles >38µm		ASTM D7647	>10	<b>3</b>	---	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<b>19/17/13</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.12</b>	---	---

# OIL ANALYSIS REPORT

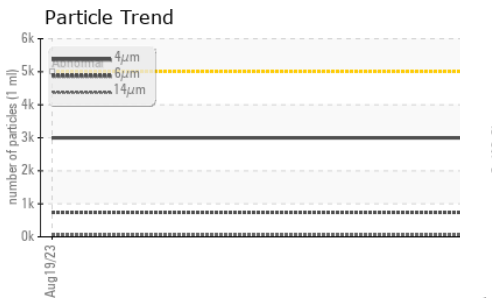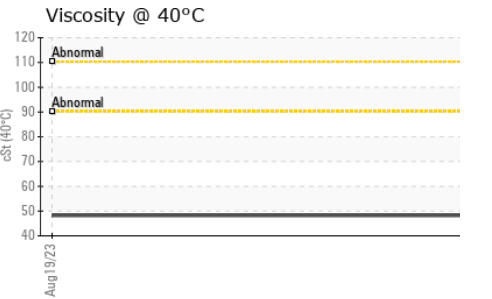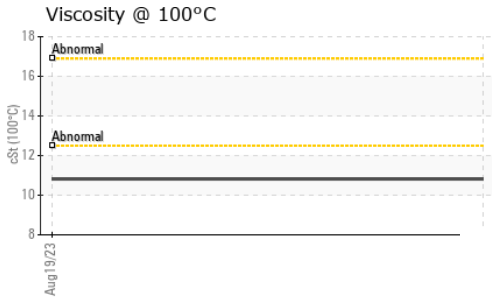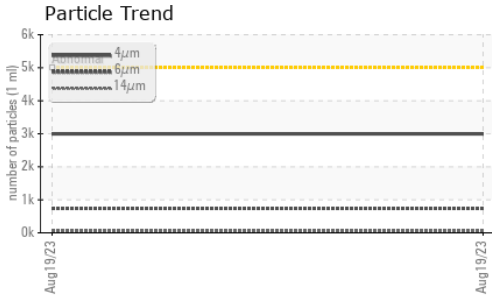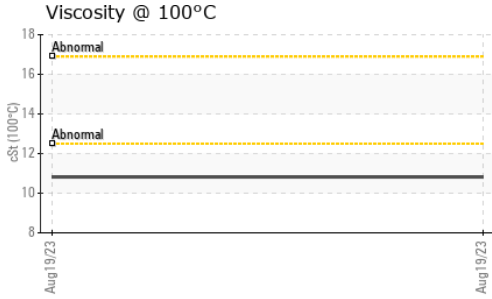






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	NEG	---	---
Free Water	scalar	*Visual	NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	48.21	---	---
Visc @ 100°C	cSt	ASTM D445	10.82	---	---
Viscosity Index (VI)	Scale	ASTM D2270	223	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

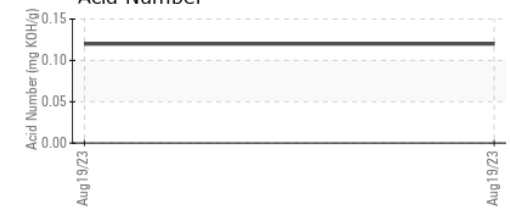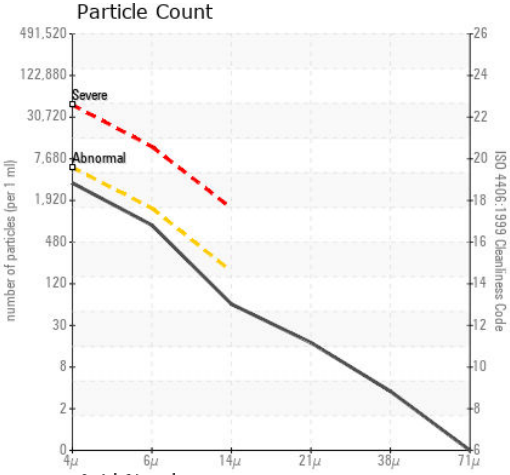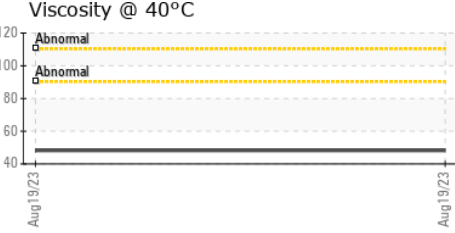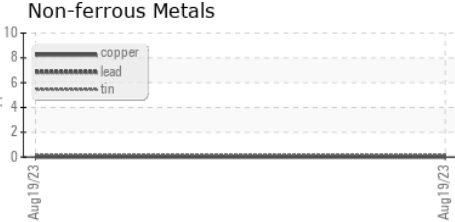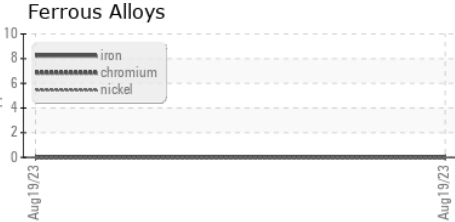

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : BB0000150 **Received** : 18 Aug 2023  
**Lab Number** : 05928539 **Diagnosed** : 22 Aug 2023  
**Unique Number** : 10608486 **Diagnostician** : Jonathan Hester  
**Test Package** : PLANT ( Additional Tests: FT-IR, ICP-NewOil, KV100, VI )

**BioBlend - Elk Grove Village**  
 1500 JARVIS AVE  
 ELK GROVE VILLAGE, IL  
 US 60007  
 Contact: DAN GABRIEL  
 dan.gabriel@bioblend.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: