



# OIL ANALYSIS REPORT

Sample Rating Trend


**NORMAL**



Machine Id  
**AIRMAN SDG65S 1478C10301**

Component  
**Diesel Engine**

Fluid  
**NOT GIVEN (--- GAL)**

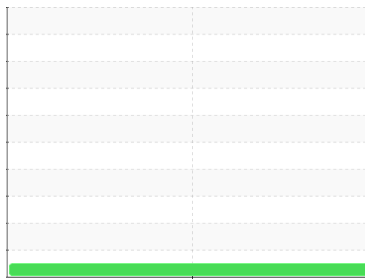

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

### Wear

Metal levels are typical for a new component breaking in.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>JCB005571</b>	---	---
Sample Date	Client Info		<b>15 Aug 2023</b>	---	---
Machine Age	hrs	Client Info	<b>835</b>	---	---
Oil Age	hrs	Client Info	<b>22</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<b>&lt;1.0</b>	---	---
Glycol	WC Method		<b>NEG</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	<b>2</b>	---	---
Chromium	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m >4	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m >3	<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m >40	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m >330	<b>6</b>	---	---
Tin	ppm	ASTM D5185m >15	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>2</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>58</b>	---	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>1003</b>	---	---
Calcium	ppm	ASTM D5185m	<b>1051</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>993</b>	---	---
Zinc	ppm	ASTM D5185m	<b>1235</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>3750</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>4</b>	---	---
Sodium	ppm	ASTM D5185m	<b>1</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>3</b>	---	---

## INFRA-RED




	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	<b>0.1</b>	---	---
Nitration	Abs/cm	*ASTM D7624 >20	<b>4.5</b>	---	---
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>17.2</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>13.2</b>	---	---
Base Number (BN)	mg KOH/g	ASTM D2896	<b>9.5</b>	---	---











# OIL ANALYSIS REPORT

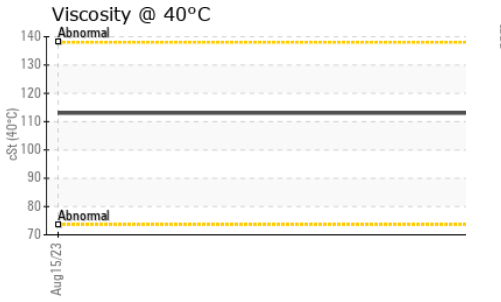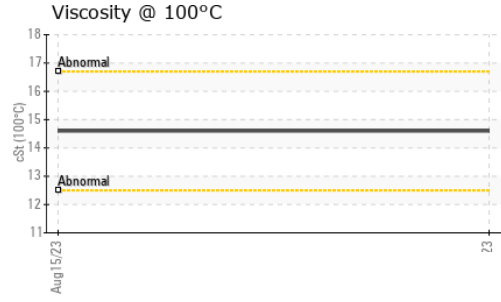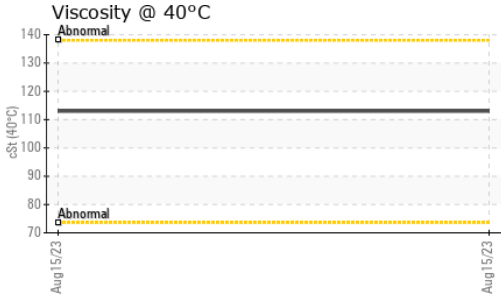

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>113.0</b>	---	---
Visc @ 100°C	cSt	ASTM D445	<b>14.6</b>	---	---
Viscosity Index (VI)	Scale	ASTM D2270	<b>132</b>	---	---

### GRAPHS

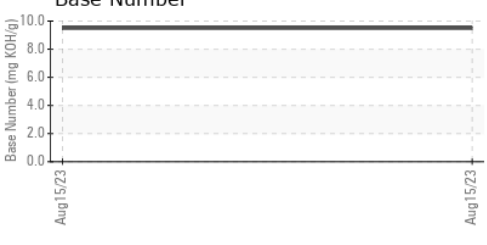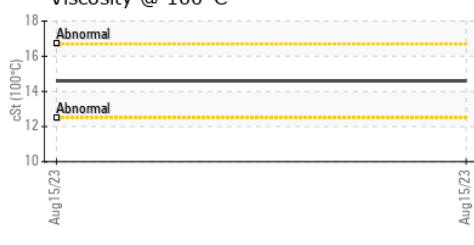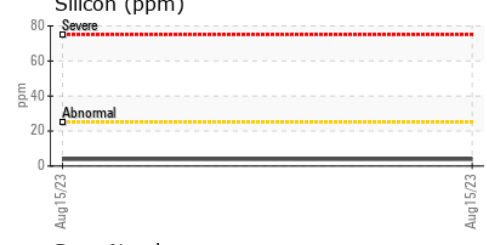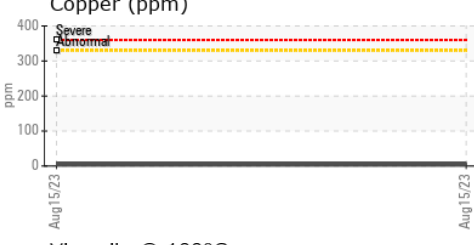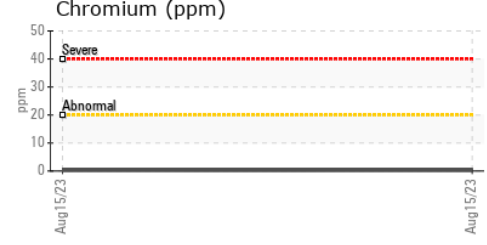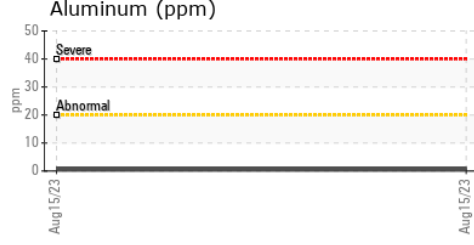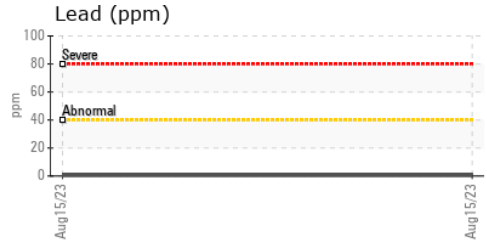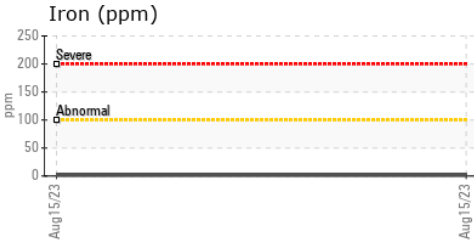

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : JCB005571 **Received** : 18 Aug 2023  
**Lab Number** : 05928712 **Diagnosed** : 23 Aug 2023  
**Unique Number** : 10608659 **Diagnostician** : Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: KV40, TBN, VI )

**MERIDIAN UTILITY EQUIPMENT SALES**  
 1315 VINCI AVE  
 SACRAMENTO, CA  
 US 95838  
 Contact: MATT  
 MATT@MUESINC.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: