




OIL ANALYSIS REPORT

Sample Rating Trend

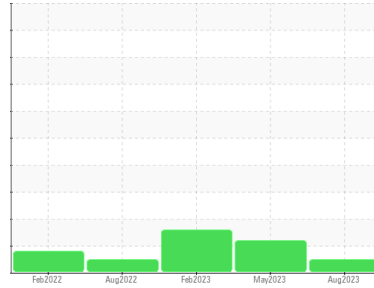

NORMAL



Machine Id
KAESER 7483379

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC98706	KC102754	KC107902
Sample Date	Client Info			10 Aug 2023	04 May 2023	08 Feb 2023
Machine Age	hrs	Client Info		3100	2894	2737
Oil Age	hrs	Client Info		774	568	411
Oil Changed	Client Info			Changed	Not Changd	Not Changd
Sample Status				NORMAL	ATTENTION	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	0
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	2	<1	2
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	<1






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	6	13	3
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	63	71	77
Calcium	ppm	ASTM D5185m	2	1	<1	2
Phosphorus	ppm	ASTM D5185m		<1	1	8
Zinc	ppm	ASTM D5185m		2	0	22

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		22	23	23
Potassium	ppm	ASTM D5185m	>20	8	8	9
Water	%	ASTM D6304	>0.05	0.025	0.025	0.036
ppm Water	ppm	ASTM D6304	>500	257.9	254.8	368.7

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3232	5227	5337
Particles >6µm		ASTM D7647	>1300	1254	▲ 1580	▲ 1912
Particles >14µm		ASTM D7647	>80	44	▲ 90	▲ 181
Particles >21µm		ASTM D7647	>20	10	18	▲ 43
Particles >38µm		ASTM D7647	>4	1	0	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	19/17/13	▲ 20/18/14	▲ 20/18/15

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.32	0.28	0.36


OIL ANALYSIS REPORT

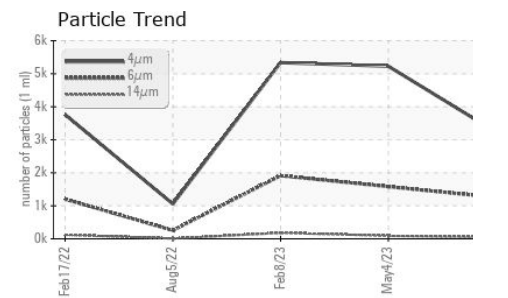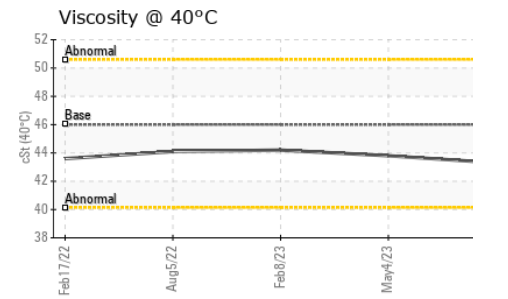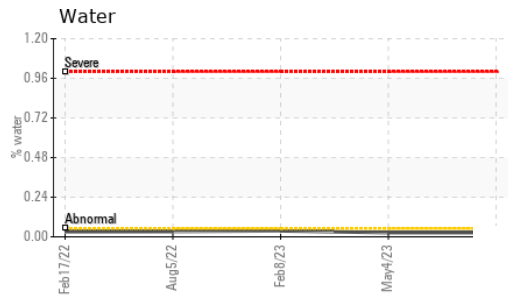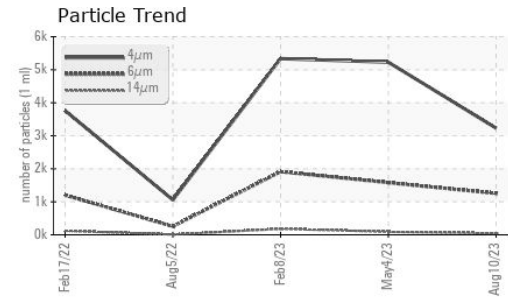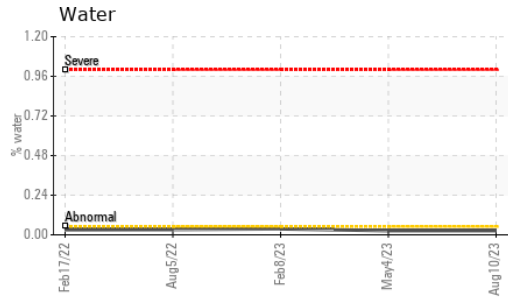






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	43.3	43.8	44.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

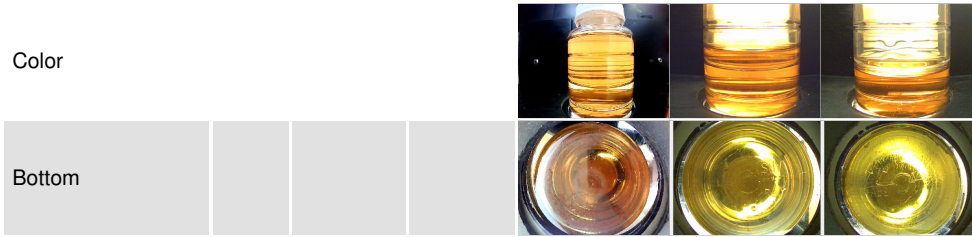

GRAPHS

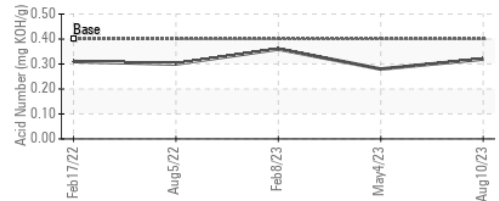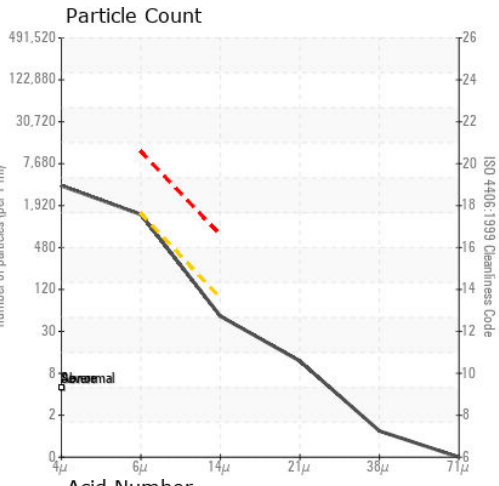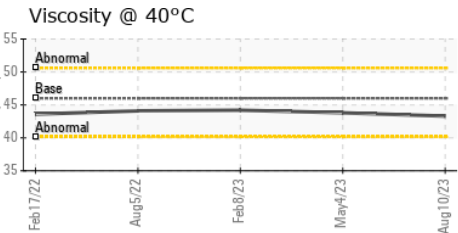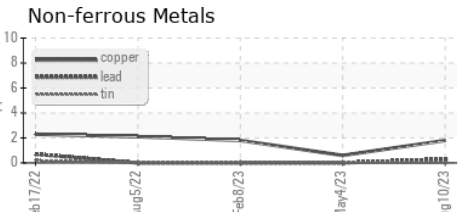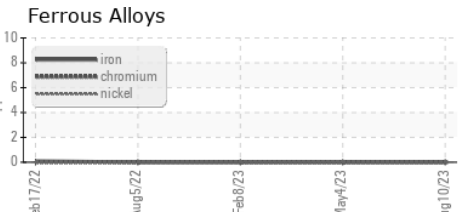

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC98706 **Received** : 18 Aug 2023
Lab Number : 05928800 **Diagnosed** : 21 Aug 2023
Unique Number : 10608747 **Diagnostician** : Doug Bogart
Test Package : IND 2

AMAZON
 4075 KIDRON RD
 LAKELAND, FL
 US 33811
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: