




# OIL ANALYSIS REPORT

Sample Rating Trend

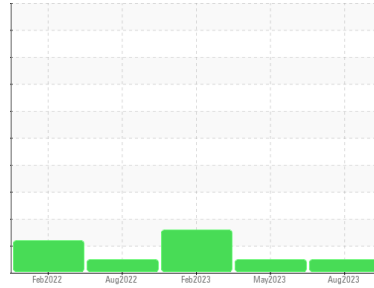

**NORMAL**



Machine Id  
**KAESER 7361746**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC106621</b>	KC102757	KC107903
Sample Date	Client Info			<b>10 Aug 2023</b>	04 May 2023	08 Feb 2023
Machine Age	hrs	Client Info		<b>3207</b>	3007	2815
Oil Age	hrs	Client Info		<b>835</b>	635	443
Oil Changed	Client Info			<b>Changed</b>	Not Changd	Not Changd
Sample Status				<b>NORMAL</b>	NORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	2	0
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>4</b>	4	2
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	3
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	90	<b>60</b>	64	81
Calcium	ppm	ASTM D5185m	2	<b>&lt;1</b>	<1	2
Phosphorus	ppm	ASTM D5185m		<b>&lt;1</b>	8	8
Zinc	ppm	ASTM D5185m		<b>3</b>	0	23

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	1	<1
Sodium	ppm	ASTM D5185m		<b>21</b>	27	23
Potassium	ppm	ASTM D5185m	>20	<b>7</b>	5	8
Water	%	ASTM D6304	>0.05	<b>0.024</b>	0.036	0.035
ppm Water	ppm	ASTM D6304	>500	<b>241.2</b>	368.1	355.0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>1335</b>	566	3613
Particles >6µm		ASTM D7647	>1300	<b>374</b>	174	▲ 1305
Particles >14µm		ASTM D7647	>80	<b>30</b>	15	▲ 127
Particles >21µm		ASTM D7647	>20	<b>8</b>	4	▲ 31
Particles >38µm		ASTM D7647	>4	<b>1</b>	0	2
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	1
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>18/16/12</b>	16/15/11	▲ 19/18/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.31</b>	0.29	0.33


# OIL ANALYSIS REPORT

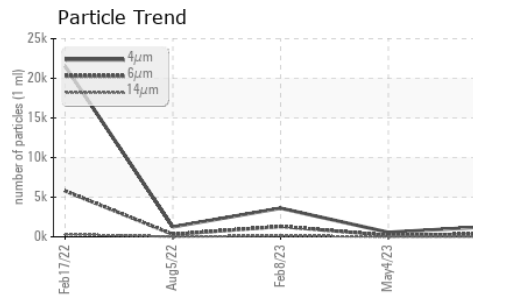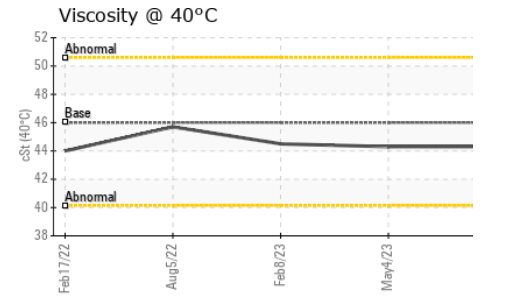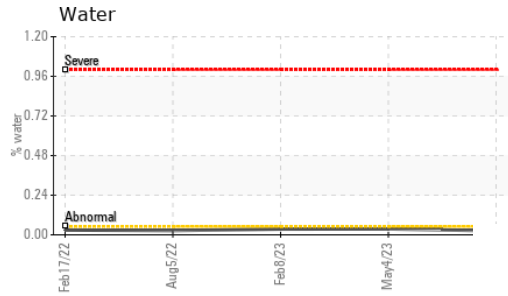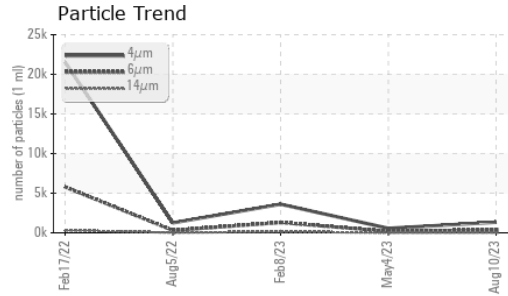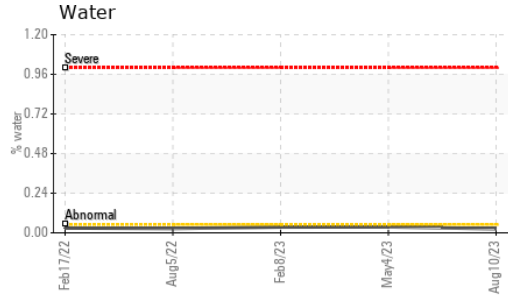






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.3	44.3	44.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

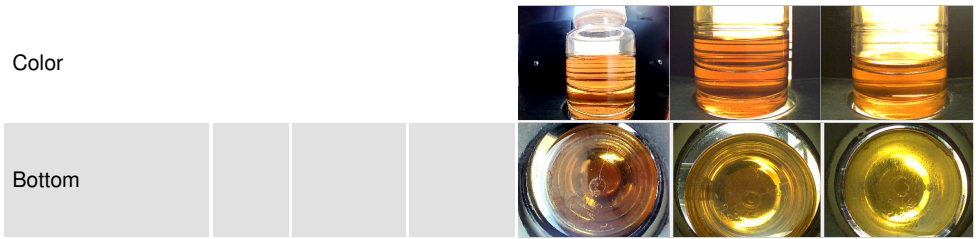

## GRAPHS

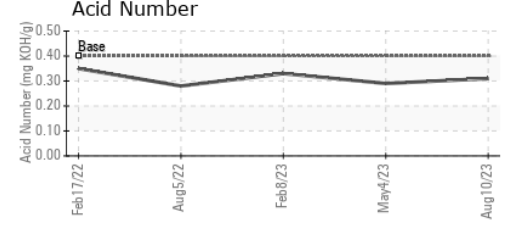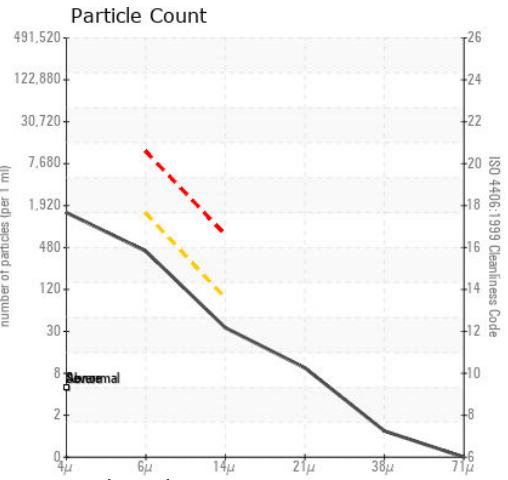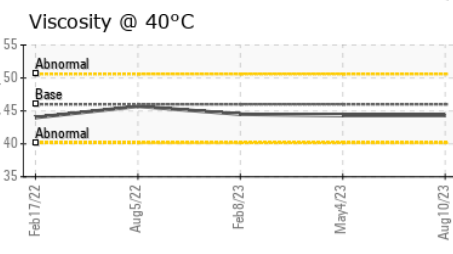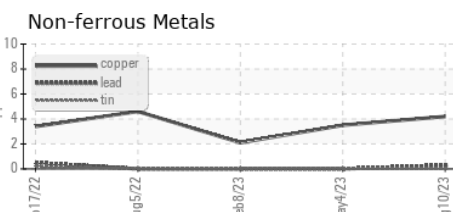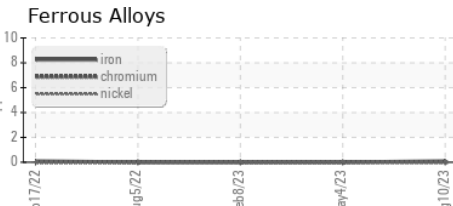

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC106621 **Received** : 18 Aug 2023  
**Lab Number** : 05928805 **Diagnosed** : 21 Aug 2023  
**Unique Number** : 10608752 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**AMAZON**  
 4075 KIDRON RD  
 LAKELAND, FL  
 US 33811  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: