




# OIL ANALYSIS REPORT

Sample Rating Trend

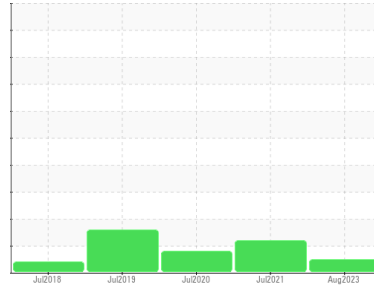

**NORMAL**



Machine Id  
**KAESER AS 36 1473301 (S/N 1036)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA005685</b>	KCP42258	KCP23066
Sample Date	Client Info			<b>14 Aug 2023</b>	12 Jul 2021	10 Jul 2020
Machine Age	hrs	Client Info		<b>49788</b>	38905	34910
Oil Age	hrs	Client Info		<b>6507</b>	3995	2929
Oil Changed	Client Info			<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	ABNORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	1	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>3</b>	<1	1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	19	<1
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	100	<b>2</b>	38	17
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	0	<b>&lt;1</b>	5	5
Zinc	ppm	ASTM D5185m	0	<b>8</b>	10	4
Sulfur	ppm	ASTM D5185m	23500	<b>21717</b>	17640	17761

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	2	1
Sodium	ppm	ASTM D5185m		<b>0</b>	5	3
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	1
Water	%	ASTM D6304	>0.05	<b>0.006</b>	0.011	0.018
ppm Water	ppm	ASTM D6304	>500	<b>66.4</b>	115.3	186.5

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>5354</b>	17141	9345
Particles >6µm		ASTM D7647	>1300	<b>1139</b>	▲ 3001	▲ 1578
Particles >14µm		ASTM D7647	>80	<b>45</b>	▲ 144	▲ 81
Particles >21µm		ASTM D7647	>20	<b>13</b>	▲ 35	17
Particles >38µm		ASTM D7647	>4	<b>0</b>	2	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>20/17/13</b>	▲ 19/14	▲ 18/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.50</b>	0.415	0.397


# OIL ANALYSIS REPORT

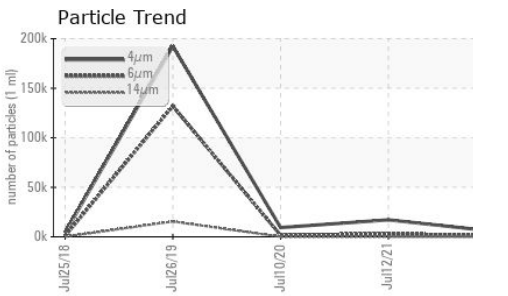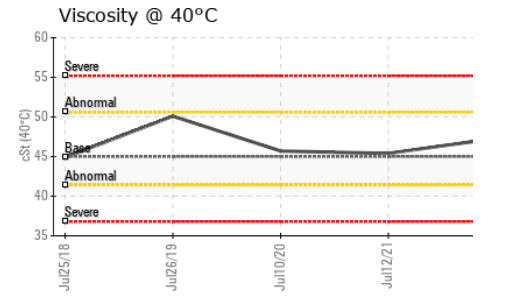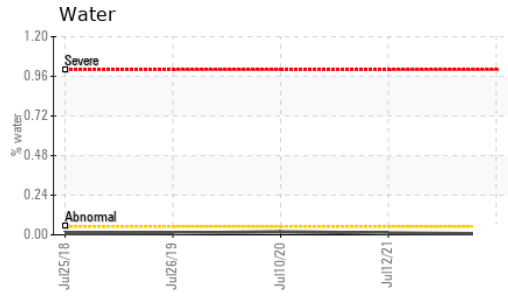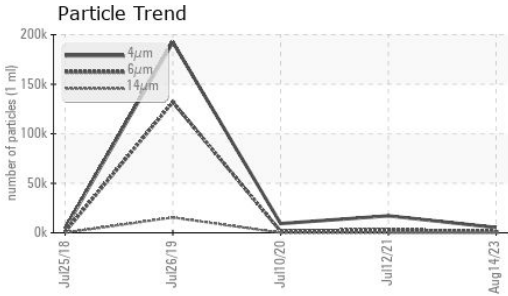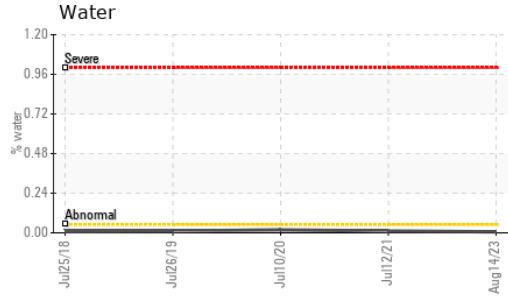






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	47.3	45.4	45.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

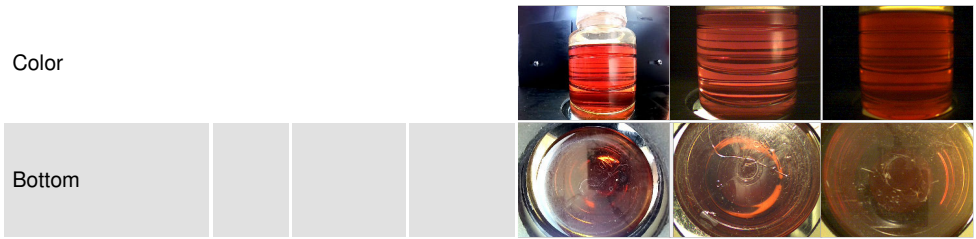

## GRAPHS

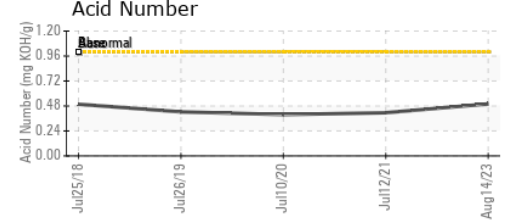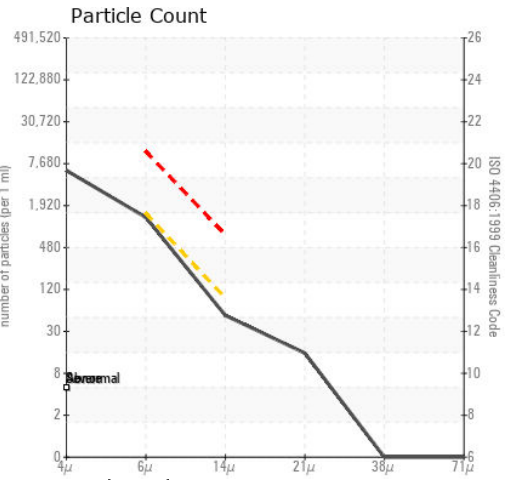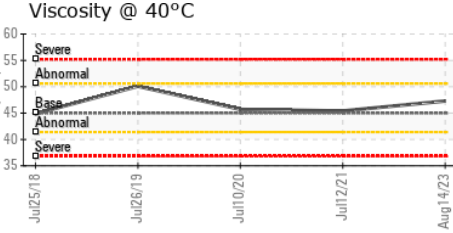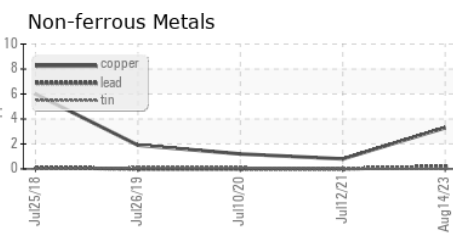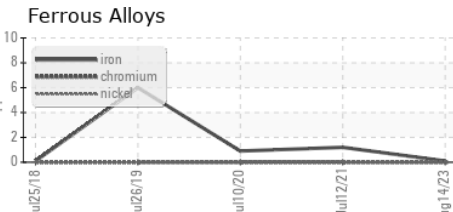

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA005685 **Received** : 18 Aug 2023  
**Lab Number** : 05928806 **Diagnosed** : 21 Aug 2023  
**Unique Number** : 10608753 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**GIW IND**  
 5000 WRIGHTSBORO RD  
 GROVETOWN, GA  
 US 30813  
 Contact: Amanda Sims  
 amanda.sims@ksb.com  
 T: (706)434-0580  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)