PROBLEM SUMMARY

Sample Rating Trend

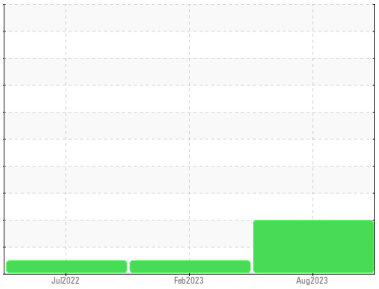

WEAR

Machine Id
KAESER 8027869
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

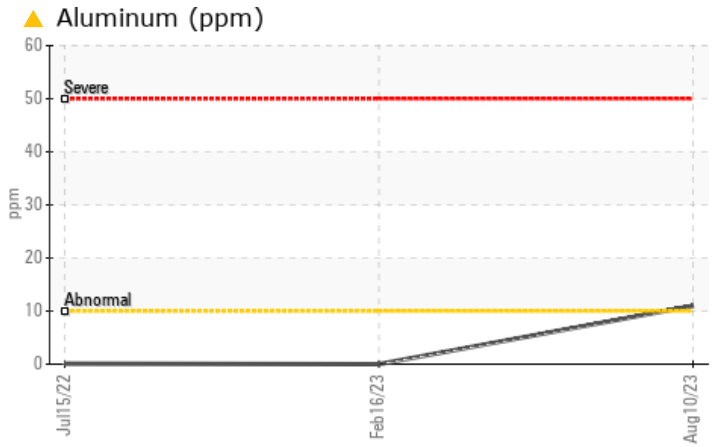

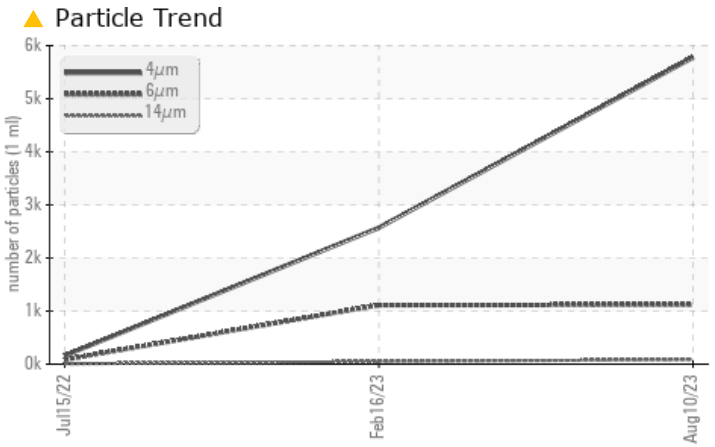

RECOMMENDATION

No corrective action is recommended at this time.
Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				**ABNORMAL**	NORMAL	NORMAL
Aluminum	ppm	ASTM D5185m	>10	▲ **11**	0	<1
Particles >14µm		ASTM D7647	>80	▲ **84**	49	7
Particles >21µm		ASTM D7647	>20	▲ **30**	7	3
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ **20/17/14**	19/17/13	14/14/10

Customer Id: GLOTAM
Sample No.: KC125401
Lab Number: 05928807
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

16 Feb 2023 Diag: Don Baldridge

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

15 Jul 2022 Diag: Don Baldridge

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Sample Rating Trend

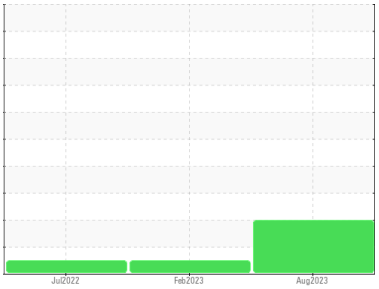

WEAR

Machine Id
KAESER 8027869
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

▲ Recommendation
No corrective action is recommended at this time. Resample at the next service interval to monitor.

▲ Wear
The aluminum level is abnormal. All other component wear rates are normal.

▲ Contamination
There is a moderate amount of particulates present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**KC125401**	KC96519	KC107121
Sample Date		Client Info		**10 Aug 2023**	16 Feb 2023	15 Jul 2022
Machine Age	hrs	Client Info		**8075**	6237	3900
Oil Age	hrs	Client Info		**1829**	2329	3900
Oil Changed		Client Info		**Not Changd**	Changed	Changed
Sample Status				**ABNORMAL**	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**2**	0	0
Chromium	ppm	ASTM D5185m	>10	**0**	0	0
Nickel	ppm	ASTM D5185m	>3	**0**	0	0
Titanium	ppm	ASTM D5185m	>3	**0**	0	0
Silver	ppm	ASTM D5185m	>2	**0**	0	0
Aluminum	ppm	ASTM D5185m	>10	▲ **11**	0	<1
Lead	ppm	ASTM D5185m	>10	**<1**	0	0
Copper	ppm	ASTM D5185m	>50	**3**	8	16
Tin	ppm	ASTM D5185m	>10	**0**	0	<1
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	<1	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	0
Barium	ppm	ASTM D5185m	90	**0**	0	0
Molybdenum	ppm	ASTM D5185m		**0**	0	0
Manganese	ppm	ASTM D5185m		**0**	<1	0
Magnesium	ppm	ASTM D5185m	90	**1**	9	11
Calcium	ppm	ASTM D5185m	2	**0**	0	0
Phosphorus	ppm	ASTM D5185m		**241**	9	7
Zinc	ppm	ASTM D5185m		**243**	28	17

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**0**	<1	<1
Sodium	ppm	ASTM D5185m		**<1**	0	2
Potassium	ppm	ASTM D5185m	>20	**<1**	<1	0
Water	%	ASTM D6304	>0.05	**0.003**	0.012	0.014
ppm Water	ppm	ASTM D6304	>500	**38.5**	124.4	147.5

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		**5778**	2570	159
Particles >6µm		ASTM D7647	>1300	**1117**	1111	84
Particles >14µm		ASTM D7647	>80	▲ **84**	49	7
Particles >21µm		ASTM D7647	>20	▲ **30**	7	3
Particles >38µm		ASTM D7647	>4	**3**	1	0
Particles >71µm		ASTM D7647	>3	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ **20/17/14**	19/17/13	14/14/10

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	**0.67**	0.31	0.28

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Aluminum (ppm)

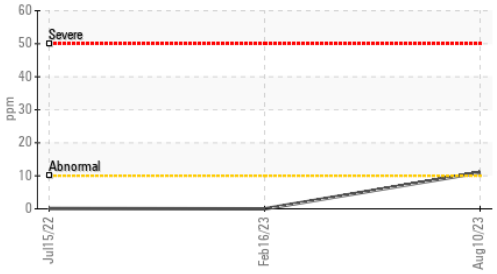

Particle Trend

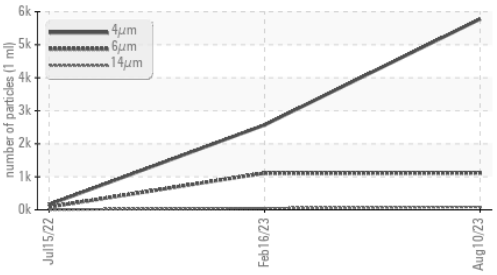

Water

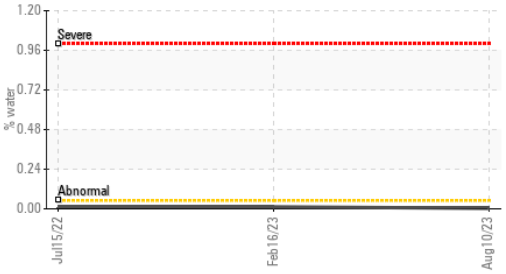

Acid Number

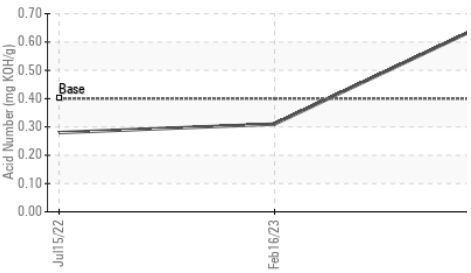

Water

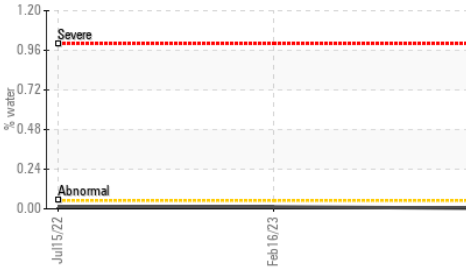

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	**46.7**	44.7	46.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color			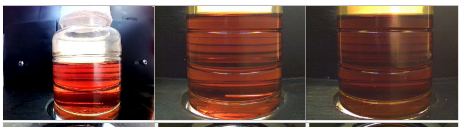		
Bottom			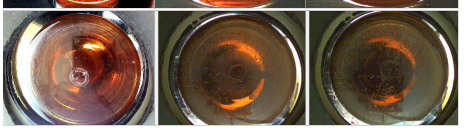		

GRAPHS

Ferrous Alloys

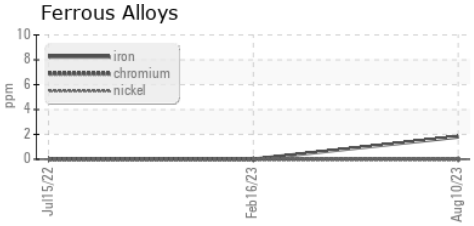

Non-ferrous Metals

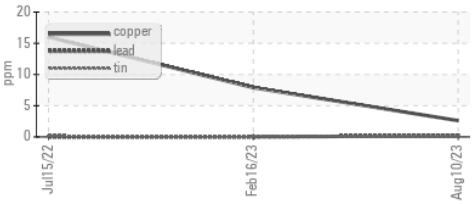

Viscosity @ 40°C

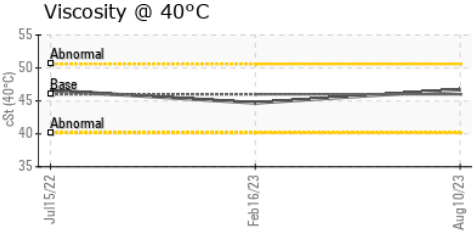

Particle Count

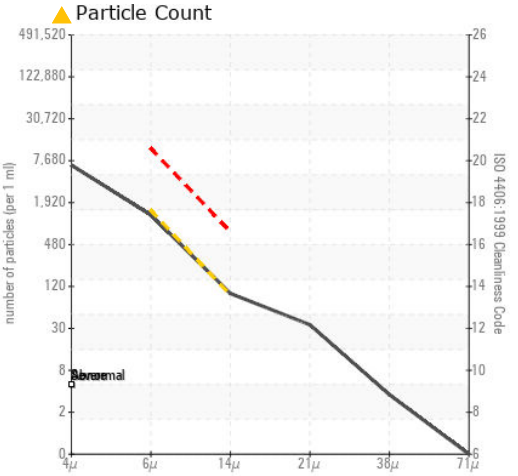

Acid Number

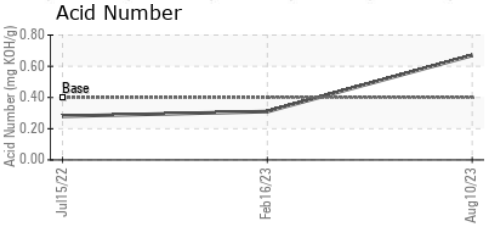

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC125401
Lab Number : 05928807
Unique Number : 10608754
Test Package : IND 2

Received : 18 Aug 2023
Diagnosed : 21 Aug 2023
Diagnostician : Doug Bogart

GLOBAL WIDGET
5601 ANDERSON RD
TAMPA, FL
US 33614
Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: