



OIL ANALYSIS REPORT


Sample Rating Trend

NORMAL



Machine Id
PUTNAM COUNTY-MOUNT NINHAM TOWER 5110719

Component
Oil
Fluid
NOT GIVEN (--- GAL)

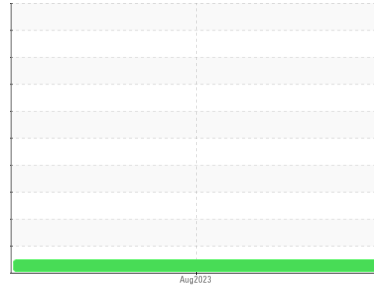

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0834356	---	---
Sample Date	Client Info		20 Aug 2023	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed		Client Info	N/A	---	---
Sample Status			NORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	1	---	---
Chromium	ppm	ASTM D5185m	<1	---	---
Nickel	ppm	ASTM D5185m	<1	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m	0	---	---
Aluminum	ppm	ASTM D5185m	<1	---	---
Lead	ppm	ASTM D5185m	0	---	---
Copper	ppm	ASTM D5185m	<1	---	---
Tin	ppm	ASTM D5185m	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	80	---	---
Barium	ppm	ASTM D5185m	0	---	---
Molybdenum	ppm	ASTM D5185m	59	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m	701	---	---
Calcium	ppm	ASTM D5185m	1088	---	---
Phosphorus	ppm	ASTM D5185m	804	---	---
Zinc	ppm	ASTM D5185m	968	---	---
Sulfur	ppm	ASTM D5185m	2860	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	2	---	---
Sodium	ppm	ASTM D5185m	2	---	---
Potassium	ppm	ASTM D5185m >20	4	---	---

INFRA-RED




	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	---	---
Nitration	Abs/cm	*ASTM D7624	4.6	---	---
Sulfation	Abs/.1mm	*ASTM D7415	15.5	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	10.5	---	---
Base Number (BN)	mg KOH/g	ASTM D2896	8.6	---	---



OIL ANALYSIS REPORT

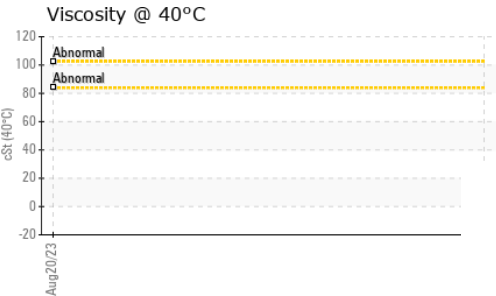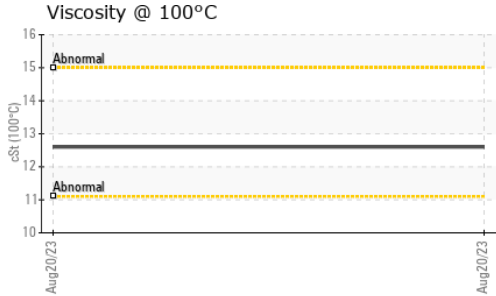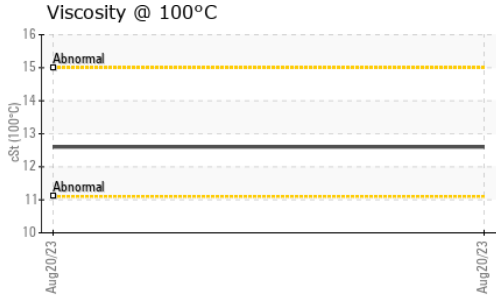


VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	NEG	---	---	
Free Water	scalar	*Visual	NEG	---	---	

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	12.6	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image	no image
Bottom				no image	no image	no image

GRAPHS

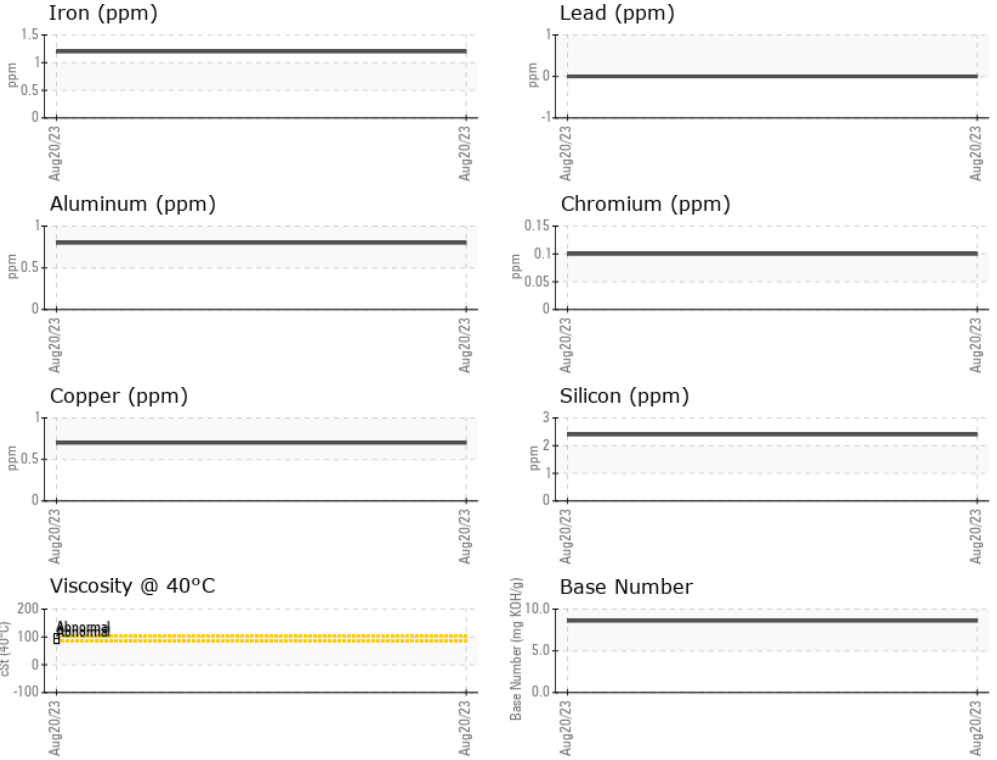

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0834356 **Received** : 21 Aug 2023
Lab Number : 05929336 **Diagnosed** : 23 Aug 2023
Unique Number : 10609283 **Diagnostician** : Jonathan Hester
Test Package : MOB 1 (Additional Tests: FT-IR, KV100, TBN)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

GEN TECH LTD
 3017 RT 9W
 NEW WINDSOR, NY
 US 12553
 Contact: JOE SAYEGH
 joe@gentechltd.com
 T: (845)568-0500
 F: (845)568-3073