




PROBLEM SUMMARY

Sample Rating Trend

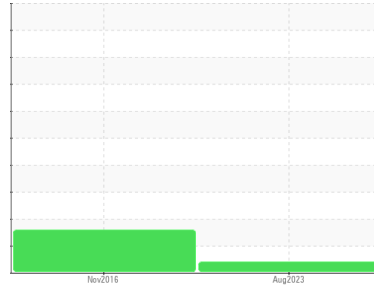

VIS DEBRIS



Machine Id
KAESER BS61 1375278 (S/N 1032)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

COMPONENT CONDITION SUMMARY

No relevant graphs to display

RECOMMENDATION

Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ATTENTION	---
Debris	scalar	*Visual	NONE	▲ MODER	LIGHT	---

Customer Id: MONDENCA
Sample No.: KCPA001495
Lab Number: 05929582
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Alert	---	---	?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

HISTORICAL DIAGNOSIS

17 Nov 2016 Diag: Jonathan Hester

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

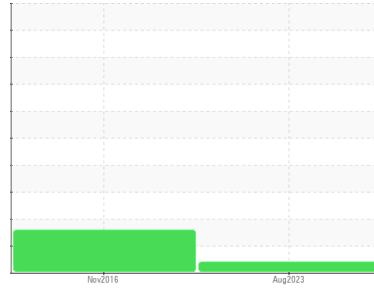

VIS DEBRIS



Machine Id
KAESER BS61 1375278 (S/N 1032)

Component
Compressor

Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

▲ Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA001495	KCP58858	---
Sample Date	Client Info			09 Aug 2023	17 Nov 2016	---
Machine Age	hrs	Client Info		63216	35889	---
Oil Age	hrs	Client Info		32845	4200	---
Oil Changed		Client Info		N/A	Changed	---
Sample Status				ABNORMAL	ATTENTION	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	19	<1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	<1	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	5	2	---
Lead	ppm	ASTM D5185m	>10	0	0	---
Copper	ppm	ASTM D5185m	>50	5	15	---
Tin	ppm	ASTM D5185m	>10	0	0	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		<1	0	---
Cadmium	ppm	ASTM D5185m		0	0	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m		2	0	---
Calcium	ppm	ASTM D5185m		0	2	---
Phosphorus	ppm	ASTM D5185m	500	246	14	---
Zinc	ppm	ASTM D5185m		109	5	---
Sulfur	ppm	ASTM D5185m		3424	18077	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	1	---
Sodium	ppm	ASTM D5185m		2	<1	---
Potassium	ppm	ASTM D5185m	>20	<1	0	---
Water	%	ASTM D6304	>0.05	0.004	0.004	---
ppm Water	ppm	ASTM D6304	>500	43.1	40	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		---	1333	---
Particles >6µm		ASTM D7647	>1300	---	726	---
Particles >14µm		ASTM D7647	>80	---	▲ 123	---
Particles >21µm		ASTM D7647	>20	---	▲ 41	---
Particles >38µm		ASTM D7647	>4	---	▲ 6	---
Particles >71µm		ASTM D7647	>3	---	0	---
Oil Cleanliness		ISO 4406 (c)	>17/13	---	▲ 17/14	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	0.80	0.362	---


OIL ANALYSIS REPORT

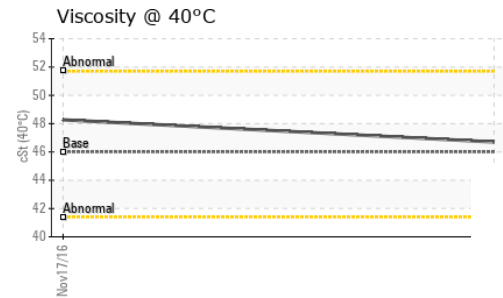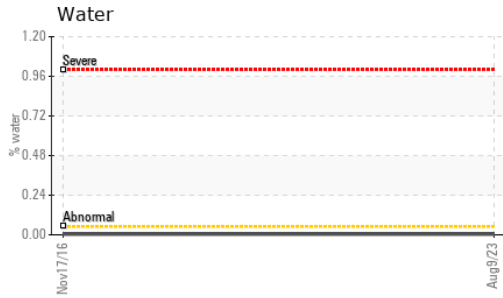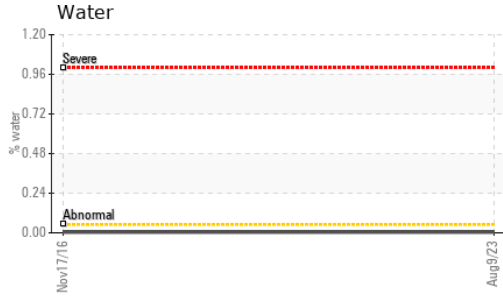





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	▲ MODER	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	46.7	48.27	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

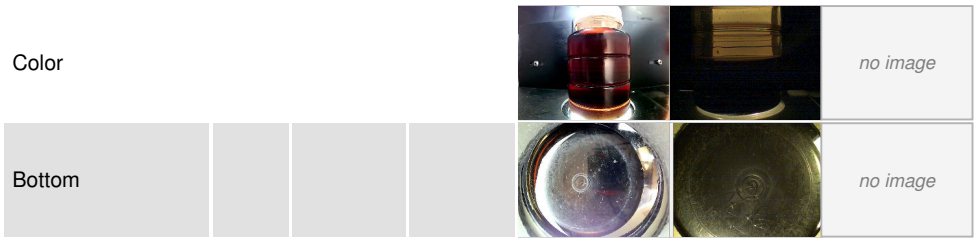

GRAPHS

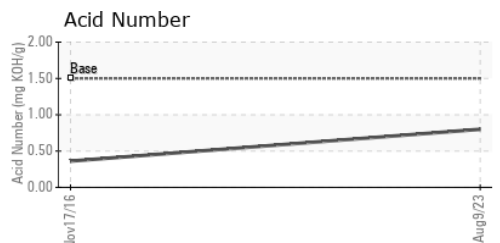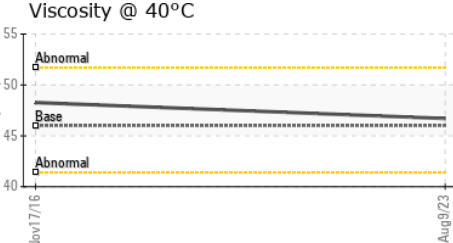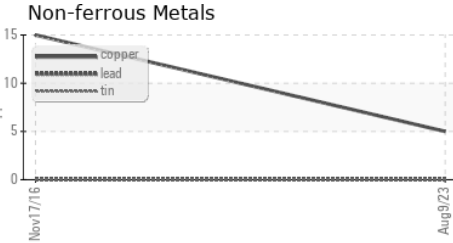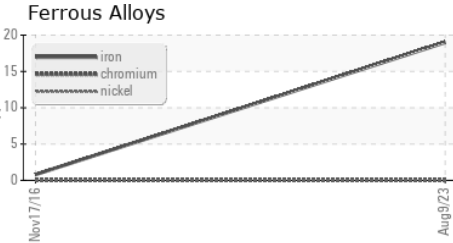

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA001495 **Received** : 21 Aug 2023
Lab Number : 05929582 **Diagnosed** : 22 Aug 2023
Unique Number : 10609529 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

MONTE VISTA FARM
 5043 N MONTPELIER RD
 DENAIR, CA
 US 95316
 Contact: J BEAVEN
 JBEAVEN@MONTEVISTAFARMING.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: