




# PROBLEM SUMMARY

Sample Rating Trend

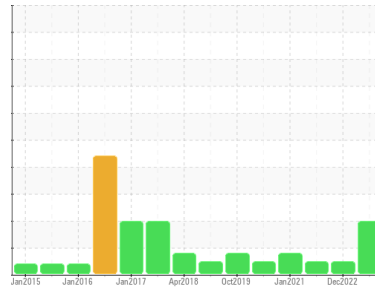

ISO




Machine Id  
**KAESER ASD 30 3061412 (S/N 1333)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

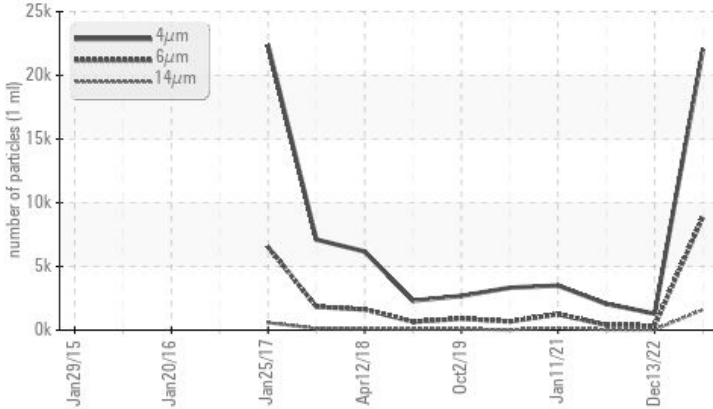

## RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	NORMAL
Particles >6µm	ASTM D7647	>1300	▲ <b>8911</b>	341	406
Particles >14µm	ASTM D7647	>80	▲ <b>1600</b>	30	37
Particles >21µm	ASTM D7647	>20	▲ <b>542</b>	13	8
Particles >38µm	ASTM D7647	>4	▲ <b>19</b>	2	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>22/20/18</b>	17/16/12	16/12

Customer Id: SCHBLAKC  
Sample No.: KC101776  
Lab Number: 05929586  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Angela Borella +1 800-237-1369  
[angela.borella@wearcheckusa.com](mailto:angela.borella@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

## HISTORICAL DIAGNOSIS

### 13 Dec 2022 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 27 Jul 2021 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 11 Jan 2021 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

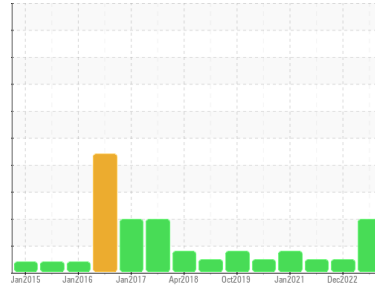

ISO



Machine Id  
**KAESER ASD 30 3061412 (S/N 1333)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KC101776</b>	KC106682	KC99279
Sample Date	Client Info	<b>07 Aug 2023</b>	13 Dec 2022	27 Jul 2021
Machine Age	hrs	<b>43181</b>	40734	33086
Oil Age	hrs	<b>2449</b>	6003	2429
Oil Changed	Client Info	<b>Not Chngd</b>	Changed	Not Chngd
Sample Status		<b>ABNORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	<1	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	1	0
Copper	ppm	ASTM D5185m >50	<b>5</b>	6	3
Tin	ppm	ASTM D5185m >10	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	14
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 90	<b>28</b>	13	36
Calcium	ppm	ASTM D5185m 2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>10</b>	6	3
Zinc	ppm	ASTM D5185m	<b>12</b>	10	11

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>0</b>	2	0
Sodium	ppm	ASTM D5185m	<b>11</b>	6	16
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	9	<1
Water	%	ASTM D6304 >0.05	<b>0.017</b>	0.005	0.022
ppm Water	ppm	ASTM D6304 >500	<b>171.7</b>	59.9	221.7






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>22046</b>	1287	2058
Particles >6µm	ASTM D7647 >1300	<b>▲ 8911</b>	341	406
Particles >14µm	ASTM D7647 >80	<b>▲ 1600</b>	30	37
Particles >21µm	ASTM D7647 >20	<b>▲ 542</b>	13	8
Particles >38µm	ASTM D7647 >4	<b>▲ 19</b>	2	0
Particles >71µm	ASTM D7647 >3	<b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	<b>▲ 22/20/18</b>	17/16/12	16/12

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.34</b>	0.35	0.331


# OIL ANALYSIS REPORT

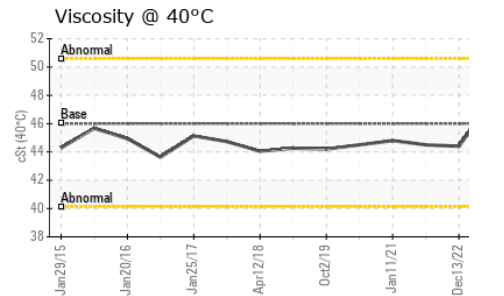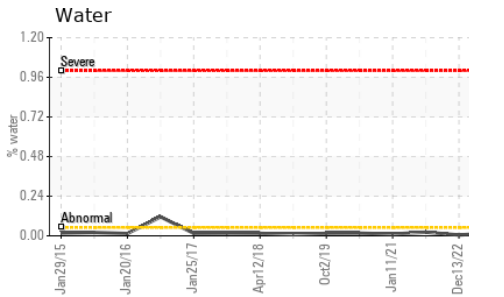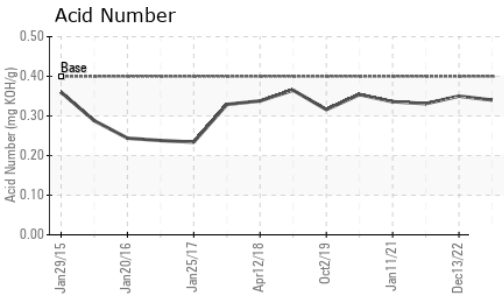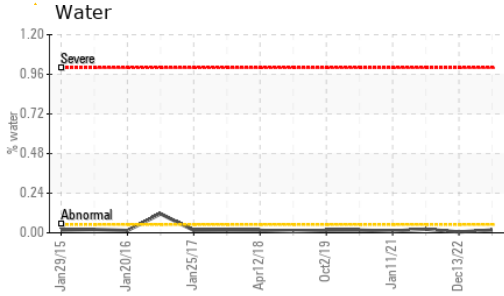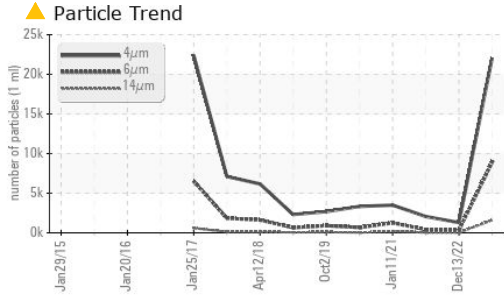






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	47.6	44.4	44.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

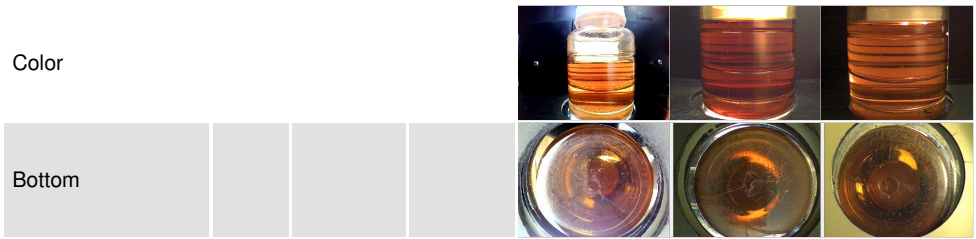

## GRAPHS

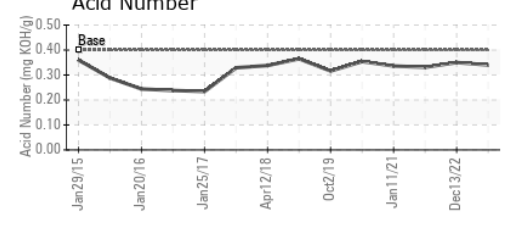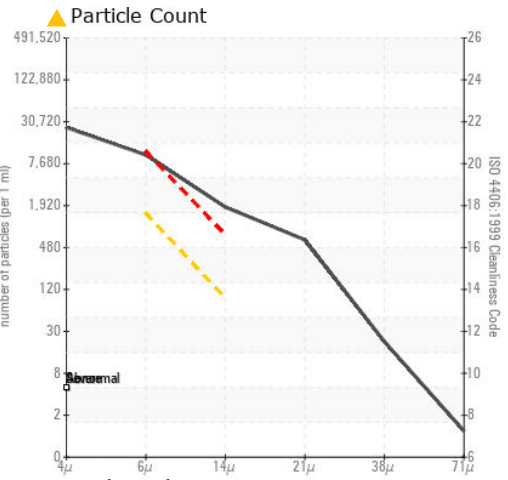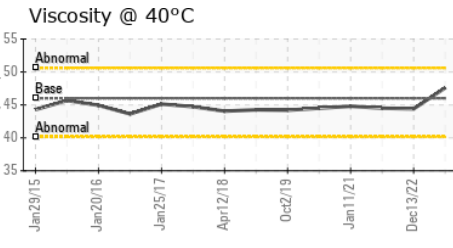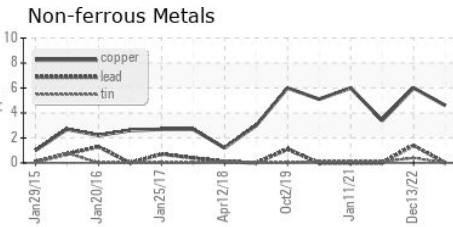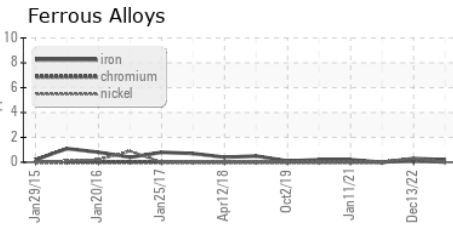

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC101776 **Received** : 21 Aug 2023  
**Lab Number** : 05929586 **Diagnosed** : 23 Aug 2023  
**Unique Number** : 10609533 **Diagnostician** : Angela Borella  
**Test Package** : IND 2

**SCHREINER-MEDIPHARM**  
 500 BRADLEY HILL RD  
 BLAUVELT, NY  
 US 10913  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: