


PROBLEM SUMMARY

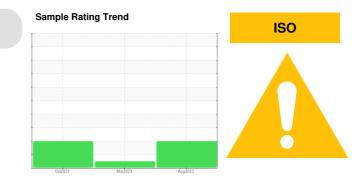


KAESER 8406163 (S/N 1166)

Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

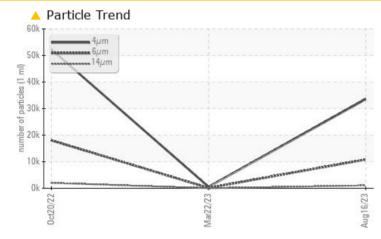

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status		ABNOR	MAL NORMAL	ABNORMAL			
Particles >6µm	ASTM D7647 >	1300 A 10820) 111	18038			
Particles >14µm	ASTM D7647 >	80 A 1058	12	<u> </u>			
Particles >21µm	ASTM D7647 >	20 4 302	4	482			
Particles >38µm	ASTM D7647 >	4 🔺 7	0	<u> </u>			
Oil Cleanliness	ISO 4406 (c) >	/17/13 🔺 22/21	/ 17 16/14/11	A 23/21/18			

Customer Id: WABWABKC Sample No.: KC05929596 Lab Number: 05929596 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Angela Borella +1 800-237-1369 angela.borella@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

RECOMMENDED ACTIONS					
Action	Status	Date	Done By	Description	
Change Filter			?	We recommend you service the filters on this component.	

HISTORICAL DIAGNOSIS

NODUAL



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



20 Oct 2022 Diag: Doug Bogart

22 Mar 2023 Diag: Angela Borella




We recommend you service the filters on this component. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

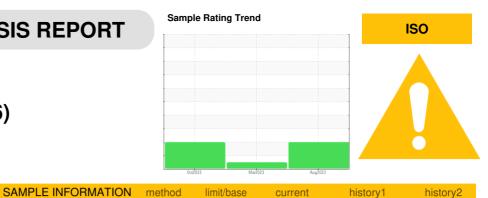

Machine Id KAESER 8406163 (S/N 1166) Component

Compressor

Fluid KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination


There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	ATION	method	limit/base	current	nistory i	nistory2
Sample Number		Client Info		KC05929596	KC100526	KC104207
Sample Date		Client Info		16 Aug 2023	22 Mar 2023	20 Oct 2022
Machine Age	hrs	Client Info		9014	6165	3207
Oil Age	hrs	Client Info		8186	4206	1248
Oil Changed		Client Info		Not Changd	Changed	Not Changd
Sample Status				ABNORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	13	3	7
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	2	<1	44
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		<1	43	0
Zinc	ppm	ASTM D5185m		0	0	0
CONTAMINANTS	\$	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	3	3
Sodium	ppm	ASTM D5185m		1	<1	17
Potassium	ppm	ASTM D5185m	>20	0	0	8
Water	%	ASTM D6304	>0.05	0.006	0.004	0.016
ppm Water	ppm	ASTM D6304	>500	62.1	45.3	160.0
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		33553	540	52286
Particles >6µm		ASTM D7647	>1300	<u> </u>	111	<u> </u>
Particles >14µm		ASTM D7647	>80	<u> </u>	12	2 024
Particles >21µm		ASTM D7647	>20	<u> </u>	4	<u> </u>
Particles >38µm		ASTM D7647	>4	<mark>/</mark> 7	0	<u> </u>
Particles >71µm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u> </u>	16/14/11	▲ 23/21/18
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.45	0.49	0.42








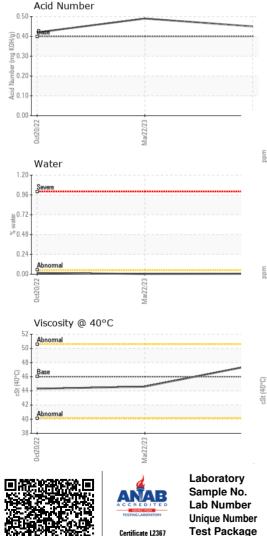

OIL ANALYSIS REPORT

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	47.6	44.6	44.3
SAMPLE IMAGE	S	method	limit/base	current	history1	history2
Color						
					1	

Bottom

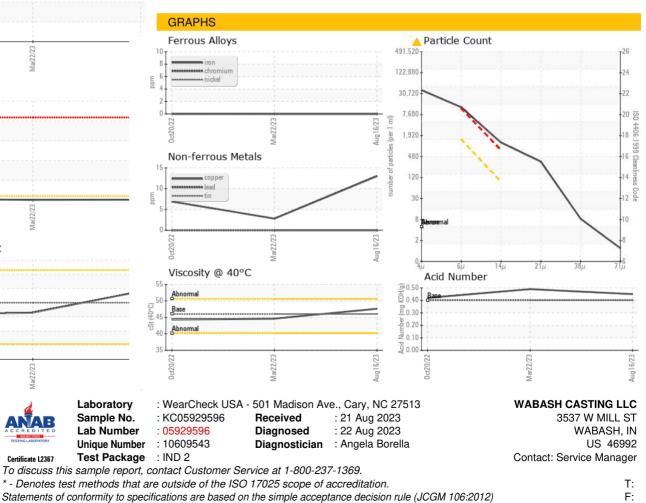

Report Id: WABWABKC [WUSCAR] 05929596 (Generated: 08/22/2023 17:38:14) Rev: 1

Contact/Location: Service Manager - WABWABKC