




# PROBLEM SUMMARY

## Sample Rating Trend

ISO




Machine Id  
**INGERSOLL RAND AC 2 (S/N CK2626U00014)**  
 Component  
**Air Compressor**  
 Fluid  
**INGERSOLL-RAND ULTRA FG (10 GAL)**

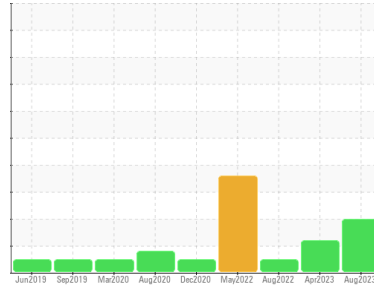

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

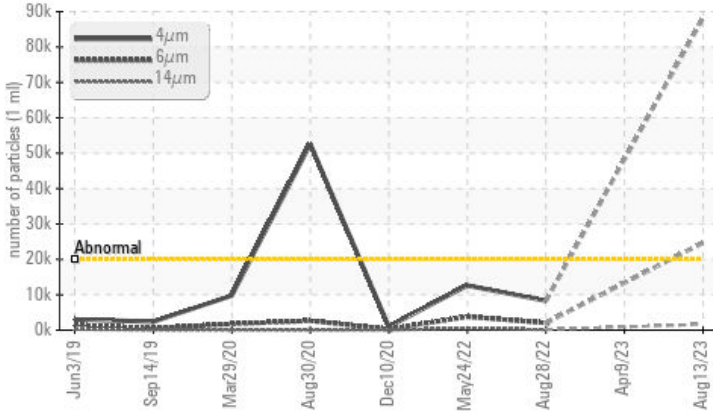

## RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status	ASTM D7647	ASTM D7647	ABNORMAL	ABNORMAL	NORMAL
Particles >4µm	>20000	>20000	▲ 88232	---	8282
Particles >6µm	>2500	>2500	▲ 24697	---	2058
Particles >14µm	>320	>320	▲ 1640	---	147
Particles >21µm	>80	>80	▲ 359	---	26
Oil Cleanliness	ISO 4406 (c)	>21/18/15	▲ 24/22/18	---	20/18/14

Customer Id: PERPERUSP  
 Sample No.: USP237852  
 Lab Number: 05929615  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

## HISTORICAL DIAGNOSIS

### 09 Apr 2023 Diag: Doug Bogart

#### SEDIMENT



We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. There is a moderate amount of visible silt present in the sample. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



### 28 Aug 2022 Diag: Doug Bogart

#### NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



### 24 May 2022 Diag: Doug Bogart

#### DIRT



Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. Elemental level of silicon (Si) above normal. Additive levels indicate the addition of a different brand or type of oil. Confirm. The AN level is acceptable for this fluid.


[view report](#)





# OIL ANALYSIS REPORT

Sample Rating Trend

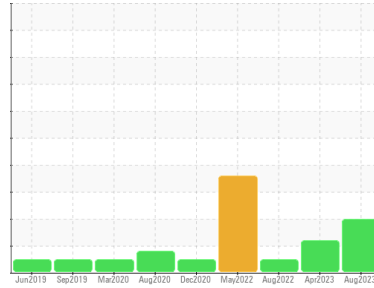

ISO



Machine Id  
**INGERSOLL RAND AC 2 (S/N CK2626U00014)**

Component  
**Air Compressor**

Fluid  
**INGERSOLL-RAND ULTRA FG (10 GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP237852</b>	USP218705	USP242984
Sample Date	Client Info		<b>13 Aug 2023</b>	09 Apr 2023	28 Aug 2022
Machine Age	hrs	Client Info	<b>7244</b>	5307	4209
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>1</b>	2	<1
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >4	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >40	<b>2</b>	<1	<1
Tin	ppm	ASTM D5185m >5	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>13</b>	48	89
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	0	1
Calcium	ppm	ASTM D5185m	<b>19</b>	41	55
Phosphorus	ppm	ASTM D5185m	<b>298</b>	289	313
Zinc	ppm	ASTM D5185m	<b>25</b>	6	29
Sulfur	ppm	ASTM D5185m	<b>525</b>	634	674

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	13	18
Sodium	ppm	ASTM D5185m	<b>14</b>	17	18
Potassium	ppm	ASTM D5185m >20	<b>2</b>	<1	3
Water	%	ASTM D6304 >0.6	<b>0.013</b>	0.033	0.058
ppm Water	ppm	ASTM D6304 >6000	<b>132.7</b>	332.2	580.1

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>▲ 88232</b>	---	8282
Particles >6µm	ASTM D7647	>2500	<b>▲ 24697</b>	---	2058
Particles >14µm	ASTM D7647	>320	<b>▲ 1640</b>	---	147
Particles >21µm	ASTM D7647	>80	<b>▲ 359</b>	---	26
Particles >38µm	ASTM D7647	>20	<b>4</b>	---	2
Particles >71µm	ASTM D7647	>4	<b>0</b>	---	1
Oil Cleanliness	ISO 4406 (c)	>21/18/15	<b>▲ 24/22/18</b>	---	20/18/14

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.39</b>	0.28	0.26




# OIL ANALYSIS REPORT

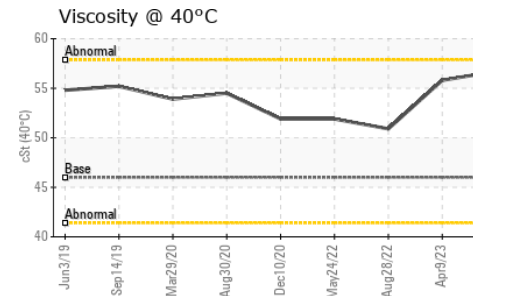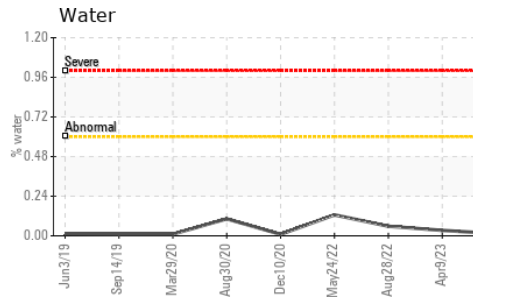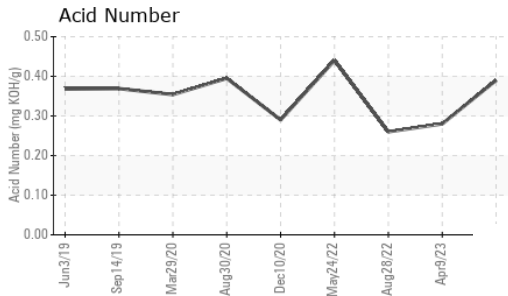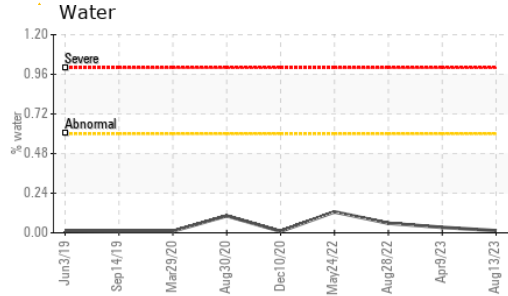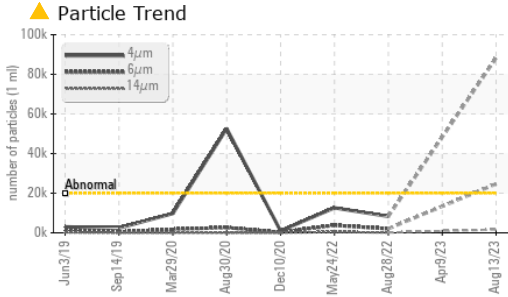





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	▲ MODER	NONE
Debris	scalar	*Visual	NONE	▲ MODER	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46.0	56.7	55.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

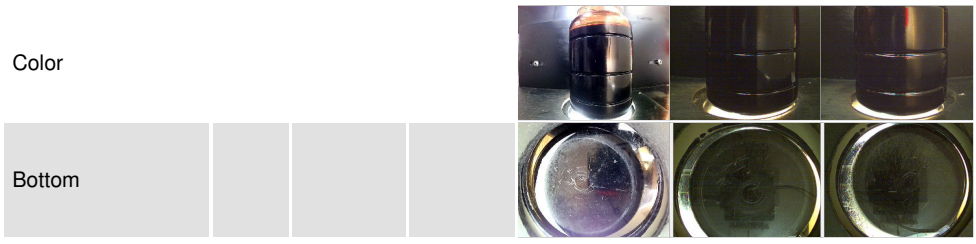

## GRAPHS

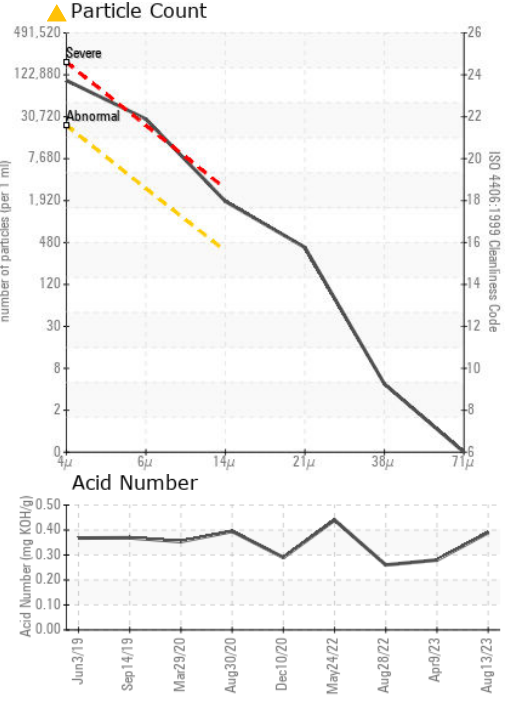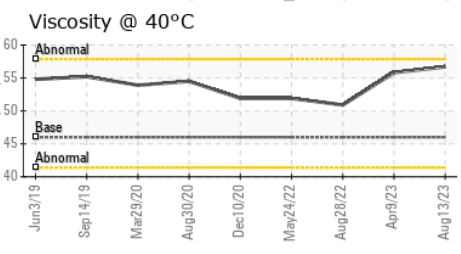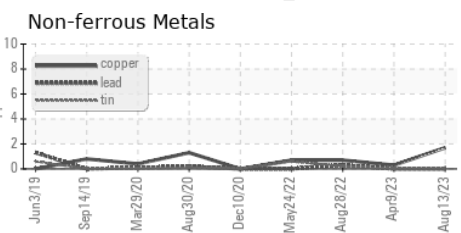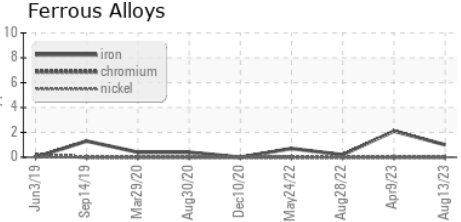

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP237852 **Received** : 21 Aug 2023  
**Lab Number** : 05929615 **Diagnosed** : 23 Aug 2023  
**Unique Number** : 10609562 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**PERDUE FARMS INC**  
 250 GEORGIA HWY 247 SPUR  
 PERRY, GA  
 US 31069  
 Contact: JAMES EAST  
 james.east@perdue.com  
 T: (478)988-6048  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)