




OIL ANALYSIS REPORT

Sample Rating Trend

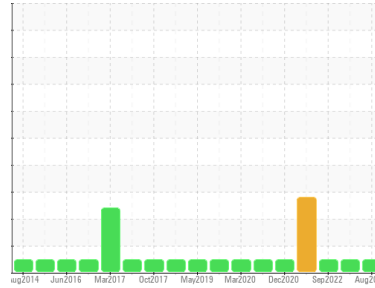

NORMAL



Area
ENGINE ROOM
Machine Id
FRICK C11-1 (S/N SGC28240017 / F0013ZFMCTHAA03)
Component
Refrigeration Compressor
Fluid
FRICK COMPRESSOR OIL #3 (--- PNT)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	USP0000506	USP218704	USP241510	
Sample Date	Client Info	08 Aug 2023	12 Apr 2023	06 Sep 2022	
Machine Age	hrs	Client Info	0	57186	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info	N/A	Not Chngd	N/A	
Sample Status		NORMAL	NORMAL	NORMAL	

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >8	21	20	12
Chromium	ppm	ASTM D5185m >2	0	0	0
Nickel	ppm	ASTM D5185m	0	0	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >3	0	0	<1
Lead	ppm	ASTM D5185m >2	0	0	<1
Copper	ppm	ASTM D5185m >8	1	<1	<1
Tin	ppm	ASTM D5185m >4	0	0	<1
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m	<1	0	0
Calcium	ppm	ASTM D5185m	0	0	0
Phosphorus	ppm	ASTM D5185m	0	0	0
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m	94	78	93

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	<1	<1	<1
Sodium	ppm	ASTM D5185m	1	1	0
Potassium	ppm	ASTM D5185m >20	0	0	1
Water	%	ASTM D6304 >0.01	0.002	0.001	0.002
ppm Water	ppm	ASTM D6304 >100	21.9	0.9	17.5

FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >20000	8320	2409	4590
Particles >6µm	ASTM D7647 >2500	1313	624	1220
Particles >14µm	ASTM D7647 >320	43	51	55
Particles >21µm	ASTM D7647 >80	8	16	4
Particles >38µm	ASTM D7647 >20	0	0	0
Particles >71µm	ASTM D7647 >4	0	0	0
Oil Cleanliness	ISO 4406 (c) >21/18/15	20/18/13	18/16/13	19/17/13

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974	0.014	0.014	0.014




OIL ANALYSIS REPORT

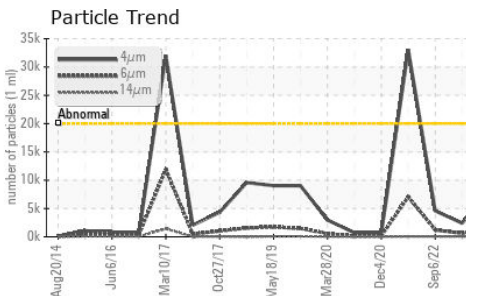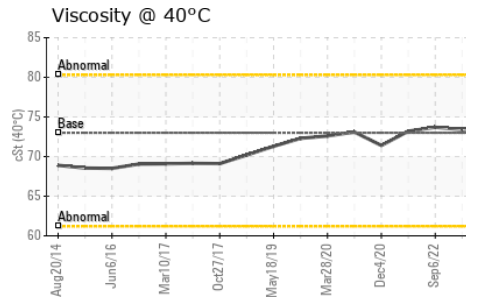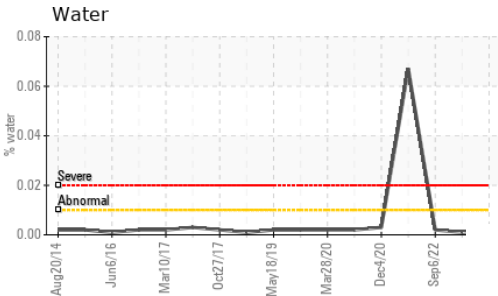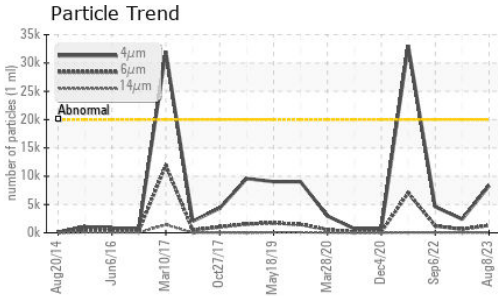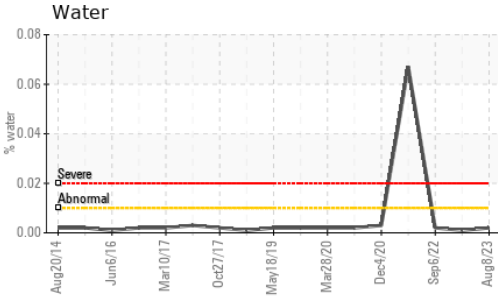






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 73	73.7	73.4	73.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

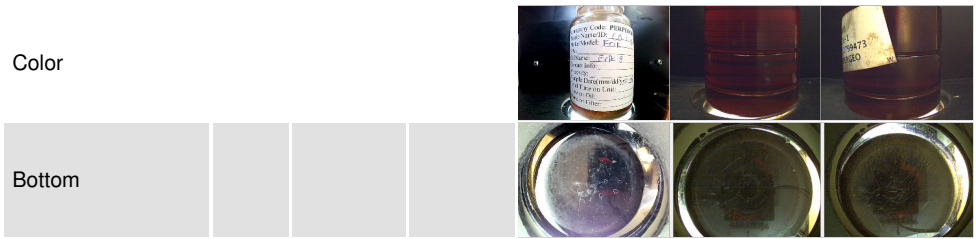

GRAPHS

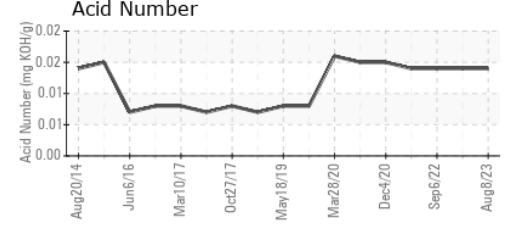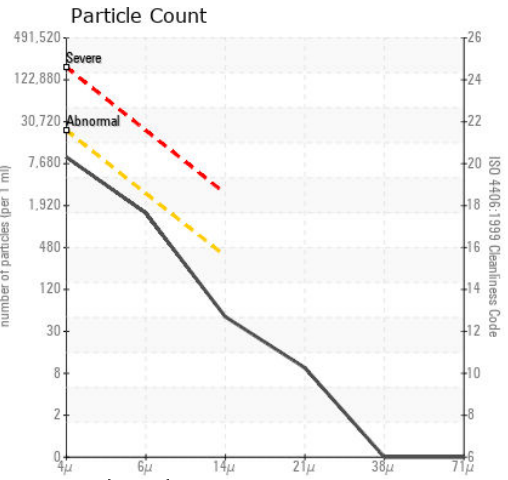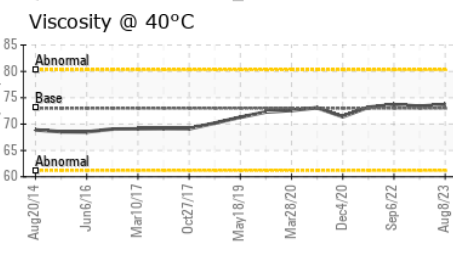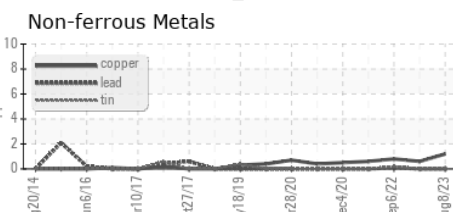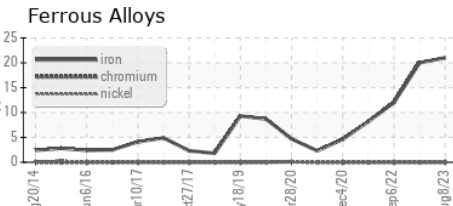

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP0000506 **Received** : 21 Aug 2023
Lab Number : 05929634 **Diagnosed** : 22 Aug 2023
Unique Number : 10609581 **Diagnostician** : Doug Bogart
Test Package : IND 2

PERDUE FARMS INC
 250 GEORGIA HWY 247 SPUR
 PERRY, GA
 US 31069
 Contact: JAMES EAST
 james.east@perdue.com
 T: (478)988-6048
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)