




PROBLEM SUMMARY

Sample Rating Trend


ISO

Area
ENGINE ROOM [PR1375351]
 Machine Id
MYCOM C03-1 (S/N 3235004 / C990635A-2)
 Component
Refrigeration Compressor
 Fluid
FRICK COMPRESSOR OIL #3 (--- PNT)

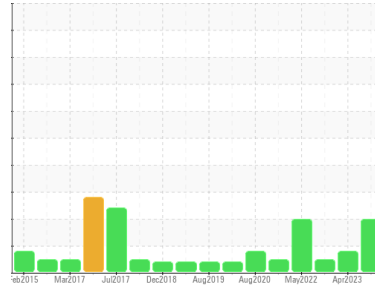

COMPONENT CONDITION SUMMARY

▲ Particle Trend

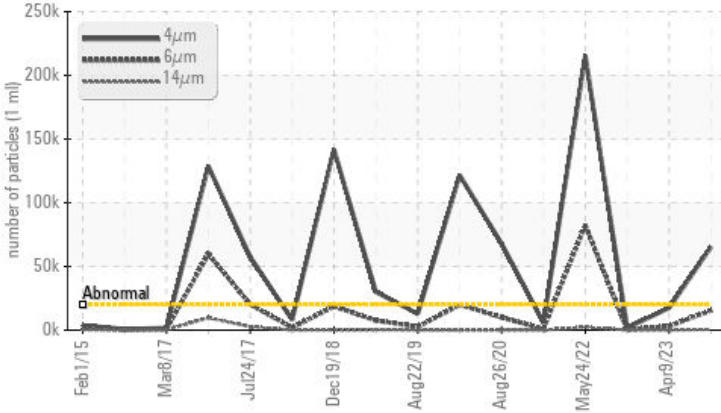

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ATTENTION	NORMAL
Particles >4µm	ASTM D7647	>20000	▲ 65344	17484	1780
Particles >6µm	ASTM D7647	>2500	▲ 15526	▲ 3054	244
Particles >14µm	ASTM D7647	>320	▲ 561	60	10
Particles >21µm	ASTM D7647	>80	▲ 92	16	2
Oil Cleanliness	ISO 4406 (c)	>21/18/15	▲ 23/21/16	▲ 21/19/13	18/15/10

Customer Id: PERPERUSP
 Sample No.: USP245947
 Lab Number: 05929649
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

09 Apr 2023 Diag: Doug Bogart

ISO



Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



30 Aug 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



24 May 2022 Diag: Doug Bogart

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

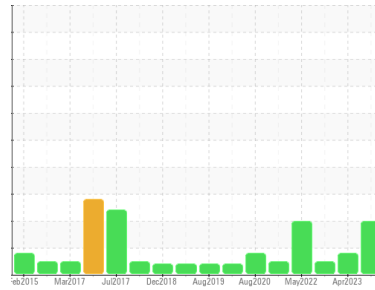

ISO



Area
ENGINE ROOM [PR1375351]
 Machine Id
MYCOM C03-1 (S/N 3235004 / C990635A-2)
 Component
Refrigeration Compressor
 Fluid
FRICK COMPRESSOR OIL #3 (--- PNT)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USP245947	USP245945	USP242996
Sample Date	Client Info		09 Jul 2023	09 Apr 2023	30 Aug 2022
Machine Age	hrs	Client Info	32442	31572	29443
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ATTENTION	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<1	0	0
Chromium	ppm	ASTM D5185m >2	0	0	0
Nickel	ppm	ASTM D5185m	0	0	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >3	0	0	<1
Lead	ppm	ASTM D5185m >2	0	0	<1
Copper	ppm	ASTM D5185m >8	0	0	0
Tin	ppm	ASTM D5185m >4	0	0	<1
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m	0	0	0
Calcium	ppm	ASTM D5185m	0	0	1
Phosphorus	ppm	ASTM D5185m	0	0	0
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m	<1	0	12

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	0	0	<1
Sodium	ppm	ASTM D5185m	<1	<1	0
Potassium	ppm	ASTM D5185m >20	0	0	1
Water	%	ASTM D6304 >0.01	0.003	0.001	0.001
ppm Water	ppm	ASTM D6304 >100	28.3	2.7	8.3

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	▲ 65344	17484	1780
Particles >6µm	ASTM D7647	>2500	▲ 15526	▲ 3054	244
Particles >14µm	ASTM D7647	>320	▲ 561	60	10
Particles >21µm	ASTM D7647	>80	▲ 92	16	2
Particles >38µm	ASTM D7647	>20	1	0	0
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>21/18/15	▲ 23/21/16	▲ 21/19/13	18/15/10


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.014	0.015	0.013




OIL ANALYSIS REPORT


Particle Trend

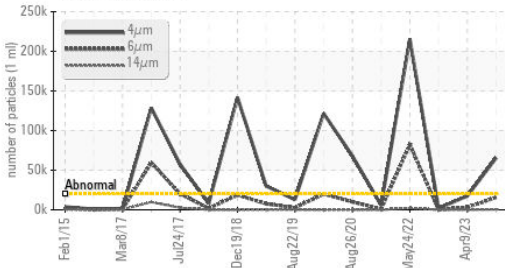


Water

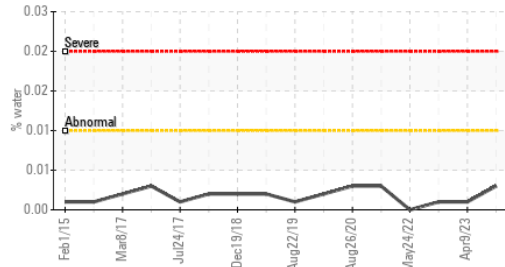


Acid Number

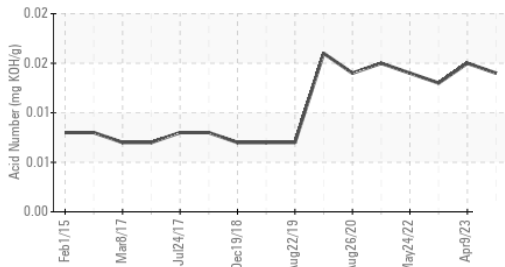

Water

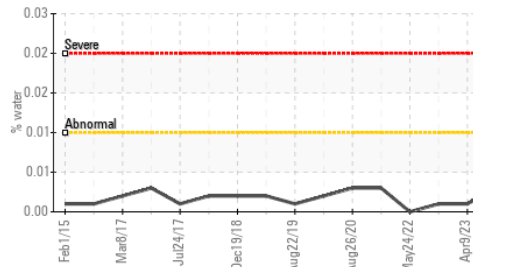

Viscosity @ 40°C

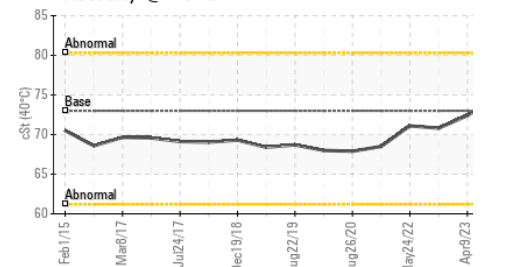


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 73	74.6	72.4	70.8


SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




GRAPHS


Ferrous Alloys

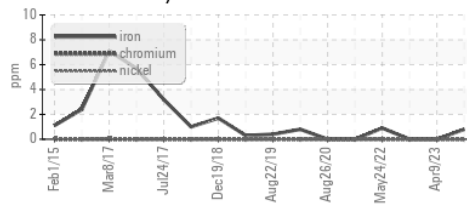


Non-ferrous Metals

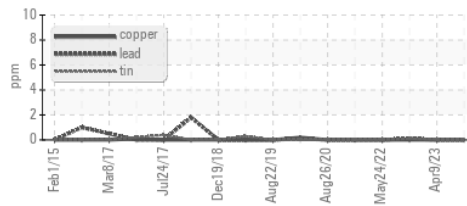


Viscosity @ 40°C

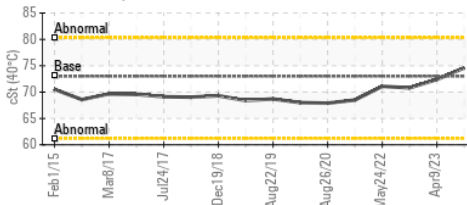

Particle Count

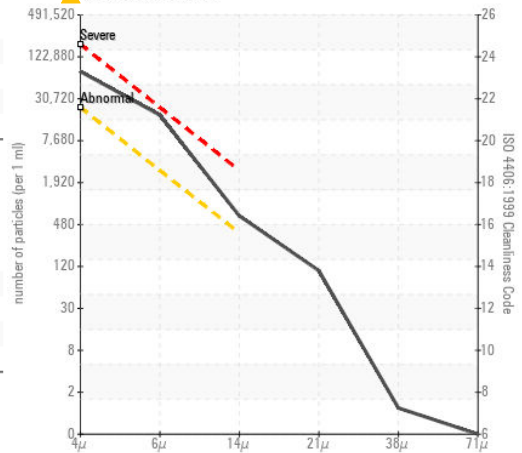

Acid Number

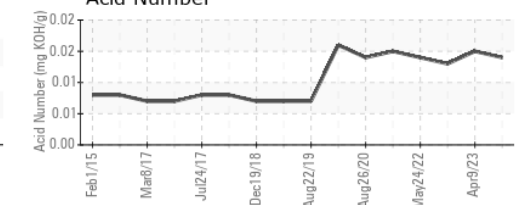

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : USP245947
 Lab Number : 05929649
 Unique Number : 10609596
 Test Package : IND 2

Received : 21 Aug 2023
 Diagnosed : 22 Aug 2023
 Diagnostician : Doug Bogart

PERDUE FARMS INC
 250 GEORGIA HWY 247 SPUR
 PERRY, GA
 US 31069
 Contact: JAMES EAST
 james.east@perdue.com
 T: (478)988-6048
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)