

OIL ANALYSIS REPORT

SULLUBE 32 SULLAIR 80075 - TEXTRON AVIATION (S/N 003-V84341) Component

Compressor

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



Sample Rating Trend




| | | | Apr2023 | Jul2023 | | |
|------------------|------------|----------------------------|------------|-------------|-------------|-------------|
| SAMPLE INFORM | ATION | method | limit/base | current | history1 | history2 |
| Sample Number | | Client Info | | UCH05929701 | UCH05824129 | |
| Sample Date | | Client Info | | 08 Jul 2023 | 13 Apr 2023 | |
| Machine Age | hrs | Client Info | | 58453 | 58382 | |
| Oil Age | hrs | Client Info | | 0 | 0 | |
| Oil Changed | | Client Info | | Not Changd | Changed | |
| Sample Status | | | | NORMAL | NORMAL | |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | <1 | 2 | |
| Chromium | ppm | ASTM D5185m | >10 | 0 | 0 | |
| Nickel | ppm | ASTM D5185m | 210 | ۲ ۲ | 0 | |
| Titanium | ppm | ASTM D5185m | | 0 | 0 | |
| Silver | ppm | ASTM D5185m | | 0 | 0 | |
| Aluminum | ppm | ASTM D5185m | >25 | ۰ <1 | 0 | |
| Lead | | ASTM D5185m | >25 | <1 | 0 | |
| | ppm | ASTM D5185m | | <1 | 0 | |
| Copper Tin | ppm | ASTM D5185m | >50 | <1 <1 | <1 | |
| Vanadium | ppm | ASTM D5185m | >10 | 0 | 0 | |
| Cadmium | ppm ppm | ASTM D5185m ASTM D5185m | | 0 | 0 | |
| ADDITIVES | ppm | | limit/base | | - | history2 |
| | | method | limit/base | current | history1 | · · · · · · |
| Boron | ppm | ASTM D5185m | | 0 | 1 | |
| Barium | ppm | ASTM D5185m | 745 | 980 | 1015 | |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | |
| Manganese | ppm | ASTM D5185m | | 0 | <1 | |
| Magnesium | ppm | ASTM D5185m | | <1 | <1 | |
| Calcium | ppm | | 1 | 6 | 14 | |
| Phosphorus | ppm | ASTM D5185m | 3 | 2 | 1 | |
| Zinc | ppm | ASTM D5185m | | 5 | 13 | |
| Sulfur | ppm | ASTM D5185m | | 344 | 402 | |
| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 0 | 4 | |
| Sodium | ppm | ASTM D5185m | | 15 | 23 | |
| Potassium | ppm | ASTM D5185m | >20 | 1 | <1 | |
| FLUID DEGRADA | TION | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.06 | 0.089 | 0.08 | |
| VISUAL | | method | limit/base | current | history1 | history2 |
| White Metal | scalar | *Visual | NONE | NONE | NONE | |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | |
| Precipitate | scalar | *Visual | NONE | NONE | NONE | |
| Silt | scalar | *Visual | NONE | NONE | NONE | |
| Debris | scalar | *Visual | NONE | NONE | LIGHT | |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | |
| Appearance | scalar | *Visual | NORML | NORML | NORML | |
| Odor | scalar | *Visual | NORML | NORML | NORML | |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | NEG | |
| Free Water | scalar | *Visual | | NEG | NEG | |
| 5:20:05) Pov: 1 | | | 0 | | | |

Report Id: UCAIRWIC [WUSCAR] 05929701 (Generated: 08/23/2023 15:30:05) Rev: 1

Contact/Location: MIKAYLA STOUT - UCAIRWIC



OIL ANALYSIS REPORT

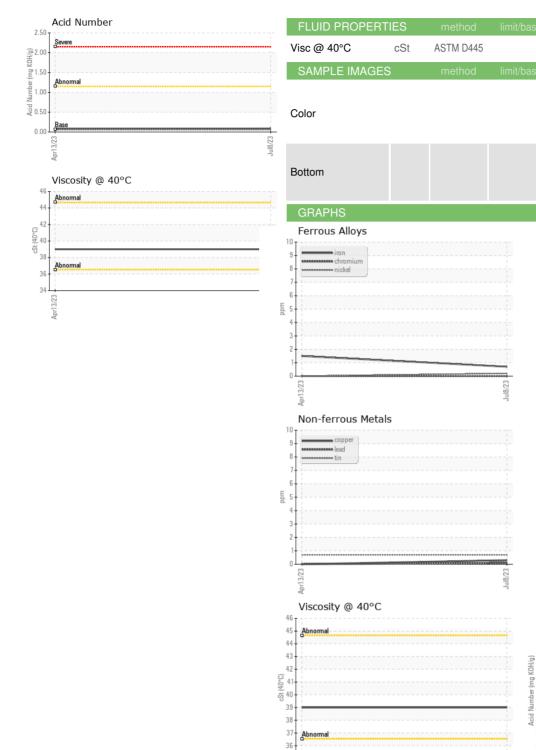

35

Unique Number : 10609648

Test Package : IND 2

Laboratory

Sample No.

Lab Number

Apr13/23

: UCH05929701

: 05929701

Acid Number 2.20 Sever 2.00 1.80 (B/HOX 1.40 1.20 1.00 Numper 0.80 0.60 0.40 0.20 0.00 lul8/23 Apr13/23 : WearCheck USA - 501 Madison Ave., Cary, NC 27513 AIR CAPITAL EQUIPMENT INC Received : 21 Aug 2023 806 E BOSTON ST Diagnosed : 23 Aug 2023 WICHITA, KS Diagnostician : Don Baldridge US 67211 Contact: MIKAYLA STOUT To discuss this sample report, contact Customer Service at 1-800-237-1369. mstout@aircapeq.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (316)522-1111 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: Contact/Location: MIKAYLA STOUT - UCAIRWIC

39.0

39.0

no image

no image

Certificate L2367