


# **OIL ANALYSIS REPORT**

# AiR LUBE 228 [1386596] CHICAGO PNEUMATIC API210912 - SOLVAY

Component

Compressor





### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Aug2023		
OAMBLE INSOR	4471011					11.
SAMPLE INFORM	JATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05929736		
Sample Date		Client Info		14 Aug 2023		
Machine Age	hrs	Client Info		72613		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	<1		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1.5	0		
Barium	ppm	ASTM D5185m	0	2		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m	0.3	0		
Magnesium	ppm	ASTM D5185m	0	<1		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	406	376		
Zinc	ppm	ASTM D5185m	0	24		
Sulfur	ppm	ASTM D5185m	1283	31		
CONTAMINANTS		method	limit/base	current	history1	history2
					,	
Silicon Sodium	ppm	ASTM D5185m	>25	0		
	ppm		00	0		
Potassium	ppm	ASTM D5185m	>20	1		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.463	1.20		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual		NEG		



## **OIL ANALYSIS REPORT**

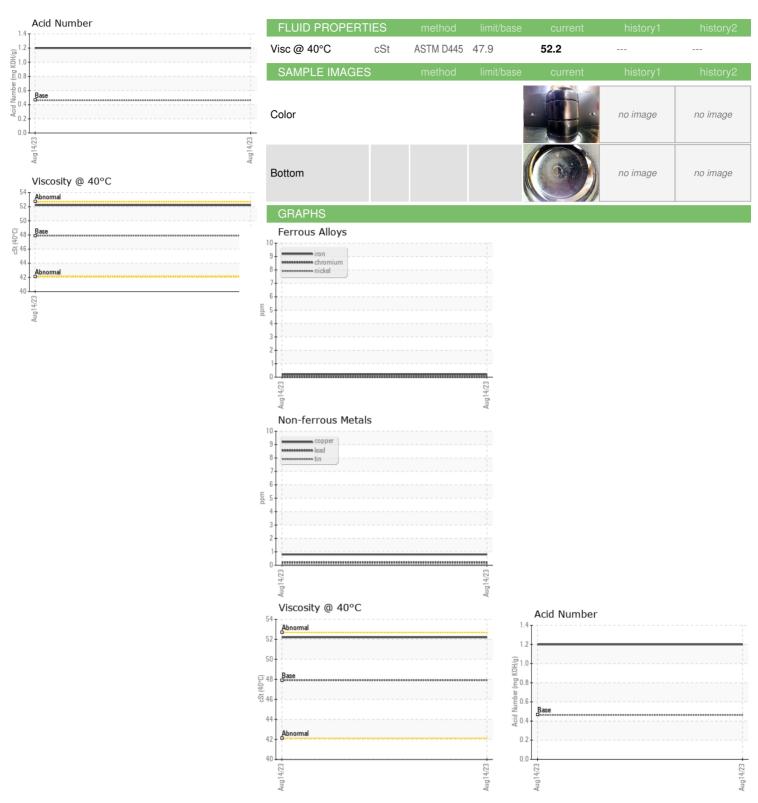





Laboratory Sample No. Lab Number

Unique Number : 10615007

: UCH05929736 : 05929736 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 21 Aug 2023 Diagnosed

: 23 Aug 2023 Diagnostician : Jonathan Hester 160 84TH STREET SW SUITE 1 BYRON CENTER, MI US 49315

AIR TECHNOLOGIES INC (GR)

Contact: STEPHANIE CLAYPOOL stephanie.claypool@aircompressors.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: STEPHANIE CLAYPOOL - UCAIRBYR

F: (616)281-6737

T: