

OIL ANALYSIS REPORT

NOT GIVEN KAESER 1670 - CUSTOM TOOL

Compressor

NOT GIVEN (--- GAL)

Sample Rating Trend **NORMAL**

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UAC05929748		
Sample Date		Client Info		10 Aug 2023		
Machine Age	hrs	Client Info		44919		
Oil Age	hrs	Client Info		4148		
Oil Changed	1110	Client Info		Changed		
Sample Status		Olioni illio		NORMAL		
				HOTHMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m	_	0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		180		
Zinc	ppm	ASTM D5185m		4		
Sulfur	ppm	ASTM D5185m		248		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m	720	0		
Potassium	ppm	ASTM D5185m	>20	<1		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.089		
VISUAL	- "	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water				NEG		
	scalar	*Visual	>0.05			
Free Water	scalar	*Visual		NEG		

Contact/Location: BILL RIMER - UCATLSAL



OIL ANALYSIS REPORT

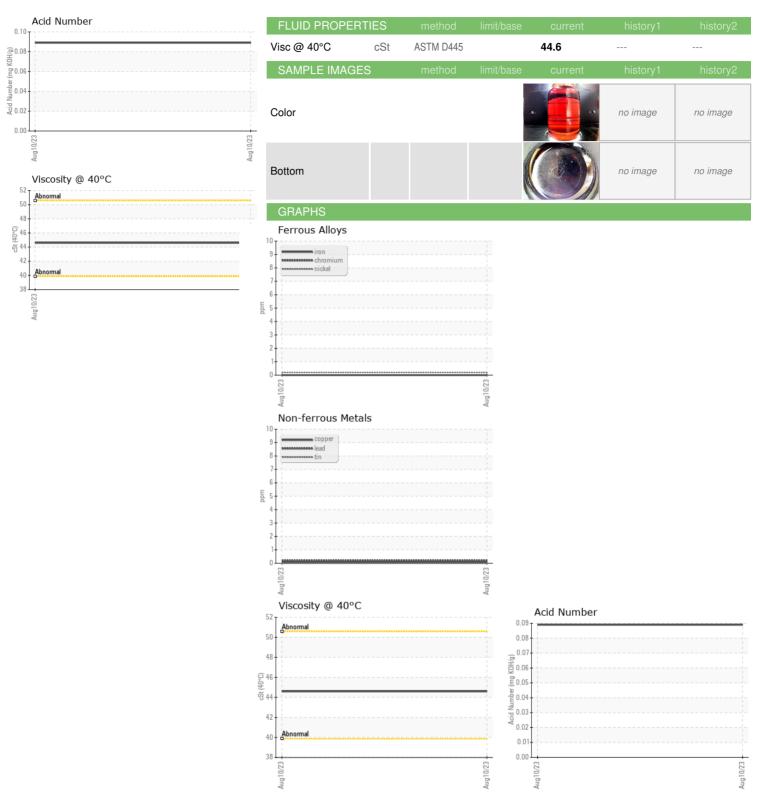





Certificate L2367

Laboratory Sample No. Lab Number

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : 05929748 Unique Number : 10615019 Test Package : IND 2

: UAC05929748

Received : 21 Aug 2023 : 23 Aug 2023 Diagnosed Diagnostician : Jonathan Hester

ATLANTIC COMPRESSORS 2144 SALEM INDUSTRIAL DRIVE

SALEM, VA US 24153

Contact: BILL RIMER bill@atlanticcompressors.com

T: (540)728-1147 F: (757)216-0134

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCATLSAL [WUSCAR] 05929748 (Generated: 08/23/2023 10:18:19) Rev: 1

Contact/Location: BILL RIMER - UCATLSAL