




# OIL ANALYSIS REPORT

Sample Rating Trend

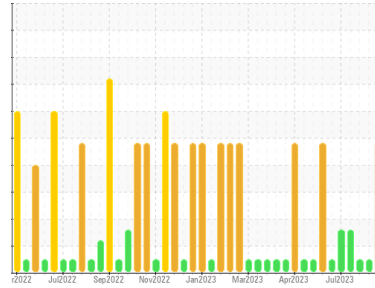

**DIRT**



Machine Id  
**Brent Run CAT 4 BRRM04BE**  
 Component  
**Biogas Engine**  
 Fluid  
**CHEVRON HDAX 6500 LFG GAS ENGINE OIL (--- GAL)**

## DIAGNOSIS

### Recommendation

We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition. ( Customer Sample Comment: 600 hr sample )

### Wear

All component wear rates are normal.

### Contamination

Elemental level of silicon (Si) above normal.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

|               | method      | limit/base  | current            | history1    | history2    |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info |             | <b>WC0776847</b>   | WC0776850   | WC0776846   |
| Sample Date   | Client Info |             | <b>17 Aug 2023</b> | 08 Aug 2023 | 01 Aug 2023 |
| Machine Age   | hrs         | Client Info | <b>102667</b>      | 102458      | 102291      |
| Oil Age       | hrs         | Client Info | <b>643</b>         | 434         | 267         |
| Oil Changed   | Client Info |             | <b>Not Chngd</b>   | Not Chngd   | Not Chngd   |
| Sample Status |             |             | <b>SEVERE</b>      | NORMAL      | NORMAL      |

## CONTAMINATION

|        | method    | limit/base | current        | history1 | history2 |
|--------|-----------|------------|----------------|----------|----------|
| Fuel   | WC Method | >4.0       | <b>&lt;1.0</b> | <1.0     | <1.0     |
| Glycol | WC Method |            | <b>NEG</b>     | NEG      | NEG      |

## WEAR METALS

|          | method | limit/base  | current | history1     | history2 |
|----------|--------|-------------|---------|--------------|----------|
| Iron     | ppm    | ASTM D5185m | >15     | <b>3</b>     | 3        |
| Chromium | ppm    | ASTM D5185m | >4      | <b>&lt;1</b> | <1       |
| Nickel   | ppm    | ASTM D5185m | >2      | <b>&lt;1</b> | <1       |
| Titanium | ppm    | ASTM D5185m |         | <b>0</b>     | 0        |
| Silver   | ppm    | ASTM D5185m | >5      | <b>0</b>     | 0        |
| Aluminum | ppm    | ASTM D5185m | >6      | <b>3</b>     | 4        |
| Lead     | ppm    | ASTM D5185m | >9      | <b>&lt;1</b> | <1       |
| Copper   | ppm    | ASTM D5185m | >6      | <b>2</b>     | 1        |
| Tin      | ppm    | ASTM D5185m | >4      | <b>5</b>     | 4        |
| Vanadium | ppm    | ASTM D5185m |         | <b>0</b>     | 0        |
| Cadmium  | ppm    | ASTM D5185m |         | <b>0</b>     | 0        |

## ADDITIVES

|            | method | limit/base  | current | history1     | history2 |
|------------|--------|-------------|---------|--------------|----------|
| Boron      | ppm    | ASTM D5185m |         | <b>0</b>     | 1        |
| Barium     | ppm    | ASTM D5185m |         | <b>0</b>     | 0        |
| Molybdenum | ppm    | ASTM D5185m |         | <b>2</b>     | 2        |
| Manganese  | ppm    | ASTM D5185m |         | <b>&lt;1</b> | <1       |
| Magnesium  | ppm    | ASTM D5185m |         | <b>10</b>    | 12       |
| Calcium    | ppm    | ASTM D5185m |         | <b>1943</b>  | 1934     |
| Phosphorus | ppm    | ASTM D5185m |         | <b>276</b>   | 298      |
| Zinc       | ppm    | ASTM D5185m |         | <b>356</b>   | 345      |
| Sulfur     | ppm    | ASTM D5185m |         | <b>3124</b>  | 3264     |

## CONTAMINANTS

|           | method | limit/base  | current | history1   | history2 |
|-----------|--------|-------------|---------|------------|----------|
| Silicon   | ppm    | ASTM D5185m | >181    | <b>239</b> | 172      |
| Sodium    | ppm    | ASTM D5185m |         | <b>0</b>   | 2        |
| Potassium | ppm    | ASTM D5185m | >20     | <b>2</b>   | 1        |

## INFRA-RED





|           | method   | limit/base  | current | history1    | history2 |
|-----------|----------|-------------|---------|-------------|----------|
| Soot %    | %        | *ASTM D7844 |         | <b>0</b>    | 0        |
| Nitration | Abs/cm   | *ASTM D7624 | >20     | <b>6.8</b>  | 6.3      |
| Sulfation | Abs/.1mm | *ASTM D7415 | >30     | <b>23.5</b> | 21.0     |

## FLUID DEGRADATION

|                  | method   | limit/base  | current | history1    | history2 |
|------------------|----------|-------------|---------|-------------|----------|
| Oxidation        | Abs/.1mm | *ASTM D7414 | >25     | <b>16.8</b> | 13.5     |
| Acid Number (AN) | mg KOH/g | ASTM D8045  | 1.2     | <b>1.98</b> | 1.43     |
| Base Number (BN) | mg KOH/g | ASTM D2896  | 4.5     | <b>3.50</b> | 5.12     |











# OIL ANALYSIS REPORT

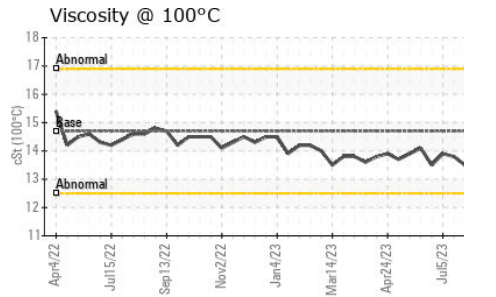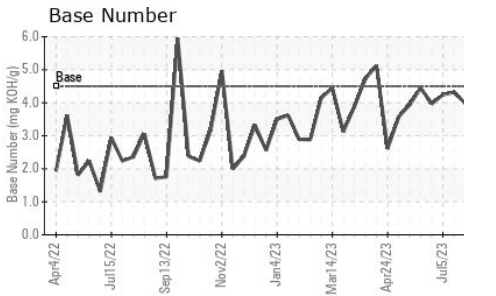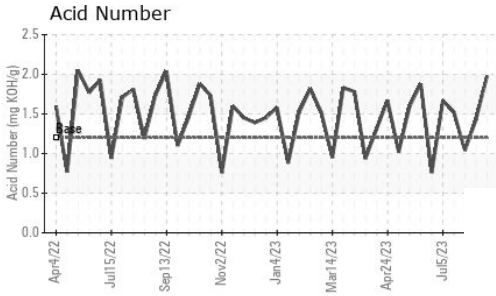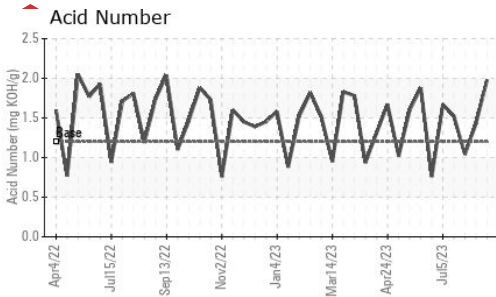

| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | NONE     | NONE     |
| Debris           | scalar | *Visual    | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.1    | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 100°C     | cSt    | ASTM D445  | 14.7    | 13.8     | 13.6     |

### GRAPHS

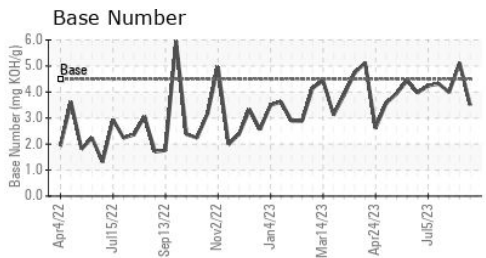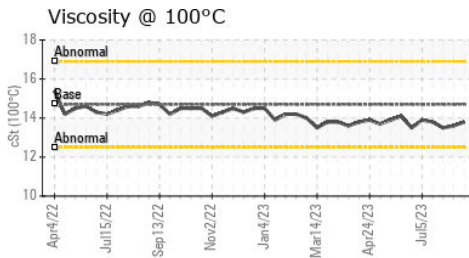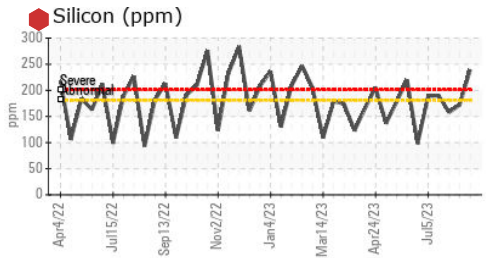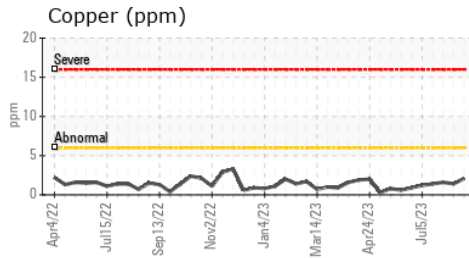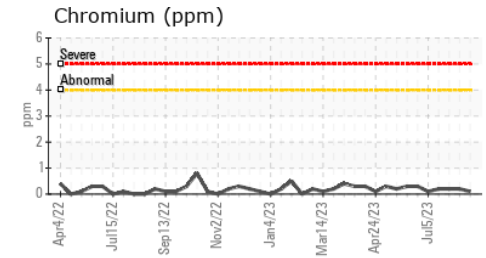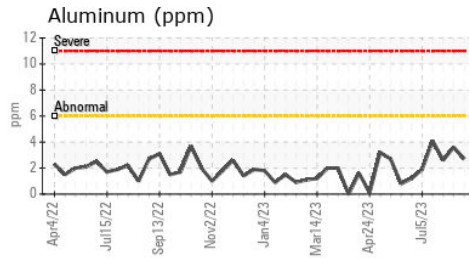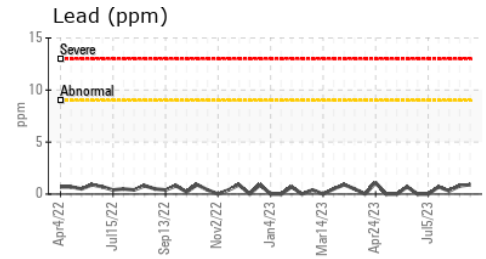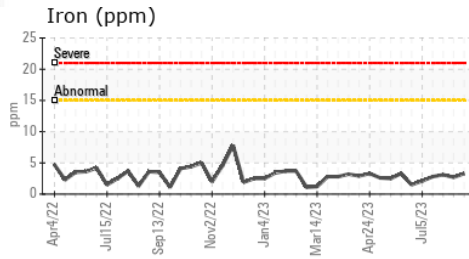

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0776847 **Received** : 21 Aug 2023  
**Lab Number** : 05929858 **Diagnosed** : 23 Aug 2023  
**Unique Number** : 10615129 **Diagnostician** : Jonathan Hester  
**Test Package** : MOB 2

**EDL NA Recips-Brent Run**  
 Brent Run Power Station, 8383 Vienna Road  
 Montrose, MI  
 US 48457-9141  
 Contact: Jenna Hiltz  
 Jenna.Hiltz@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: