




FUEL REPORT

Sample Rating Trend

NORMAL



Machine Id
3VA384904 - WRRF BLIND BROOK WESTCHESTER CO 8VA384904
 Component
Diesel Fuel
 Fluid
NOT GIVEN (--- GAL)

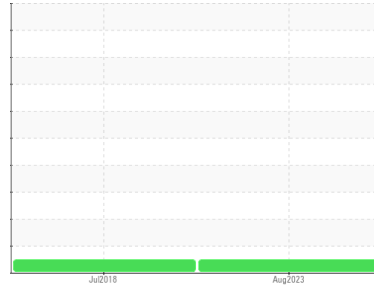

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample.

Contaminants

There is no indication of any contamination in the fuel.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0748883	WCM1394919	---
Sample Date	Client Info			20 Aug 2023	09 Jul 2018	---
Machine Age	hrs	Client Info		0	360	---
Sample Status				NORMAL	NORMAL	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		2.44	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		0	32	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0	<1	---
Sodium	ppm	ASTM D5185m	<0.1	0	<1	---
Potassium	ppm	ASTM D5185m	<0.1	0	10	---


HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	<1	---
Nickel	ppm	ASTM D5185m	<0.1	<1	0	---
Lead	ppm	ASTM D5185m	<0.1	<1	3	---
Vanadium	ppm	ASTM D5185m	<0.1	0	0	---
Iron	ppm	ASTM D5185m	<0.1	<1	<1	---
Calcium	ppm	ASTM D5185m	<0.1	<1	3	---
Magnesium	ppm	ASTM D5185m	<0.1	<1	0	---
Phosphorus	ppm	ASTM D5185m	<0.1	<1	0	---
Zinc	ppm	ASTM D5185m	<0.1	0	2	---

SAMPLE IMAGES


method	limit/base	current	history1	history2	
Color					no image
Bottom					no image



FUEL REPORT

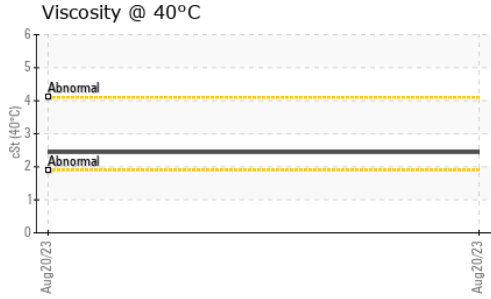

GRAPHS

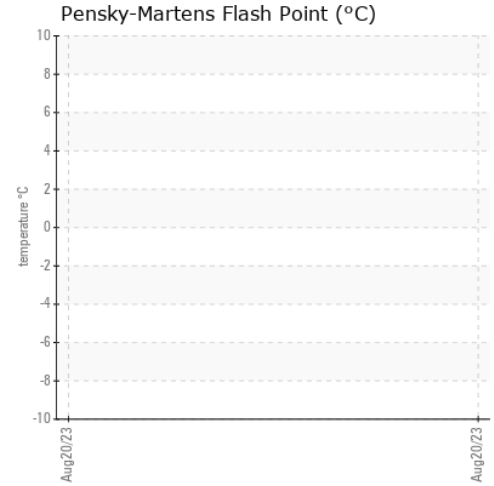

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0748883 **Received** : 21 Aug 2023
Lab Number : 05930097 **Diagnosed** : 23 Aug 2023
Unique Number : 10615368 **Diagnostician** : Jonathan Hester
Test Package : MOB 1

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

GEN TECH LTD
 3017 RT 9W
 NEW WINDSOR, NY
 US 12553
 Contact: JOE SAYEGH
 joe@gentechltd.com
 T: (845)568-0500
 F: (845)568-3073