


PROBLEM SUMMARY

Sample Rating Trend




VISCOSITY

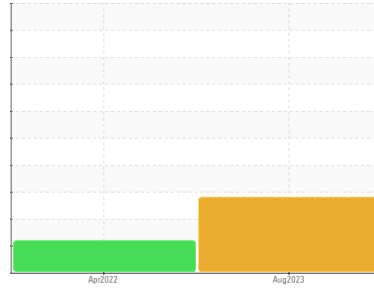


Machine Id
KAESER 7417309 (S/N 1002)
Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Viscosity @ 40°C

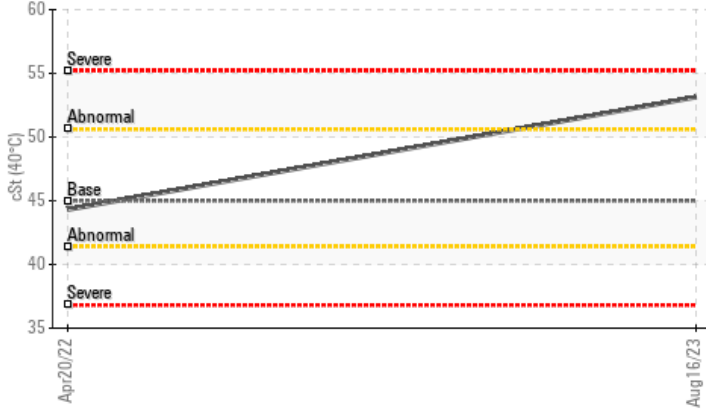

▲ Particle Trend

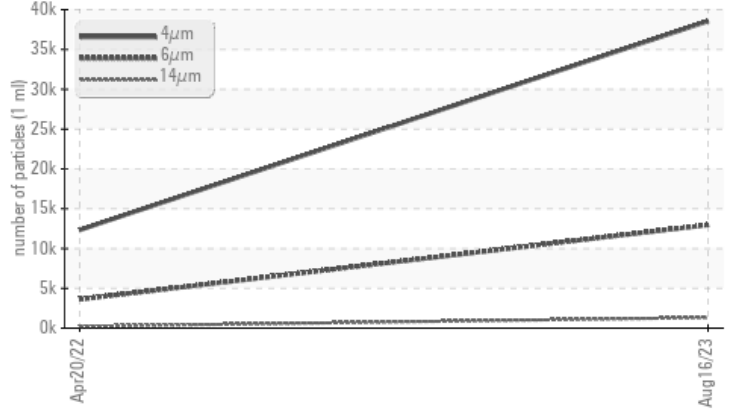

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	---
Particles >6µm	ASTM D7647	>1300	▲ 12962	▲ 3621	---
Particles >14µm	ASTM D7647	>80	▲ 1322	▲ 226	---
Particles >21µm	ASTM D7647	>20	▲ 413	▲ 35	---
Particles >38µm	ASTM D7647	>4	▲ 32	1	---
Particles >71µm	ASTM D7647	>3	▲ 5	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/21/18	▲ 19/15	---
Visc @ 40°C	cSt	ASTM D445	45	▲ 53.13	44.3

Customer Id: BRISTOCA
Sample No.: KCPA004335
Lab Number: 05930362
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

20 Apr 2022 Diag: Don Baldrige

ISO




No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

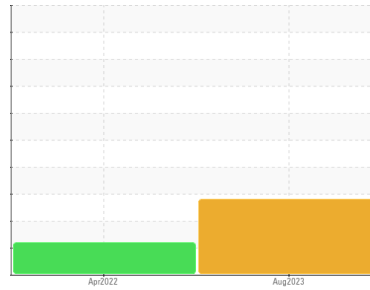

VISCOSITY



Machine Id
KAESER 7417309 (S/N 1002)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

▲ Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA004335	KCP44786	---
Sample Date	Client Info		16 Aug 2023	20 Apr 2022	---
Machine Age	hrs	Client Info	15854	8725	---
Oil Age	hrs	Client Info	0	8725	---
Oil Changed	Client Info		Changed	Changed	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >3	0	0	---
Titanium	ppm	ASTM D5185m >3	0	0	---
Silver	ppm	ASTM D5185m >2	0	0	---
Aluminum	ppm	ASTM D5185m >10	0	0	---
Lead	ppm	ASTM D5185m >10	<1	0	---
Copper	ppm	ASTM D5185m >50	13	10	---
Tin	ppm	ASTM D5185m >10	0	<1	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	---
Barium	ppm	ASTM D5185m 90	0	0	---
Molybdenum	ppm	ASTM D5185m 0	0	0	---
Manganese	ppm	ASTM D5185m	0	0	---
Magnesium	ppm	ASTM D5185m 100	0	0	---
Calcium	ppm	ASTM D5185m 0	0	0	---
Phosphorus	ppm	ASTM D5185m 0	0	0	---
Zinc	ppm	ASTM D5185m 0	0	0	---
Sulfur	ppm	ASTM D5185m 23500	24108	14020	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	13	1	---
Sodium	ppm	ASTM D5185m	1	0	---
Potassium	ppm	ASTM D5185m >20	0	0	---
Water	%	ASTM D6304 >0.05	0.003	0.002	---
ppm Water	ppm	ASTM D6304 >500	33.8	15.6	---

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		38562	12326	---
Particles >6µm	ASTM D7647	>1300	▲ 12962	▲ 3621	---
Particles >14µm	ASTM D7647	>80	▲ 1322	▲ 226	---
Particles >21µm	ASTM D7647	>20	▲ 413	▲ 35	---
Particles >38µm	ASTM D7647	>4	▲ 32	1	---
Particles >71µm	ASTM D7647	>3	▲ 5	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/21/18	▲ 19/15	---

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.58	0.43	---

OIL ANALYSIS REPORT


Particle Trend

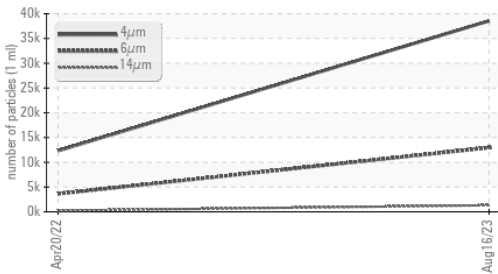


Water

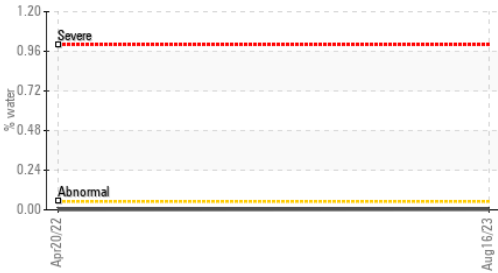


Particle Trend

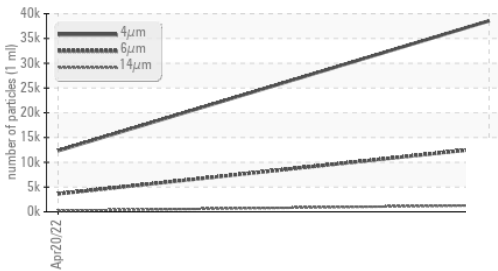

Acid Number

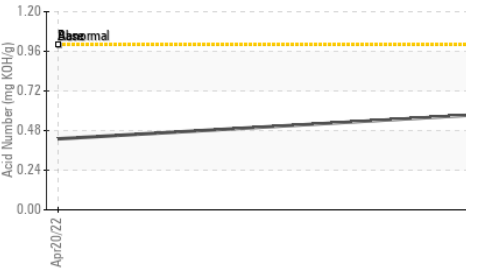

Water

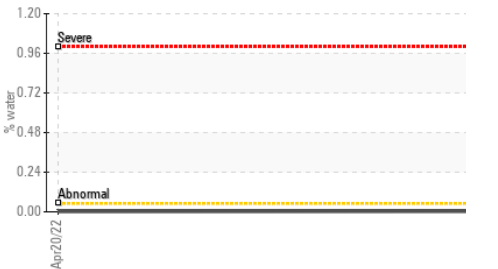


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	53.13	44.3


SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

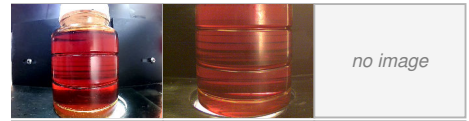

no image

Bottom




no image

GRAPHS


Ferrous Alloys




Non-ferrous Metals

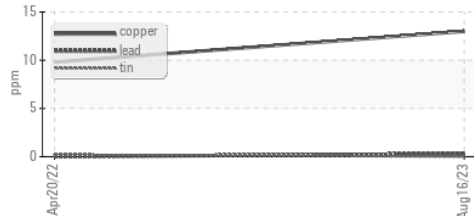


Viscosity @ 40°C

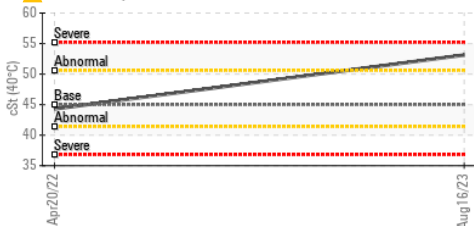

Particle Count

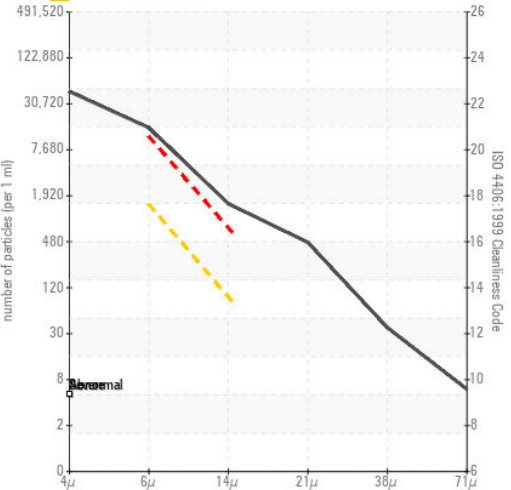

Acid Number

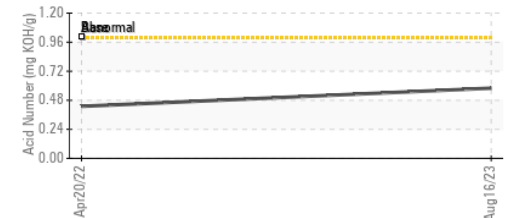

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA004335 **Received** : 21 Aug 2023
Lab Number : 05930362 **Diagnosed** : 24 Aug 2023
Unique Number : 10615633 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

BRIDGESTONE AMERICAS
 4336 POCK LN
 STOCKTON, CA
 US 95206
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: