




OIL ANALYSIS REPORT

Sample Rating Trend

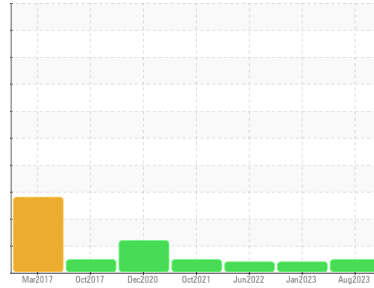

Machine Id
KAESER ASD 40T 5732162 (S/N 1206)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA002957	KCP54925	KCP40446
Sample Date	Client Info	15 Aug 2023	16 Jan 2023	01 Jun 2022
Machine Age	hrs	56625	52553	47842
Oil Age	hrs	7997	1478	4700
Oil Changed	Client Info	Changed	Not Changd	Not Changd
Sample Status		NORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	0	<1
Chromium	ppm	ASTM D5185m >5	0	0	0
Nickel	ppm	ASTM D5185m	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >15	0	0	2
Lead	ppm	ASTM D5185m >65	0	0	<1
Copper	ppm	ASTM D5185m >65	22	21	9
Tin	ppm	ASTM D5185m >10	0	0	<1
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	0
Magnesium	ppm	ASTM D5185m 90	0	6	22
Calcium	ppm	ASTM D5185m 2	0	0	0
Phosphorus	ppm	ASTM D5185m	0	0	7
Zinc	ppm	ASTM D5185m	7	40	77
Sulfur	ppm	ASTM D5185m	21297	21631	17538

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >35	1	0	<1
Sodium	ppm	ASTM D5185m	2	1	7
Potassium	ppm	ASTM D5185m >20	0	0	4
Water	%	ASTM D6304 >0.1	0.007	0.009	0.022
ppm Water	ppm	ASTM D6304 >1000	75.1	96.4	224.4






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	3707	---	---
Particles >6µm	ASTM D7647 >2500	1669	---	---
Particles >14µm	ASTM D7647 >320	281	---	---
Particles >21µm	ASTM D7647 >80	89	---	---
Particles >38µm	ASTM D7647 >20	2	---	---
Particles >71µm	ASTM D7647 >4	0	---	---
Oil Cleanliness	ISO 4406 (c) >20/18/15	19/18/15	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.41	0.36	0.40


OIL ANALYSIS REPORT

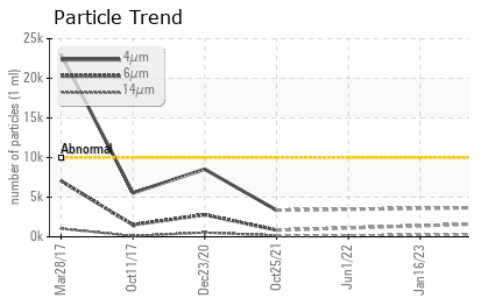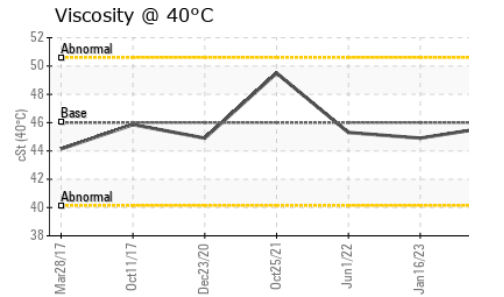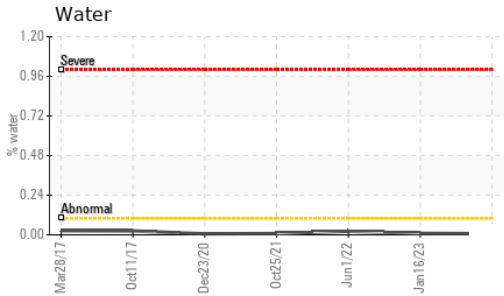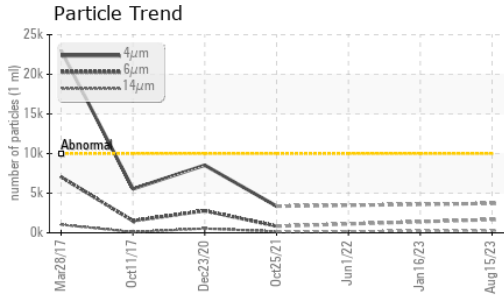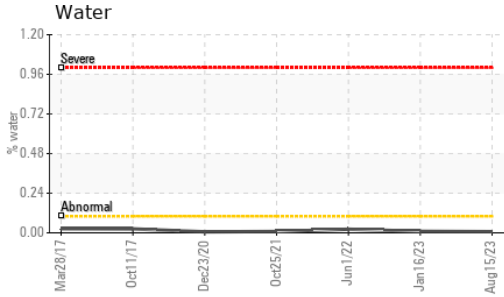






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.7	44.9	45.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

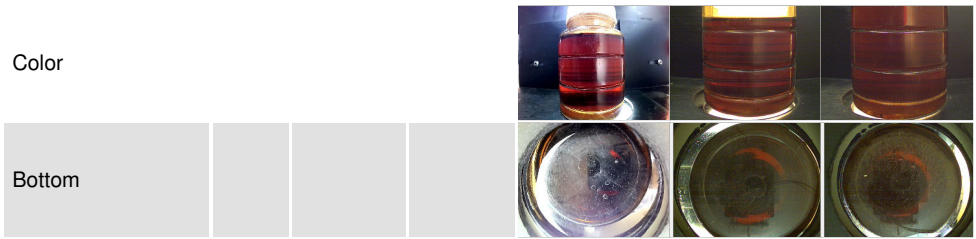

GRAPHS

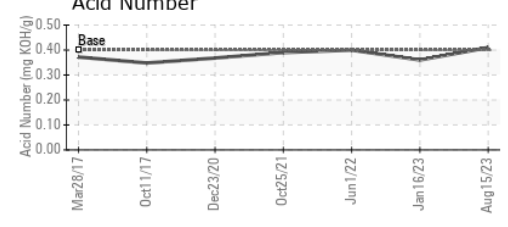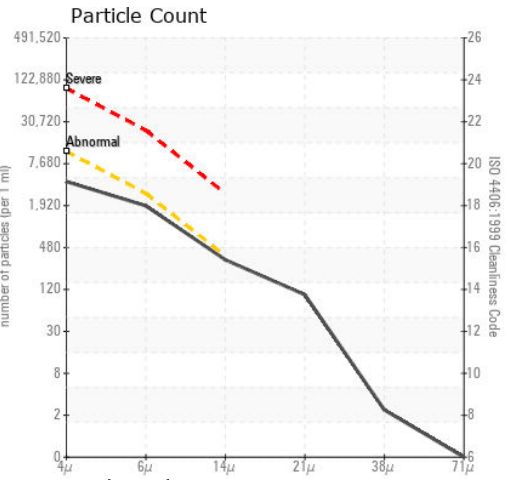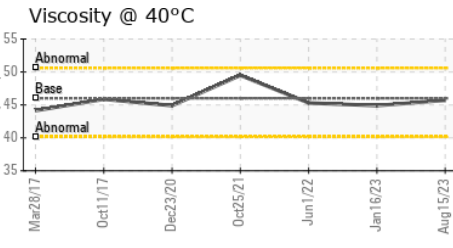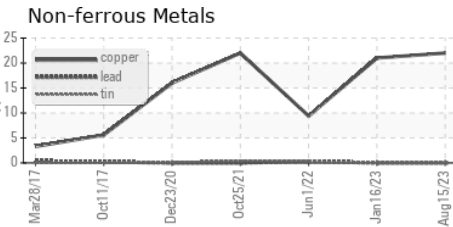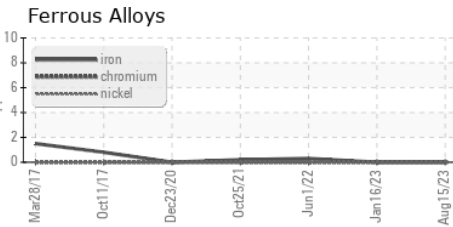

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA002957 **Received** : 21 Aug 2023
Lab Number : 05930370 **Diagnosed** : 23 Aug 2023
Unique Number : 10615641 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

84 LUMBER
 71 RIVERSIDE DR SW
 CARTERSVILLE, GA
 US 30120
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: