


Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

#### COMPONENT CONDITION SUMMARY

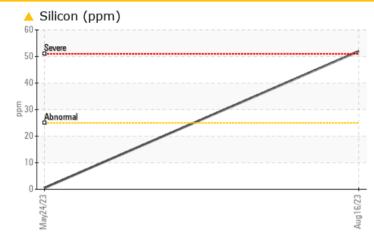

#### RECOMMENDATION

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS								
Sample Status				ABNORMAL	ABNORMAL			
Silicon	ppm	ASTM D5185m	>25	<u> </u>	<1			


Customer Id: 40VDAY Sample No.: KC05930377 Lab Number: 05930377 Test Package: IND 2



To manage this report scan the QR code

*To discuss the diagnosis or test data:* Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

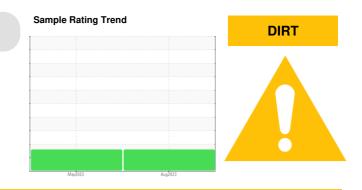

RECOMMENDED ACTIONS						
Action	Status	Date	Done By	Description		
Change Fluid			?	Oil and filter change at the time of sampling has been noted.		
Change Filter			?	Oil and filter change at the time of sampling has been noted.		

#### HISTORICAL DIAGNOSIS



#### 24 May 2023 Diag: Don Baldridge

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





### **OIL ANALYSIS REPORT**

Sample Rating Trend

DIRT

# Area [641] Hachine Id KAESER SX 6 6971034 (S/N 2404)

Component Compressor

Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

#### DIAGNOSIS

#### Recommendation

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

#### Wear

All component wear rates are normal.

#### Contamination

Elemental level of silicon (Si) above normal indicating ingress of seal material. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			May2023	Aug2023		
SAMPLE INFORM		method	limit/base	current	history1	history2
Sample Number		Client Info		KC05930377	KC110928	
Sample Date		Client Info		16 Aug 2023	24 May 2023	
Machine Age	hrs	Client Info		18564	17481	
Oil Age	hrs	Client Info		5645	5545	
Oil Changed		Client Info		Changed	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm		>50	13	6	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Volybdenum	ppm	ASTM D5185m		0	0	
Vanganese	ppm	ASTM D5185m		0	0	
Vagnesium	ppm	ASTM D5185m	90	0	16	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		0	1	
Zinc	ppm	ASTM D5185m		0	2	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>5</b> 2	<1	
Sodium	ppm	ASTM D5185m		2	6	
Potassium	ppm	ASTM D5185m	>20	<1	2	
Water	%	ASTM D6304	>0.05	0.019	0.007	
opm Water	ppm	ASTM D6304	>500	196.7	70.9	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1171	20755	
Particles >6µm		ASTM D7647	>1300	406	🔺 11697	
Particles >14µm		ASTM D7647	>80	44	<b>1</b> 371	
Particles >21µm		ASTM D7647	>20	12	<b>1</b> 23	
Particles >38µm		ASTM D7647	>4	1	2	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/16/13	<b>2</b> 2/21/18	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.42	0.24	



## **OIL ANALYSIS REPORT**

limit/base

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

limit/base

limit/base

491,52

122,880

30.720 7,680

1,920 per

480

120

31

(<sup>0.50</sup>) (<sup>10</sup>) (<sup>10</sup>) (<sup>10</sup>)

Ē 0.30

· 문 0.20

Acid

0.10

0.00

Ba

Aug16/23

Aug16/23

Aug16/23 -

>0.05

46

current

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

curren

current

Particle Count

Acid Number

NEG

NEG

43.9

history1

NONE

NONE

NONE

NONE

LIGHT

NONE

NORML

NORML

history

history1

NFG

NEG

46.1

history2

history

history2


no image

no image

4406

:1999 Cle

14

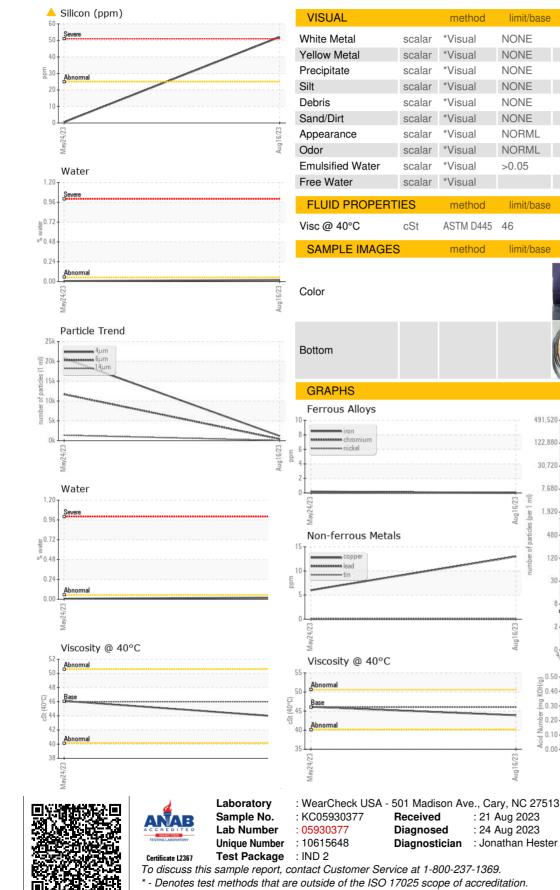

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

7801 TECHNOLOGY BLVD

214

28

Page 4 of 4

**4 OVER INC** 

DAYTON, OH

US 45424

Contact: