


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

Machine Id KAESER SFC 22 5698072 (S/N 1015)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Mar2017 Feb2	018 May2018 Jul2019 Aug2	019 Nov2020 May2021 Dec2021 Aug	022 Aug2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC121433	KC95208	KC96397
Sample Date		Client Info		14 Aug 2023	23 Aug 2022	29 Dec 2021
Machine Age	hrs	Client Info		39783	36431	32203
Oil Age	hrs	Client Info		31078	4228	8679
Oil Changed		Client Info		Changed	Not Changd	Changed
Sample Status				NORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	<1	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	<1
Aluminum	ppm	ASTM D5185m	>10	0	2	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	10	10	10
Tin	ppm	ASTM D5185m	>10	0	1	0
Antimony	ppm	ASTM D5185m				2
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	0	6	0
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		0	<1	7
Zinc	ppm	ASTM D5185m		32	40	13
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	8	2	17
Sodium	ppm	ASTM D5185m		2	<1	0
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.05	0.007	0.007	0.001
ppm Water	ppm	ASTM D6304	>500	71.9	77.8	10.3
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		284	56147	2103
Particles >6µm		ASTM D7647	>1300	87	<u>▲</u> 13655	712
Particles >14µm		ASTM D7647	>80	13	△ 649	68
Particles >21µm		ASTM D7647	>20	4	▲ 135	16
Particles >38µm		ASTM D7647	>4	0	2	2
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>17/13	14/11	<u>\$\lambda\$</u> 21/17	17/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A =!=! N!! (ANI)	I/OII/-	ACTM DODAE	0.4	0.44	0.00	0.007

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.44

0.39

0.387



OIL ANALYSIS REPORT

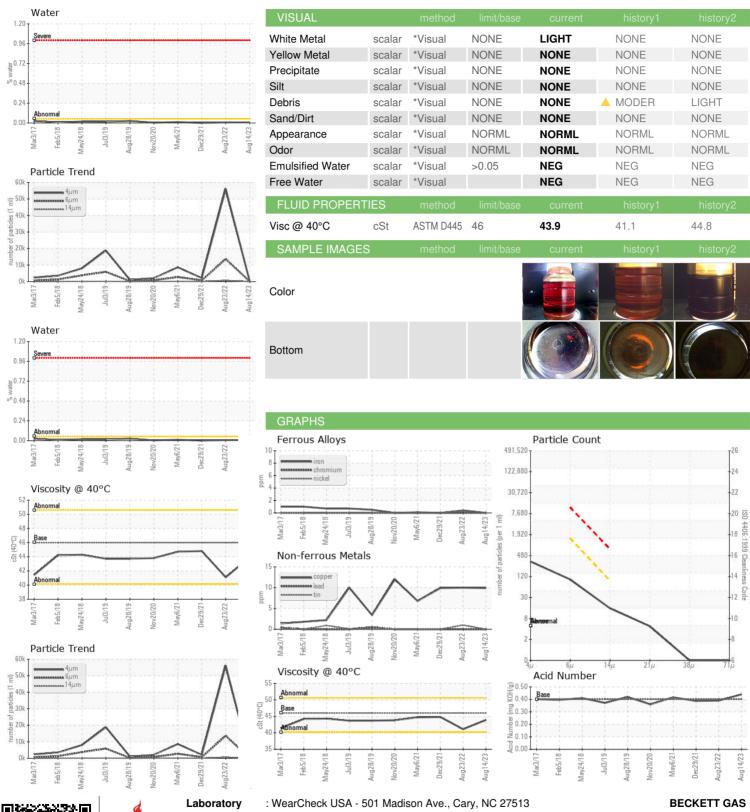





Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC121433

: 05930400 : 10615671 : IND 2

: 21 Aug 2023 Received : 23 Aug 2023 Diagnosed Diagnostician

: Angela Borella

21819 ROYALTON RD STRONGSVILLE, OH US 44149

Contact:

T: F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)