




KAESER 7.5C 6837673 (S/N 1994)

Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

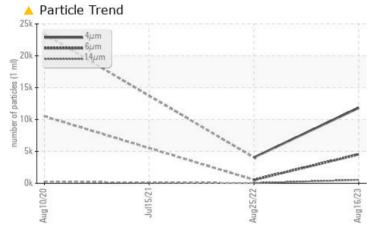

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

an Disease of the second and the second and the	
Aug 16/23	
PROBLEMATIC TEST RESULTS	

PROBLEMATIC TEST RESULTS								
Sample Status		ABNORMAL NORM	MAL ABNORMAL					
Particles >6µm	ASTM D7647 >130	0 4532 533	7					
Particles >14µm	ASTM D7647 >80	▲ 534 26						
Particles >21µm	ASTM D7647 >20	▲ 164 5						
Oil Cleanliness	ISO 4406 (c) >17/	13 🔺 19/16 16/						


Customer Id: JPADUL Sample No.: KC124308 Lab Number: 05930404 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Angela Borella +1 800-237-1369 angela.borella@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

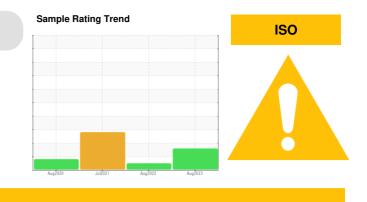

RECOMMENDED ACTIONS						
Action	Status	Date	Done By	Description		
Change Fluid			?	Oil and filter change at the time of sampling has been noted.		
Change Filter			?	Oil and filter change at the time of sampling has been noted.		

HISTORICAL DIAGNOSIS



25 Aug 2022 Diag: Don Baldridge

Resample at the next service interval to monitor.All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

15 Jul 2021 Diag: Doug Bogart



The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

10 Aug 2020 Diag: Angela Borella



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view report







OIL ANALYSIS REPORT

KAESER 7.5C 6837673 (S/N 1994)

Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

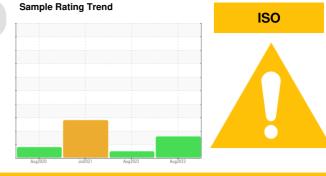

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC124308	KC103000	KC98001
Sample Date		Client Info		16 Aug 2023	25 Aug 2022	15 Jul 2021
Machine Age	hrs	Client Info		6245	4574	2928
Oil Age	hrs	Client Info		6245	3185	1539
Oil Changed		Client Info		Changed	Changed	Not Changd
Sample Status				ABNORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	2
Copper	ppm	ASTM D5185m		4	5	4
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m	-			0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
	ppiii		11 11 11	-	-	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m	90	1	0	<1
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	90	49	24	35
Calcium	ppm	ASTM D5185m	2	0	0	<1
Phosphorus	ppm	ASTM D5185m		4	6	4
Zinc	ppm	ASTM D5185m		4	4	0
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	1
Sodium	ppm	ASTM D5185m		18	11	9
Potassium	ppm	ASTM D5185m	>20	2	0	1
Water	%	ASTM D6304	>0.05	0.026	0.015	0.220
ppm Water	ppm	ASTM D6304	>500	260.6	153.6	▲ 2200
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		11821	4049	
Particles >6µm		ASTM D7647	>1300	<u> </u>	537	
Particles >14µm		ASTM D7647	>80	5 34	26	
Particles >21µm		ASTM D7647	>20	<u> </u>	5	
Particles >38µm		ASTM D7647	>4	5	0	
Particles >71µm		ASTM D7647		0	0	
Oil Cleanliness		ISO 4406 (c)	>17/13	1 9/16	16/12	
FLUID DEGRAD	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.32	0.28	0.319
. ,						

Report Id: JPADUL [WUSCAR] 05930404 (Generated: 08/23/2023 17:26:41) Rev: 1

Contact/Location: DAN ? - JPADUL Page 3 of 4



Built for a lifetime

OIL ANALYSIS REPORT

scalar

scalar

scalar

scalar

method

*Visual

*Visual

*Visual

*Visual

scalar *Visual

limit/base


NONE

NONE

NONE

NONE

NONE

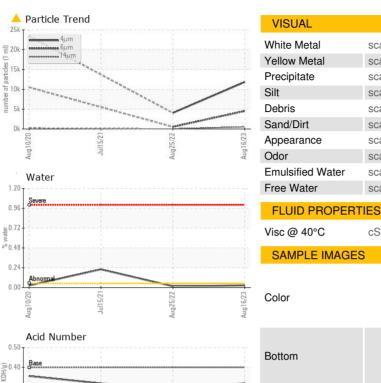



current

NONE

NONE

NONE

NONE

NONE

history1

NONE

NONE

NONE

NONE

NONE

history2

NONE

NONE

NONE

NONE

🔺 MODER

