

## **OIL ANALYSIS REPORT**

Sample Rating Trend



KAESER 1.9623.80010

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


				Aug2023		
SAMPLE INFORM	<b>IATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA006758		
Sample Date		Client Info		14 Aug 2023		
Machine Age	hrs	Client Info		7541		
Oil Age	hrs	Client Info		743		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm		>50	<1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES	lele	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m	Ū	0		
Magnesium	ppm	ASTM D5185m	100	3		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	568		
Zinc	ppm	ASTM D5185m	0	14		
Sulfur	ppm	ASTM D5185m	23500	14		
CONTAMINANTS					biotory1	
		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	13		
Sodium	ppm	ASTM D5185m	00	2		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304		0.010		
ppm Water	ppm	ASTM D6304	>500	104.8		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2327		
Particles >6µm		ASTM D7647	>1300	332		
Particles >14 $\mu$ m		ASTM D7647	>80	10		
Particles >21µm		ASTM D7647	>20	3		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/10		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.24		
	J .J					




# **OIL ANALYSIS REPORT**





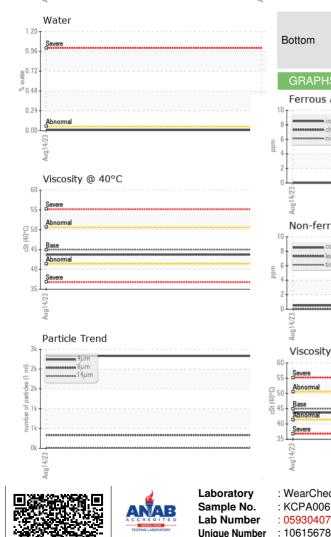

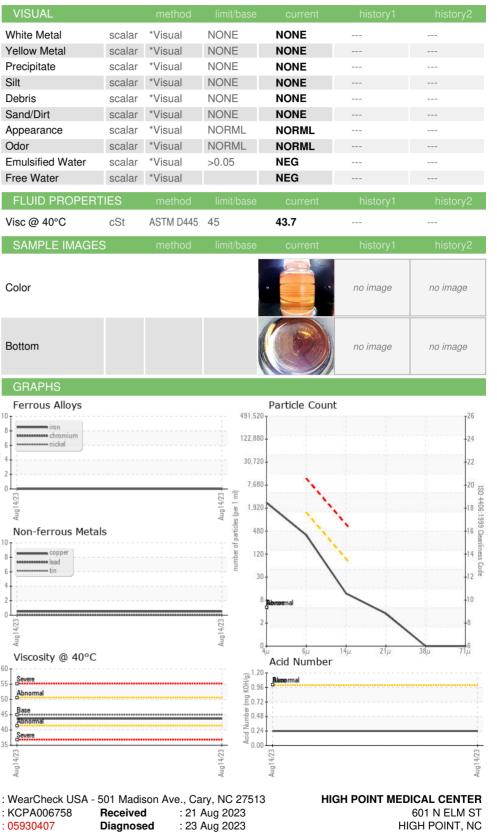

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Test Package : IND 2 (Additional Tests: KF, PrtCount)

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnostician : Jonathan Hester

Certificate L2367

US 27262

Contact: Service Manager