


PROBLEM SUMMARY

KAESER AS 30T 5885109 (S/N 1325)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

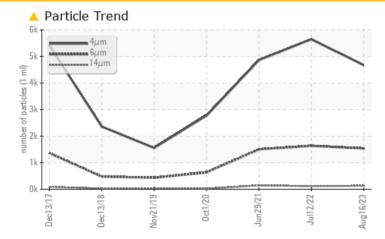

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status			ATTENTION	ATTENTION	ATTENTION		
Particles >6µm	ASTM D7647	>1300	<u> </u>	1 635	1 504		
Particles >14µm	ASTM D7647	>80	A 132	🔺 117	🔺 145		
Particles >21µm	ASTM D7647	>20	<u> </u>	<u> </u>	<u> </u>		
Oil Cleanliness	ISO 4406 (c)	>/17/13	 19/18/14	🔺 20/18/14	<u> </u>		


Customer Id: POLSUW Sample No.: KCPA006733 Lab Number: 05930408 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

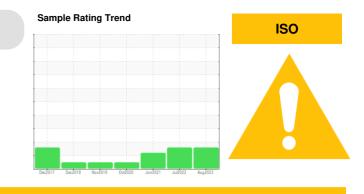

RECOMMENDED ACTIONS						
Action	Status	Date	Done By	Description		
Change Fluid			?	Oil and filter change at the time of sampling has been noted.		
Change Filter			?	Oil and filter change at the time of sampling has been noted.		

HISTORICAL DIAGNOSIS



12 Jul 2022 Diag: Don Baldridge

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view report

29 Jun 2021 Diag: Angela Borella



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

01 Oct 2020 Diag: Angela Borella





Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Machine Id KAESER AS 30T 5885109 (S/N 1325) Component

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

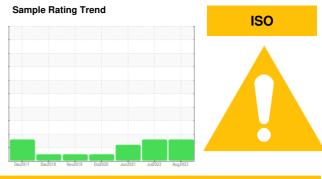

SAMPLE INFORM	/IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA006733	KCP49681	KCP33243
Sample Date		Client Info		16 Aug 2023	12 Jul 2022	29 Jun 2021
Machine Age	hrs	Client Info		14487	12557	10504
Oil Age	hrs	Client Info		3245	2000	1587
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				ATTENTION	ATTENTION	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	3	3	3
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m	210			<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium		ASTM D5185m		0	0	0
	ppm			-	-	-
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	4
Barium	ppm	ASTM D5185m	90	3	10	17
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	100	77	60	67
Calcium	ppm	ASTM D5185m	0	0	0	<1
Phosphorus	ppm	ASTM D5185m	0	3	1	3
Zinc	ppm	ASTM D5185m	0	6	5	0
Sulfur	ppm	ASTM D5185m	23500	24126	22830	17529
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	0
Sodium	ppm	ASTM D5185m		23	20	16
Potassium	ppm	ASTM D5185m	>20	3	0	3
Water	%	ASTM D6304	>0.05	0.030	0.042	0.032
ppm Water	ppm	ASTM D6304	>500	307.3	428.8	325.9
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4674	5652	4862
Particles >6µm		ASTM D7647	>1300	<u> </u>	1 635	1 504
Particles >14µm		ASTM D7647	>80	A 132	1 17	1 45
Particles >21µm		ASTM D7647	>20	<u> </u>	<u> </u>	<u> </u>
Particles >38μm		ASTM D7647	>4	1	0	4
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	▲ 19/18/14	▲ 20/18/14	▲ 18/14
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37	0.35	0.344
10.20) Rov: 1	ing itori/g	A0 HW D0040	1.0	Contact/Locatio		

Report Id: POLSUW [WUSCAR] 05930408 (Generated: 08/23/2023 15:19:29) Rev: 1


Contact/Location: Service Manager - POLSUW





A Particle Trend

6

end VISUAL White Metal





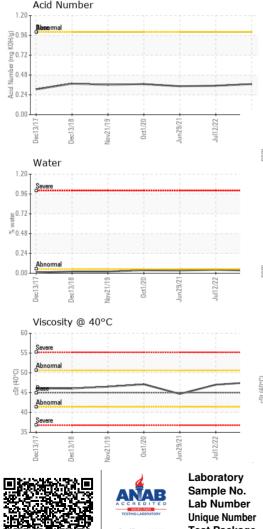

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT		method	limit/base	current	history1	history2
	IL0	methou	IIIIII/Dase	Current	TIIStOLAT	Thistory2
Visc @ 40°C	cSt	ASTM D445	45	47.6	47.0	44.7


SAMPLE IMAGES method

OIL ANALYSIS REPORT

 limit/base
 current
 history1
 history2

Bottom

Color

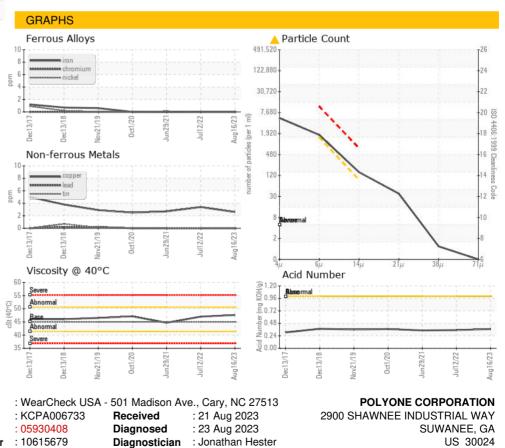

Certificate L2367 **Test Package** : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

Contact/Location: Service Manager - POLSUW

Contact: Service Manager