

OIL ANALYSIS REPORT

Iron

Tin

Sample Rating Trend

NORMAL

INGERSOLL RAND R110I-A125 2 I/R 150 H/P (S/N V1031U10149) Component

Air Compressor

USPI FG AIR 46 (15 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





SAMPLE INFORMATION method USPM29314 USPM28682 USPM26118 Sample Number **Client Info** 20 Aug 2023 27 Apr 2023 05 Jan 2023 Sample Date Client Info 0 0 0 Machine Age hrs **Client Info** Oil Age hrs Client Info 0 0 0 Oil Changed **Client Info** N/A N/A N/A NORMAL NORMAL Sample Status NORMAL WEAR METALS ASTM D5185m >70 0 0 0 ppm Chromium ASTM D5185m >15 0 0 0 ppm Nickel ppm ASTM D5185m >6 0 0 0 Titanium ASTM D5185m 0 0 0 ppm 0 0 Silver ppm ASTM D5185m 0 Aluminum ASTM D5185m >10 0 0 0 ppm >20 Lead ASTM D5185m 0 0 0 ppm ASTM D5185m 0 0 Copper >80 0 ppm ppm ASTM D5185m >15 0 0 0 Vanadium ASTM D5185m 0 0 0 ppm Cadmium ppm ASTM D5185m 0 0 0 ASTM D5185m O 0 0 0 Boron ppm Barium ppm ASTM D5185m 0 0 0 0 0 0 0 Molybdenum ASTM D5185m 0 ppm 0 0 Manganese ppm ASTM D5185m <1 ASTM D5185m 0 0 0 0 Magnesium ppm 0 0 Calcium ppm ASTM D5185m 0 <1 0 Phosphorus ppm ASTM D5185m 0 <1 0 Zinc ASTM D5185m 0 0 0 0 ppm 0 Sulfur ASTM D5185m 0 0 4 ppm CONTAMINANTS Silicon ppm ASTM D5185m >12 <1 0 2 0 0 Sodium ppm ASTM D5185m 1 Potassium ASTM D5185m >20 0 0 <1 ppm


Water	%	ASTM D6304	>0.1	0.003	0.003	0.004
ppm Water	ppm	ASTM D6304	>1000	39.0	27.1	42.4
FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	655	1258	2372
Particles >6µm		ASTM D7647	>2500	142	315	571
Particles >14µm		ASTM D7647	>320	15	14	42
Particles >21µm		ASTM D7647	>80	5	2	13
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	17/14/11	17/15/11	18/16/13
FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.15	0.40	0.26	0.48


Report Id: TYSWILFOO [WUSCAR] 05930459 (Generated: 08/22/2023 19:44:52) Rev: 1


Contact/Location: ? ? - TYSWILFOO





OIL ANALYSIS REPORT














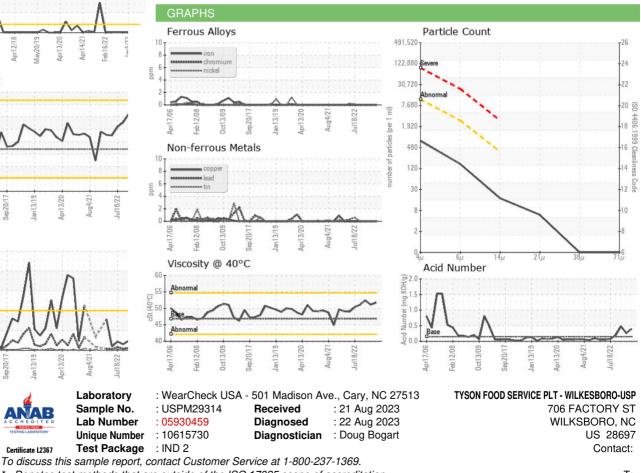

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Contact/Location: ? ? - TYSWILFOO