




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

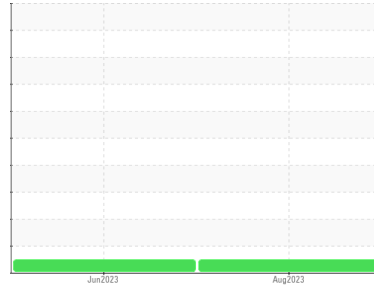

Machine Id  
**D-236**  
 Component  
**Diesel Engine**  
 Fluid  
**PHILLIPS 66 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0780362</b>	WC0780369	---
Sample Date	Client Info			<b>16 Aug 2023</b>	01 Jun 2023	---
Machine Age	hrs	Client Info		<b>1730</b>	1441	---
Oil Age	hrs	Client Info		<b>289</b>	355	---
Oil Changed	Client Info			<b>Changed</b>	Changed	---
Sample Status				<b>NORMAL</b>	NORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<b>&lt;1.0</b>	<1.0	---
Glycol	WC Method			<b>NEG</b>	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	<b>10</b>	23	---
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>1</b>	0	---
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>20	<b>3</b>	4	---
Lead	ppm	ASTM D5185m	>40	<b>1</b>	8	---
Copper	ppm	ASTM D5185m	>330	<b>2</b>	5	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>57</b>	186	---
Barium	ppm	ASTM D5185m		<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>108</b>	244	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m		<b>104</b>	808	---
Calcium	ppm	ASTM D5185m		<b>2192</b>	1551	---
Phosphorus	ppm	ASTM D5185m		<b>1028</b>	847	---
Zinc	ppm	ASTM D5185m		<b>1245</b>	1049	---
Sulfur	ppm	ASTM D5185m		<b>4391</b>	3593	---



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>4</b>	6	---
Sodium	ppm	ASTM D5185m		<b>2</b>	3	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	2	---

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	<b>0.4</b>	0.5	---
Nitration	Abs/cm	*ASTM D7624	>20	<b>9.9</b>	9.8	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>19.2</b>	23.2	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>14.9</b>	18.6	---
Base Number (BN)	mg KOH/g	ASTM D2896		<b>7.1</b>	8.8	---







# OIL ANALYSIS REPORT

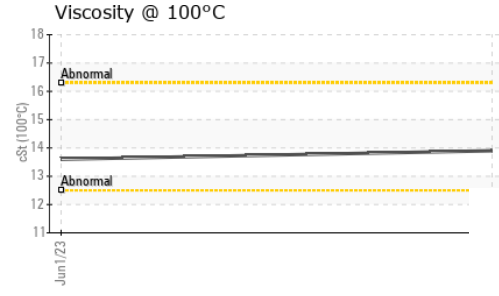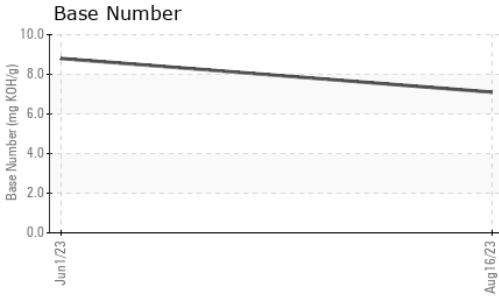

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	<b>13.9</b>	13.6	---

## GRAPHS

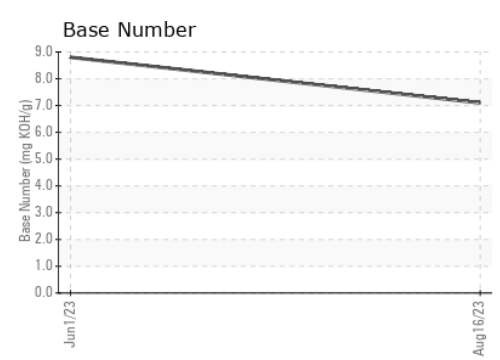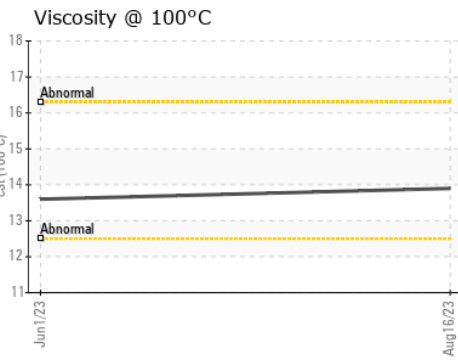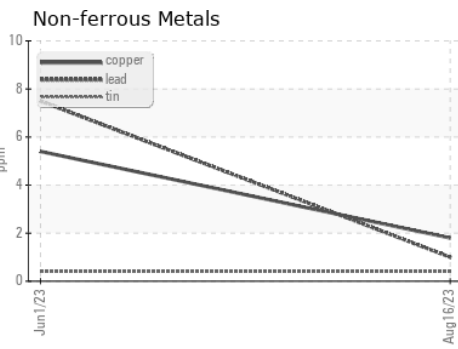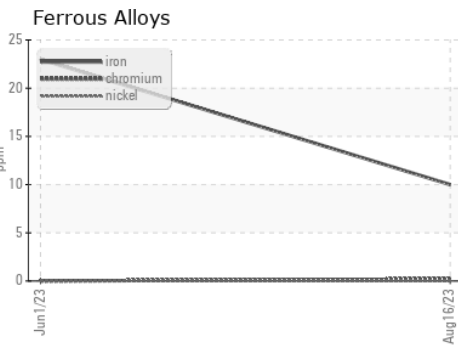

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0780362      **Received** : 22 Aug 2023  
**Lab Number** : **05930598**      **Diagnosed** : 22 Aug 2023  
**Unique Number** : 10615869      **Diagnostician** : Wes Davis  
**Test Package** : CONST ( Additional Tests: TBN )

**DUKE LAZZARA**  
 4201 FAYETTEVILLE RD  
 RALEIGH, NC  
 US 27603  
 Contact: NICK DIXON  
 NICK.DIXON@DUKELAZZAM.COM  
 T: (919)760-7797  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)