


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

Machine Id KAESER SM 10 4635768 (S/N 2493)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Aug2013 N	May2014 Feb 2015 Mar20	18 Jan 2019 Aug 2020 Jul 2021	Aug2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC05930882	KC94350	KC83376
Sample Date		Client Info		16 Aug 2023	28 Jul 2021	03 Aug 2020
Machine Age	hrs	Client Info		24992	24984	23099
Oil Age	hrs	Client Info		0	1900	6000
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				NORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	<1
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	<1	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	8	8
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	10
Barium	ppm	ASTM D5185m	90	20	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m	90	64	4	0
Calcium	ppm	ASTM D5185m	2	<1	0	4
Phosphorus	ppm	ASTM D5185m		2	7	2
Zinc	ppm	ASTM D5185m		1	0	0
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	1
Sodium	ppm	ASTM D5185m		5	0	0
Potassium	ppm	ASTM D5185m	>20	0	0	0
Water	%	ASTM D6304	>0.05	0.028	0.004	0.005
ppm Water	ppm	ASTM D6304	>500	286.6	43.6	56.7
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3780		
Particles >6µm		ASTM D7647	>1300	1115		
Particles >14µm		ASTM D7647	>80	55		
Particles >21µm		ASTM D7647	>20	18		
Particles >38µm		ASTM D7647	>4	2		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	I/OLI/-	ACTM DOOM	0.4	0.27	0.007	0.047

0.37

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.287

0.347



OIL ANALYSIS REPORT

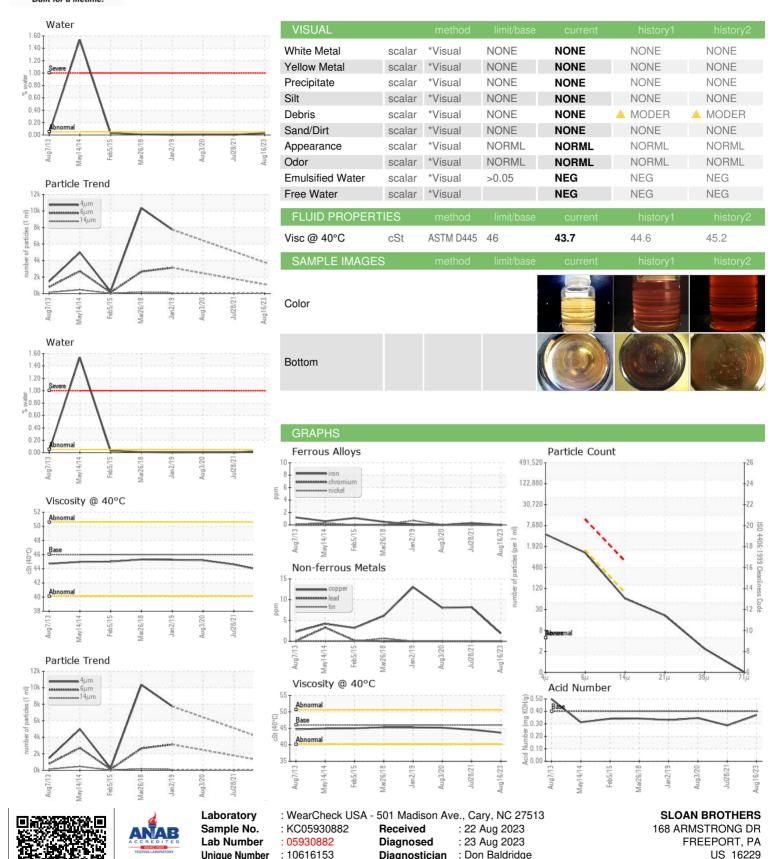

Certificate L2367

Unique Number

Test Package : IND 2

: 10616153

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Diagnostician

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact:

T: F: