


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id KAESER BSD 50T 3234274 (S/N 1224)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		Aug2017 Jan	2018 Jul2018 Jan2019	Jun2020 Mar2021 Sep2021 Jun202	.2 Aug2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA006763	KCP40402	KCP11817
Sample Date		Client Info		11 Aug 2023	01 Jun 2022	20 Sep 2021
Machine Age	hrs	Client Info		104417	97906	93483
Oil Age	hrs	Client Info		0	9030	5300
Oil Changed		Client Info		N/A	Changed	Not Changd
Sample Status				NORMAL	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	4	6	4
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	90	20	4	20
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		1	<1	3
Zinc	ppm	ASTM D5185m		17	20	24
Sulfur	ppm	ASTM D5185m		21018	15958	15445
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	0
Sodium	ppm	ASTM D5185m		8	3	8
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.05	0.012	0.007	0.017
ppm Water	ppm	ASTM D6304	>500	124.4	77.1	176.7
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2089	4395	
Particles >6µm		ASTM D7647	>1300	622	<u>1344</u>	
Particles >14µm		ASTM D7647	>80	42	<u> </u>	
Particles >21µm		ASTM D7647	>20	11	<u>4</u> 24	
Particles >38µm		ASTM D7647	>4	0	3	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/13	<u>19/18/14</u>	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
	140111	4.0T14.D0045				

0.39

0.335



OIL ANALYSIS REPORT

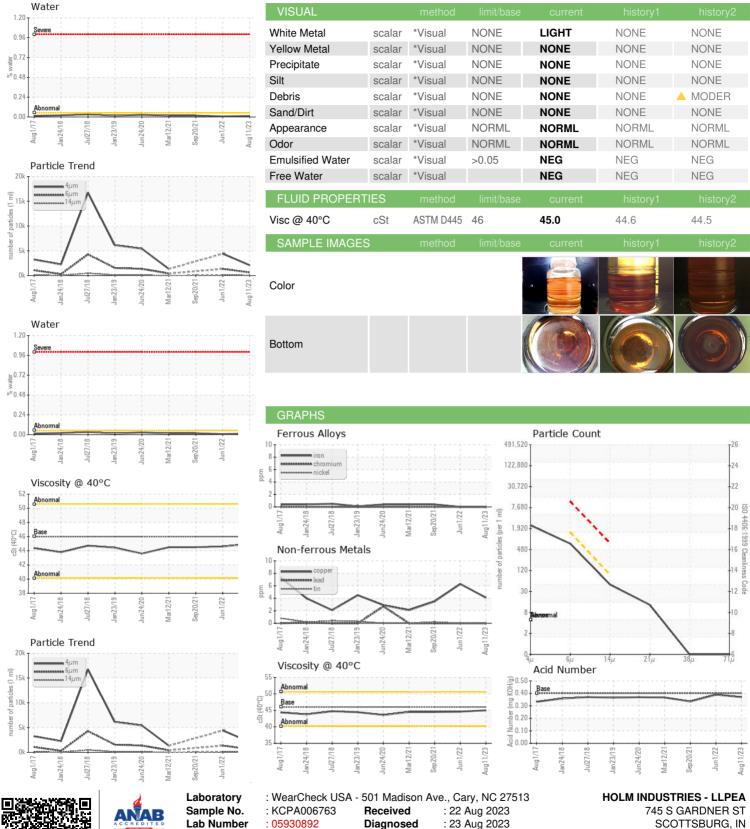





Certificate L2367

Lab Number **Unique Number**

: 05930892 : 10616163

Diagnosed

Test Package : IND 2 (Additional Tests: KF, PrtCount)

Diagnostician : Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: HOLSCO [WUSCAR] 05930892 (Generated: 08/23/2023 17:41:25) Rev: 1

Contact/Location: Service Manager - HOLSCO

US 47170

T: F:

Contact: Service Manager