



# PROBLEM SUMMARY

Sample Rating Trend



**WATER**




Machine Id  
**5K9032.1AZBD**

Component  
**Gearbox**

Fluid  
**MOBIL GLYGOYLE 220 (--- GAL)**

## COMPONENT CONDITION SUMMARY

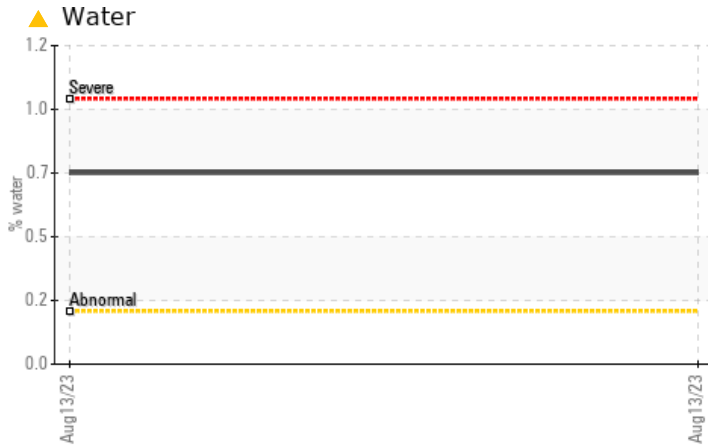

## RECOMMENDATION

We advise that you check for the source of water entry. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status				<b>ABNORMAL</b>	---	---
Water	%	ASTM D6304	>0.2	<b>▲ 0.721</b>	---	---
ppm Water	ppm	ASTM D6304	>2000	<b>▲ 7211.6</b>	---	---

**Customer Id:** WOOWOOMA  
**Sample No.:** RP05930903  
**Lab Number:** 05930903  
**Test Package:** IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Check Water Access	---	---	?	We advise that you check for the source of water entry.

## HISTORICAL DIAGNOSIS

# OIL ANALYSIS REPORT

Sample Rating Trend



**WATER**



Machine Id  
**5K9032.1AZBD**

Component

**Gearbox**

Fluid

**MOBIL GLYGOYLE 220 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

We advise that you check for the source of water entry. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a moderate concentration of water present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>RP05930903</b>	---	---
Sample Date	Client Info	<b>13 Aug 2023</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---
Oil Age	hrs	Client Info	<b>0</b>	---
Oil Changed	Client Info	<b>Changed</b>	---	---
Sample Status		<b>ABNORMAL</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	<b>2</b>	---
Chromium	ppm	ASTM D5185m >15	<b>0</b>	---
Nickel	ppm	ASTM D5185m >15	<b>0</b>	---
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	---
Silver	ppm	ASTM D5185m	<b>&lt;1</b>	---
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	---
Lead	ppm	ASTM D5185m >100	<b>0</b>	---
Copper	ppm	ASTM D5185m >200	<b>&lt;1</b>	---
Tin	ppm	ASTM D5185m >25	<b>&lt;1</b>	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>1</b>	---
Barium	ppm	ASTM D5185m	<b>0</b>	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	---
Magnesium	ppm	ASTM D5185m	<b>4</b>	---
Calcium	ppm	ASTM D5185m	<b>4</b>	---
Phosphorus	ppm	ASTM D5185m	<b>667</b>	---
Zinc	ppm	ASTM D5185m	<b>5</b>	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>13</b>	---
Sodium	ppm	ASTM D5185m	<b>2</b>	---
Potassium	ppm	ASTM D5185m >20	<b>6</b>	---
Water	%	ASTM D6304 >0.2	<b>▲ 0.721</b>	---
ppm Water	ppm	ASTM D6304 >2000	<b>▲ 7211.6</b>	---




## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.38</b>	---

## VISUAL

method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	---
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	---
Precipitate	scalar	*Visual NONE	<b>NONE</b>	---
Silt	scalar	*Visual NONE	<b>NONE</b>	---
Debris	scalar	*Visual NONE	<b>NONE</b>	---
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	---
Appearance	scalar	*Visual NORML	<b>NORML</b>	---
Odor	scalar	*Visual NORML	<b>NORML</b>	---
Emulsified Water	scalar	*Visual >0.2	<b>NEG</b>	---
Free Water	scalar	*Visual	<b>NEG</b>	---

# OIL ANALYSIS REPORT


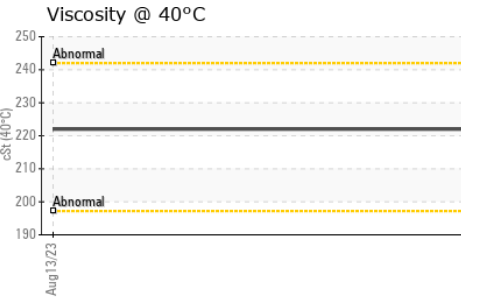
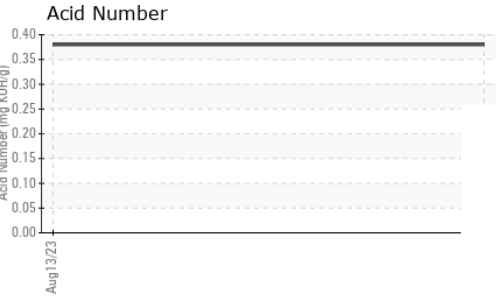
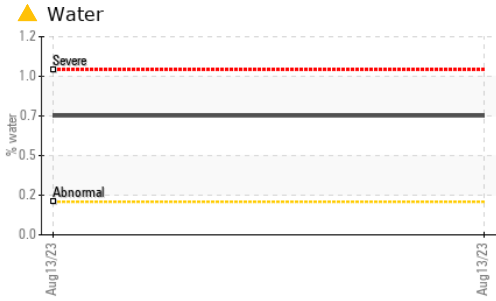


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	222	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

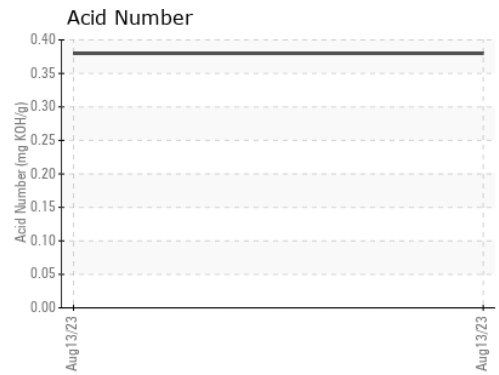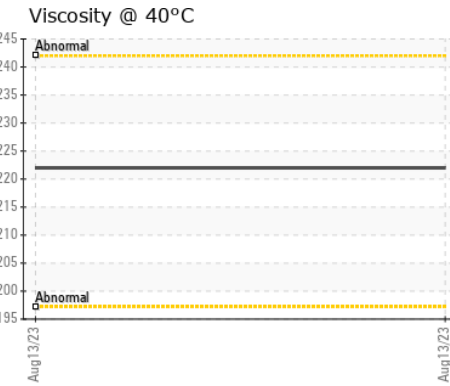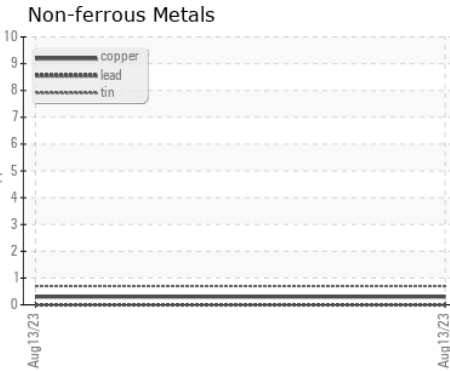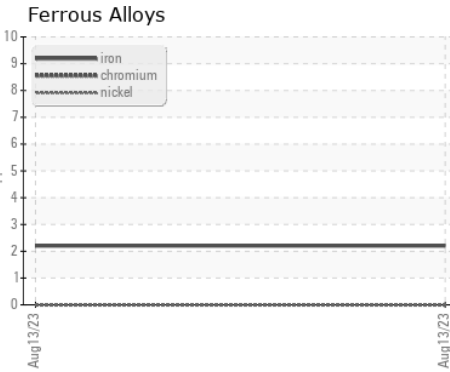

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP05930903 **Received** : 22 Aug 2023  
**Lab Number** : 05930903 **Diagnosed** : 23 Aug 2023  
**Unique Number** : 10616174 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**WOODS HOLE OCEANOGRAPHIC INSTITUTE**  
 266 WOODS HOLE RD  
 WOODS HOLE, MA  
 US 02543  
 Contact: FRED DENTON  
 fdenton@whoi.edu  
 T: (508)289-3852  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)