




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**PALASYN 45 [1389115]**  
 Machine Id  
**SULLAIR 1201310010 - EAGLE MAGNETIC**  
 Component  
**Compressor**

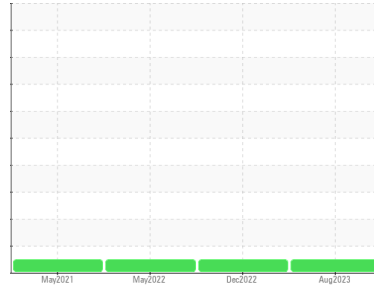

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCH05930915</b>	UCH05709850	UCH05550276
Sample Date	Client Info			<b>11 Aug 2023</b>	02 Dec 2022	06 May 2022
Machine Age	hrs	Client Info		<b>27007</b>	25478	24147
Oil Age	hrs	Client Info		<b>2386</b>	5179	3148
Oil Changed	Client Info			<b>Changed</b>	Changed	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.0	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m	0.0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	0.0	<b>2</b>	0	0
Calcium	ppm	ASTM D5185m	0.0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	966	<b>544</b>	390	443
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	1309	<b>1390</b>	233	170



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	2	1
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.172	<b>0.06</b>	0.23	0.19

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG




# OIL ANALYSIS REPORT



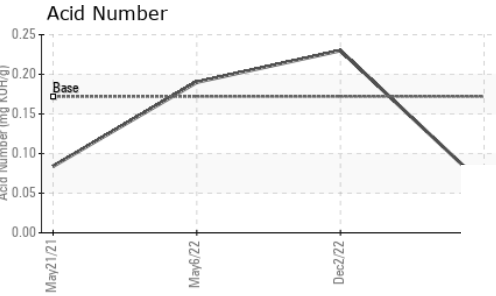
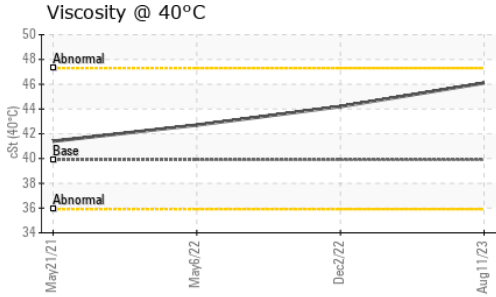


FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	39.9	<b>46.1</b>	44.2	42.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

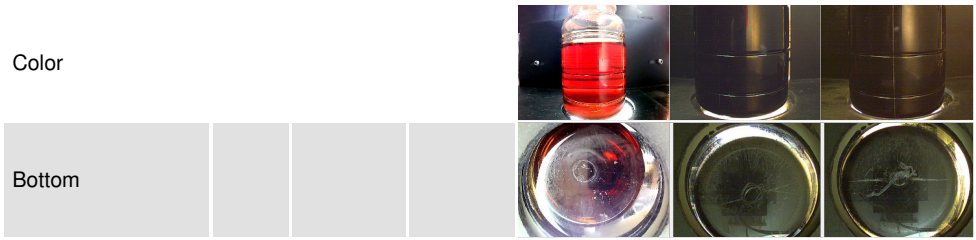

## GRAPHS

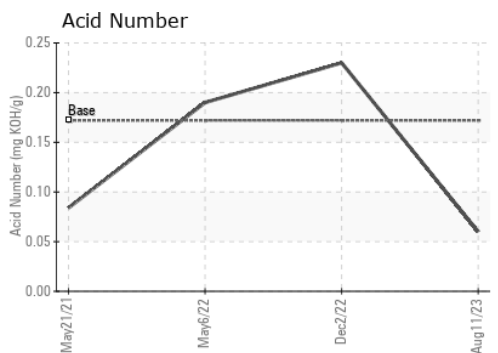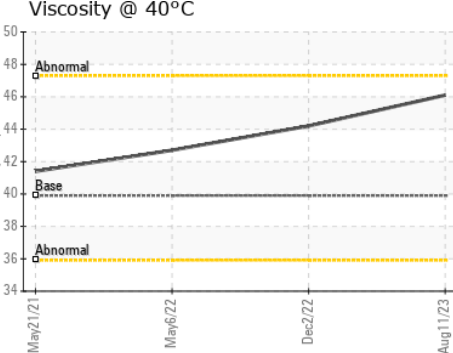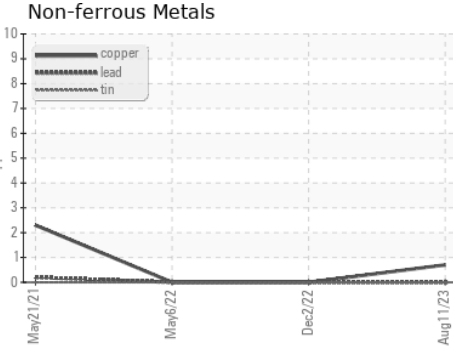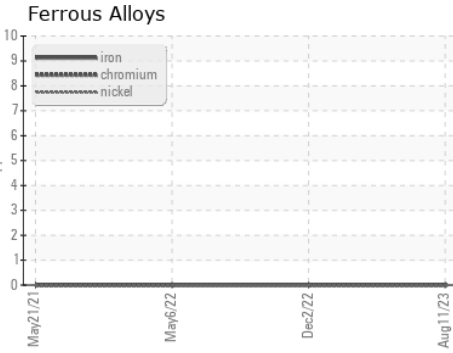

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05930915 **Received** : 22 Aug 2023  
**Lab Number** : **05930915** **Diagnosed** : 23 Aug 2023  
**Unique Number** : 10616186 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**AIR TECHNOLOGIES INC (IND)**  
 8405 E 30TH ST  
 INDIANAPOLIS, IN  
 US 46219  
 Contact: GLEN PARKER  
 glen.parker@aircompressors.com  
 T: (765)516-4920  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)