




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area
D230 [2951008]
 Machine Id
71AG214 (S/N 1000003190867)
 Component
Agitator Gearbox
 Fluid
MOBIL SHC CIBUS 220 (--- GAL)

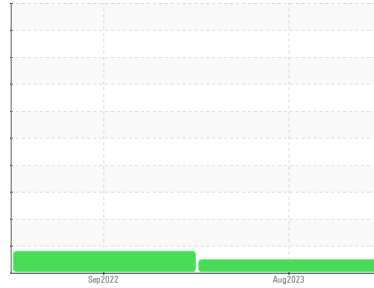

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0792592	WC0711950	---
Sample Date	Client Info		20 Aug 2023	01 Sep 2022	---
Machine Age	mths	Client Info	0	0	---
Oil Age	mths	Client Info	0	0	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			NORMAL	ATTENTION	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >150	<1	<1	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >10	0	0	---
Titanium	ppm	ASTM D5185m	0	0	---
Silver	ppm	ASTM D5185m	0	0	---
Aluminum	ppm	ASTM D5185m >25	0	<1	---
Lead	ppm	ASTM D5185m >100	0	0	---
Copper	ppm	ASTM D5185m >50	<1	0	---
Tin	ppm	ASTM D5185m >10	<1	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1	---
Barium	ppm	ASTM D5185m	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	<1	0	---
Magnesium	ppm	ASTM D5185m	<1	0	---
Calcium	ppm	ASTM D5185m	1	<1	---
Phosphorus	ppm	ASTM D5185m	531	549	---
Zinc	ppm	ASTM D5185m	0	<1	---
Sulfur	ppm	ASTM D5185m	636	526	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	1	<1	---
Sodium	ppm	ASTM D5185m	1	<1	---
Potassium	ppm	ASTM D5185m >20	<1	0	---
Water	%	ASTM D6304 >0.1	0.001	0.003	---
ppm Water	ppm	ASTM D6304 >1000	6.7	27.1	---

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	6261	▲ 22444	---
Particles >6µm	ASTM D7647	>5000	991	1373	---
Particles >14µm	ASTM D7647	>640	66	33	---
Particles >21µm	ASTM D7647	>160	15	4	---
Particles >38µm	ASTM D7647	>40	2	0	---
Particles >71µm	ASTM D7647	>10	1	0	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	20/17/13	▲ 22/18/12	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.35	0.35	---




OIL ANALYSIS REPORT

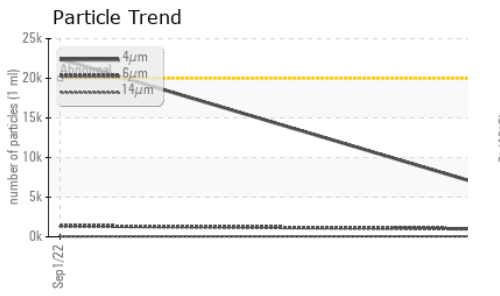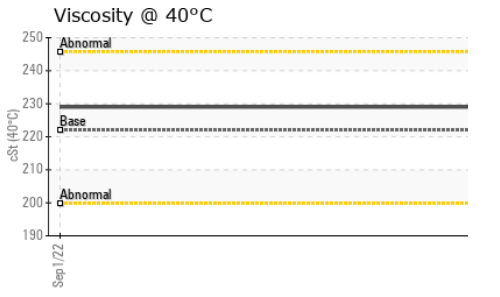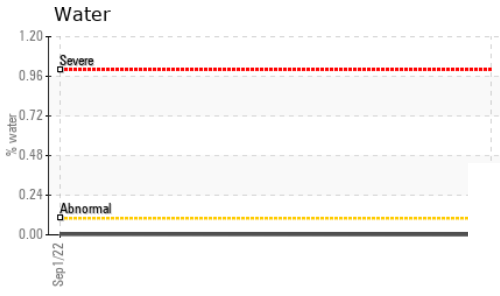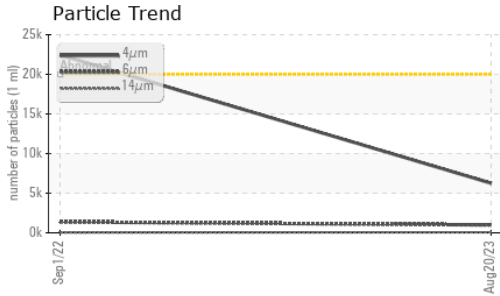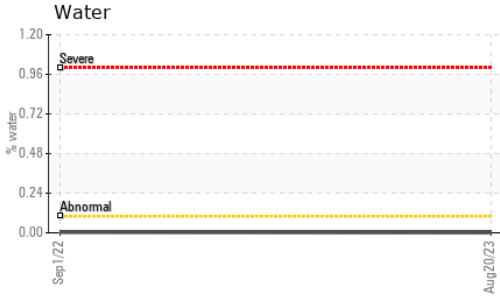





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 222	229	229	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

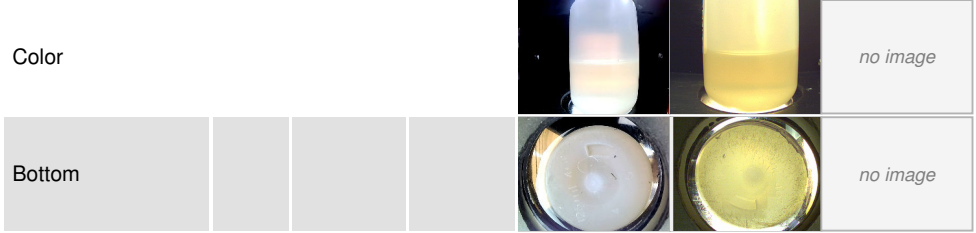

GRAPHS

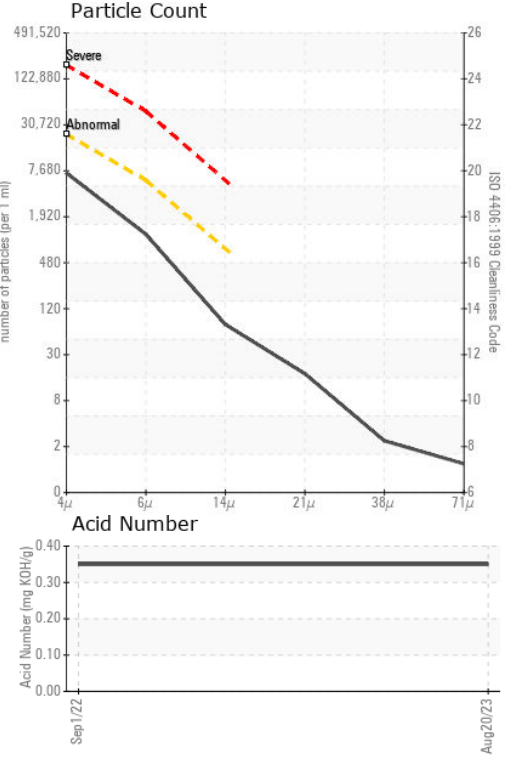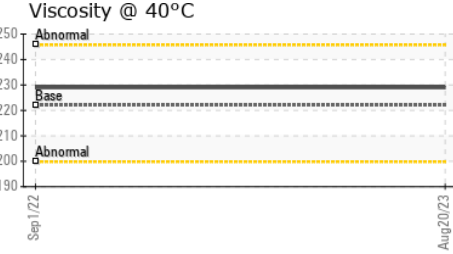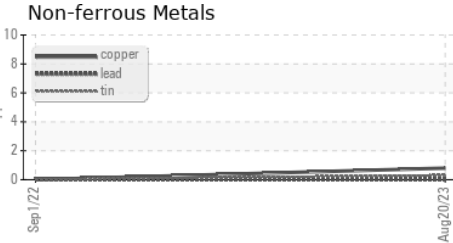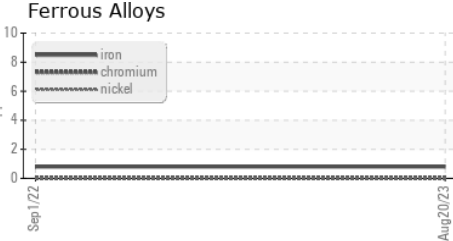

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0792592 **Received** : 22 Aug 2023
Lab Number : **05931540** **Diagnosed** : 24 Aug 2023
Unique Number : 10616811 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

GRIFOLS TALECRIS PHARMACEUTICAL
 8368 US 70 WEST
 CLAYTON, NC
 US 27520
 Contact: KEN TERRY
 kenneth.terry@grifols.com
 T: (919)359-4362
 F: (919)359-4767

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)