


PROBLEM SUMMARY

Machine Id 7027987 (S/N 1229) Component

Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

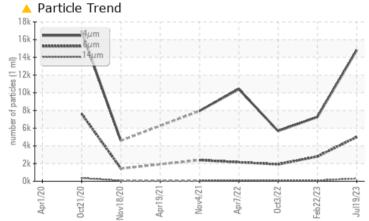

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS Sample Status ABNORMAL ABNORMAL **ATTENTION 1**909 Particles >6µm ASTM D7647 >1300 5001 ▲ 2805 Particles >14µm ASTM D7647 >80 310 **4** 91 **A** 87 Particles >21µm ASTM D7647 >20 58 10 19 **Oil Cleanliness** ISO 4406 (c) >--/17/13 A 21/20/15 ▲ 20/19/14 ▲ 20/18/14


Customer Id: AMABALMAR Sample No.: KCPA004255 Lab Number: 05931545 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 <u>don.b505@comcast.net</u>

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

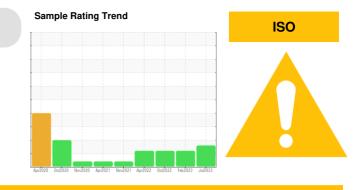

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

22 Feb 2023 Diag: Angela Borella



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

03 Oct 2022 Diag: Angela Borella



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view report

07 Apr 2022 Diag: Don Baldridge



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend ISO

Machine Id 7027987 (S/N 1229) Component Compressor

Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM		method	limit/baca	ourropt	history	history
	AHON		limit/base		history1	history2
Sample Number		Client Info		KCPA004255	KCP55200	KCP46938
Sample Date		Client Info		19 Jul 2023	22 Feb 2023	03 Oct 2022
Machine Age	hrs	Client Info		12935	11928	10437
Oil Age	hrs	Client Info		0	1489	2333
Oil Changed		Client Info		N/A	Not Changd	Changed
Sample Status				ABNORMAL	ABNORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	<1	<1
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	3	12	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	100	50	64	57
Calcium	ppm	ASTM D5185m	0	2	0	0
Phosphorus	ppm	ASTM D5185m	0	5	2	16
Zinc	ppm	ASTM D5185m	0	0	4	0
Sulfur	ppm	ASTM D5185m	23500	21625	21586	23707
CONTAMINANTS	5	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	2
Sodium	ppm	ASTM D5185m		16	16	12
Potassium	ppm	ASTM D5185m	>20	1	<1	<1
Water	%	ASTM D6304	>0.05	0.021	0.015	0.025
ppm Water	ppm	ASTM D6304	>500	216.0	157.7	253.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		14816	7270	5674
Particles >6µm		ASTM D7647	>1300	<u> </u>	A 2805	1 909
Particles >14µm		ASTM D7647	>80	A 310	4 91	8 7
Particles >21µm		ASTM D7647	>20	<u> </u>	10	19
Particles >38µm		ASTM D7647	>4	0	1	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	1/20/15	▲ 20/19/14	▲ 20/18/14
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.32	0.35	0.37
. ,	- 5					


Contact/Location: SERVICE MANAGER - AMABALMAR



OIL ANALYSIS REPORT






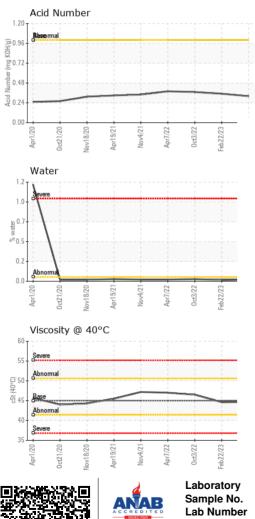

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.7	44.6	46.5
SAMPLE IMAGES	6	method	limit/base	current	history1	history2





Bottom

