


OIL ANALYSIS REPORT

Sample Rating Trend







23024

Component

Screw Compressor

TULCO LUBSOIL LPG WS 150 (--- LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Aug2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		TO90002220		
Sample Date		Client Info		16 Aug 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>60	0		
Chromium	ppm	ASTM D5185m	>4	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		2		
Silver	ppm	ASTM D5185m		<1		
Aluminum	ppm	ASTM D5185m	>5	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>30	<1		
Tin	ppm	ASTM D5185m	>15	1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	0	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	0	<1		
Calcium	ppm	ASTM D5185m	0	<1		
Phosphorus	ppm	ASTM D5185m	0	13		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	0	8615		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	5		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>2.26	0.539		
ppm Water	ppm	ASTM D6304	>22600	5398.6		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	731		
Particles >6µm		ASTM D7647	>1300	398		
Particles >14µm		ASTM D7647	>320	68		
Particles >21µm		ASTM D7647	>80	23		
Particles >38µm		ASTM D7647	>20	4		
Particles >71µm		ASTM D7647	>4	0		
Oil Cleanliness		ISO 4406 (c)	>20/17/15	17/16/13		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A sid Nivesbar (ANI)	ma 1/011/-	ACTM DOGGE		0.076		


Acid Number (AN)

mg KOH/g ASTM D8045

0.076



OIL ANALYSIS REPORT

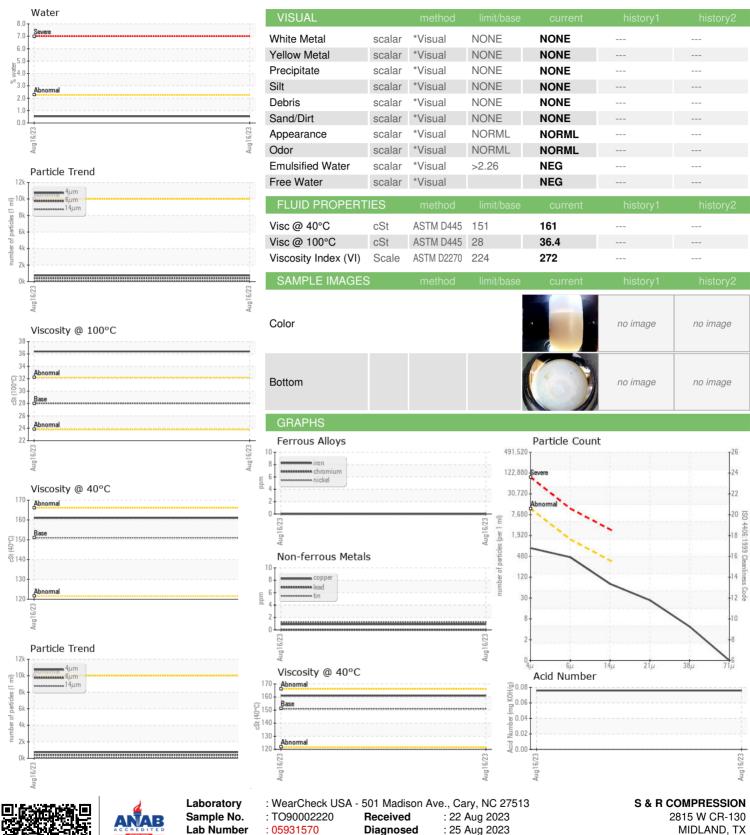



Certificate L2367

Lab Number **Unique Number**

: 05931570

: 10616841

Diagnosed

: 25 Aug 2023 Diagnostician : Jonathan Hester

Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

US 79706 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: