


OIL ANALYSIS REPORT



NORMAL



Machine Id **22067**

Component

Screw Compressor

TULCO LUBSOIL LPG WS 150 (--- LTR)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		L		Aug2023		
SAMPLE INFORM	MATION	method				history2
Sample Number		Client Info		TO90002219		
Sample Date		Client Info		16 Aug 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>60	<1		
Chromium	ppm	ASTM D5185m	>4	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>5	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>30	<1		
Tin	ppm	ASTM D5185m	>15	1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	0	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	0	1		
Calcium	ppm	ASTM D5185m	0	2		
Phosphorus	ppm	ASTM D5185m	0	8		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	0	9095		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304	>2.26	0.613		
ppm Water	ppm	ASTM D6304	>22600	6138.4		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	1853		
Particles >6µm		ASTM D7647	>1300	1009		
Particles >14µm		ASTM D7647	>320	172		
Particles >21µm		ASTM D7647	>80	58		
Particles >38μm		ASTM D7647	>20	9		
Particles >71µm		ASTM D7647	>4	1		
Oil Cleanliness		ISO 4406 (c)	>20/17/15	18/17/15		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045

0.073



OIL ANALYSIS REPORT

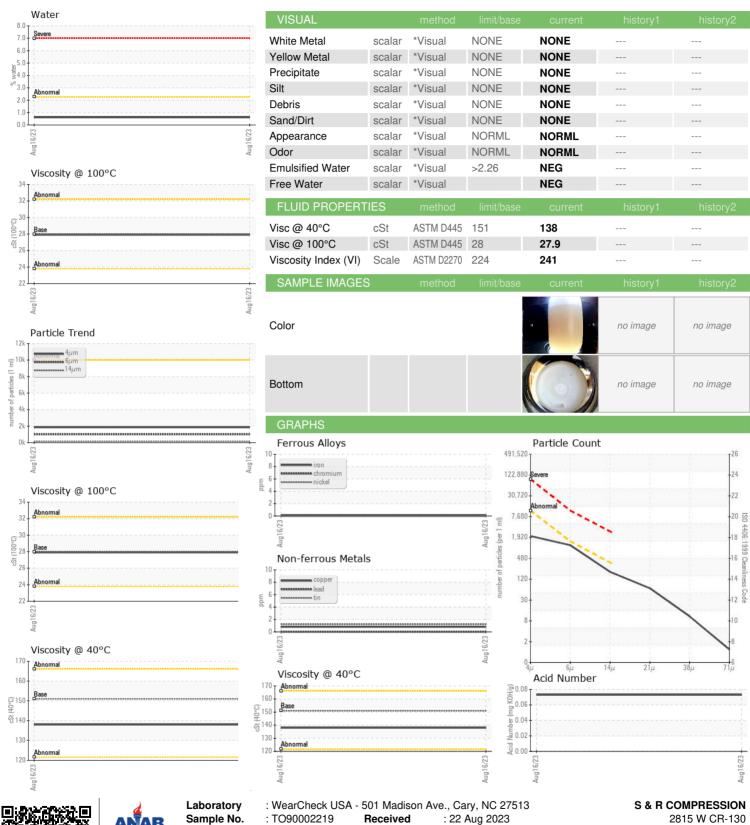





Certificate L2367

Sample No. Lab Number **Unique Number**

: 05931571

: 10616842

Received Diagnosed

: 25 Aug 2023 Diagnostician : Jonathan Hester

Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

MIDLAND, TX US 79706

Contact: Service Manager

T:

F: