

PROBLEM SUMMARY

Sample Rating Trend


ISO



Machine Id
C-1163
Component
Screw Compressor
Fluid
NOT GIVEN (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

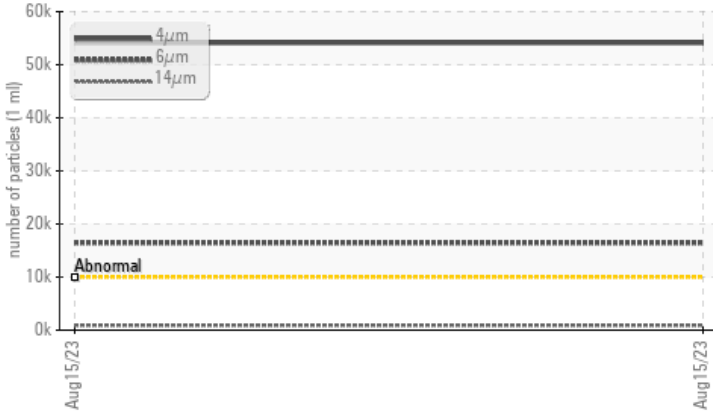

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	---	---
Particles >4µm	ASTM D7647	>10000	▲ 54106	---	---
Particles >6µm	ASTM D7647	>2500	▲ 16455	---	---
Particles >14µm	ASTM D7647	>320	▲ 899	---	---
Particles >21µm	ASTM D7647	>80	▲ 137	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 23/21/17	---	---

Customer Id: CANSTETX
Sample No.: TO90002264
Lab Number: 05931573
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id
C-1163
Component
Screw Compressor
Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

Sample Number	Client Info	TO90002264	---	---
Sample Date	Client Info	15 Aug 2023	---	---
Machine Age	hrs	Client Info	0	---
Oil Age	hrs	Client Info	0	---
Oil Changed	Client Info	N/A	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>60	6	---	---
Chromium	ppm	ASTM D5185m	>4	0	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>5	0	---	---
Lead	ppm	ASTM D5185m	>10	0	---	---
Copper	ppm	ASTM D5185m	>30	<1	---	---
Tin	ppm	ASTM D5185m	>15	2	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
Cadmium	ppm	ASTM D5185m		0	---	---

ADDITIVES method limit/base current history1 history2

Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		<1	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		1	---	---
Calcium	ppm	ASTM D5185m		18	---	---
Phosphorus	ppm	ASTM D5185m		1192	---	---
Zinc	ppm	ASTM D5185m		5	---	---
Sulfur	ppm	ASTM D5185m		242	---	---

CONTAMINANTS method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>50	2	---	---
Sodium	ppm	ASTM D5185m		<1	---	---
Potassium	ppm	ASTM D5185m	>20	1	---	---
Water	%	ASTM D6304	>0.1	0.078	---	---
ppm Water	ppm	ASTM D6304	>1000	789.5	---	---






FLUID CLEANLINESS method limit/base current history1 history2

Particles >4µm	ASTM D7647	>10000	▲ 54106	---	---
Particles >6µm	ASTM D7647	>2500	▲ 16455	---	---
Particles >14µm	ASTM D7647	>320	▲ 899	---	---
Particles >21µm	ASTM D7647	>80	▲ 137	---	---
Particles >38µm	ASTM D7647	>20	0	---	---
Particles >71µm	ASTM D7647	>4	0	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 23/21/17	---	---

FLUID DEGRADATION method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045		0.015	---	---
------------------	----------	------------	--	--------------	-----	-----

OIL ANALYSIS REPORT

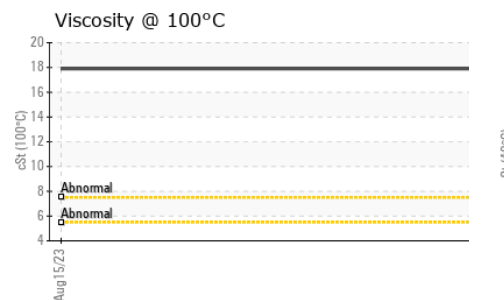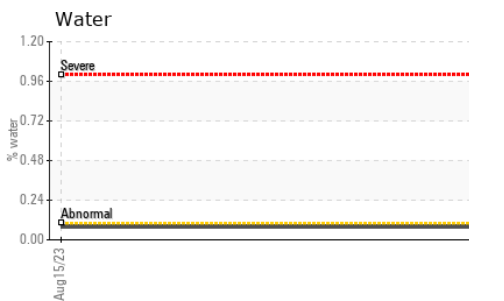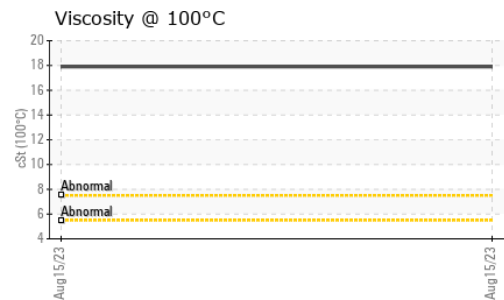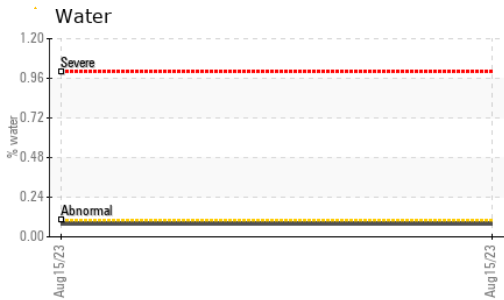
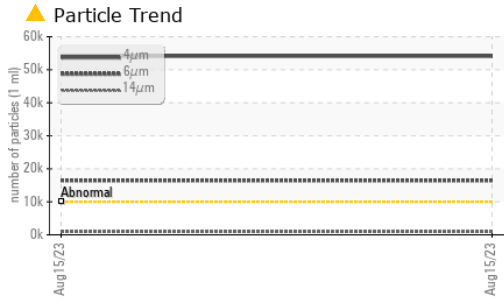


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	LIGHT	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	103	---	---
Visc @ 100°C	cSt	ASTM D445	17.9	---	---
Viscosity Index (VI)	Scale	ASTM D2270	192	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

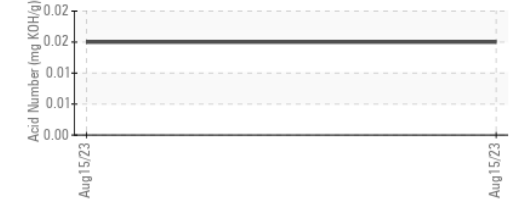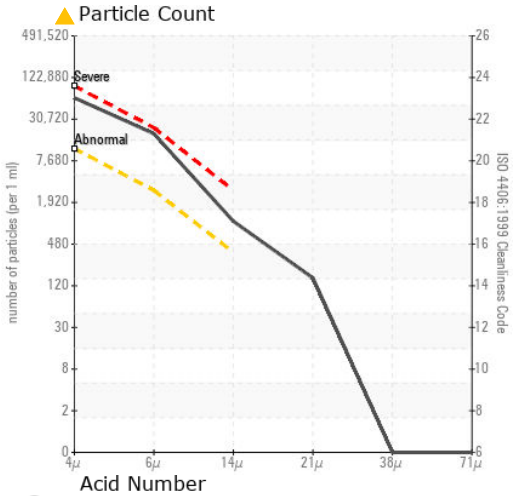

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO90002264 **Received** : 22 Aug 2023
Lab Number : 05931573 **Diagnosed** : 24 Aug 2023
Unique Number : 10616844 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

CANES MIDSTREAM
 2408 HWY 163 N
 STERLING CITY, TX
 US 76951
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)