


PROBLEM SUMMARY

Sample Rating Trend



ISO

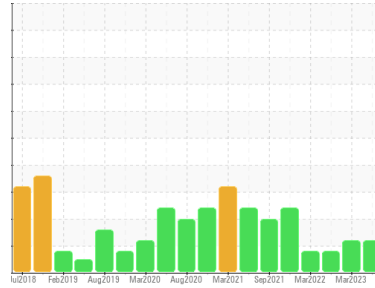


Area
EDWARD PLANT
Machine Id
C-1163 (S/N XC0296)

Component
Refrigeration Compressor
Fluid
TULCO LUBSOIL SYN RL WI 100 (250 GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

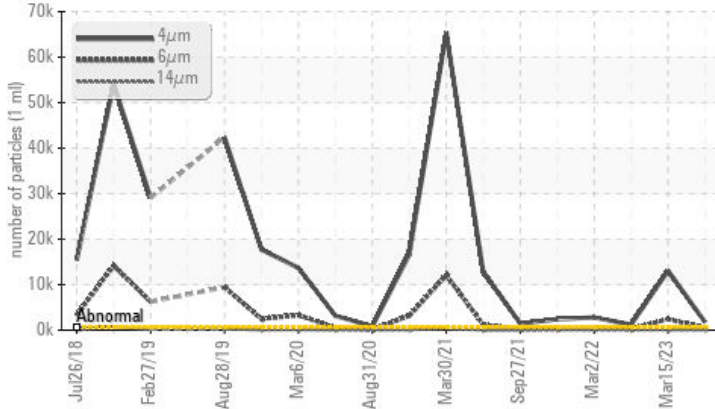

RECOMMENDATION

No corrective action is recommended at this time.
Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ATTENTION
Particles >4µm	ASTM D7647	>640	▲ 1781	▲ 13054	▲ 1191
Particles >6µm	ASTM D7647	>320	▲ 493	▲ 2445	252
Oil Cleanliness	ISO 4406 (c)	>16/15/13	▲ 18/16/12	▲ 21/18/13	▲ 17/15/11

Customer Id: TAREDWA
Sample No.: TO90002229
Lab Number: 05931590
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

15 Mar 2023 Diag: Angela Borella

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



07 Sep 2022 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 6 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



02 Mar 2022 Diag: Angela Borella

ISO




We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Area
EDWARD PLANT
 Machine Id
C-1163 (S/N XC0296)
 Component
Refrigeration Compressor
 Fluid
TULCO LUBSOIL SYN RL WI 100 (250 GAL)

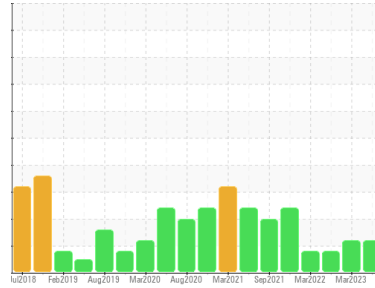

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	TO90002229	TO90002329	TO9012507
Sample Date	Client Info	14 Aug 2023	15 Mar 2023	07 Sep 2022
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	Not Changd
Sample Status		ABNORMAL	ABNORMAL	ATTENTION

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >8	7	5	3
Chromium	ppm	ASTM D5185m >2	0	0	0
Nickel	ppm	ASTM D5185m	0	<1	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >3	0	1	<1
Lead	ppm	ASTM D5185m >2	0	0	0
Copper	ppm	ASTM D5185m >8	1	0	0
Tin	ppm	ASTM D5185m >4	6	4	4
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	<1	0
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m	<1	3	0
Calcium	ppm	ASTM D5185m	25	22	17
Phosphorus	ppm	ASTM D5185m 1500	1172	1052	739
Zinc	ppm	ASTM D5185m	0	7	<1
Sulfur	ppm	ASTM D5185m	17	13	60

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	2	1	1
Sodium	ppm	ASTM D5185m	2	0	<1
Potassium	ppm	ASTM D5185m >20	<1	<1	0
Water	%	ASTM D6304 >2.26	0.071	0.00	0.022
ppm Water	ppm	ASTM D6304 >22600	712.6	0.00	225.7






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >640	▲ 1781	▲ 13054	▲ 1191
Particles >6µm	ASTM D7647 >320	▲ 493	▲ 2445	252
Particles >14µm	ASTM D7647 >80	37	66	15
Particles >21µm	ASTM D7647 >20	13	14	5
Particles >38µm	ASTM D7647 >4	0	1	0
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >16/15/13	▲ 18/16/12	▲ 21/18/13	▲ 17/15/11

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974 0.04	0.028	0.045	0.027


OIL ANALYSIS REPORT

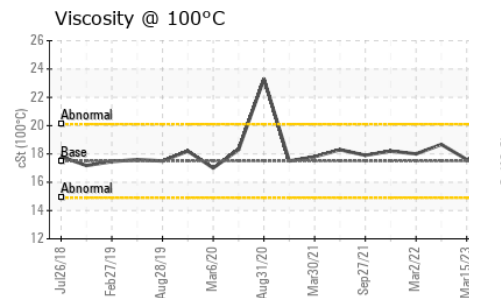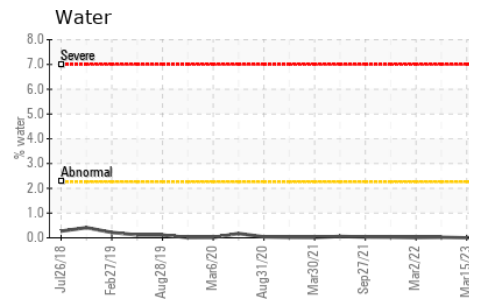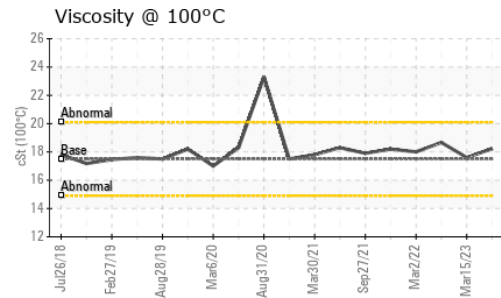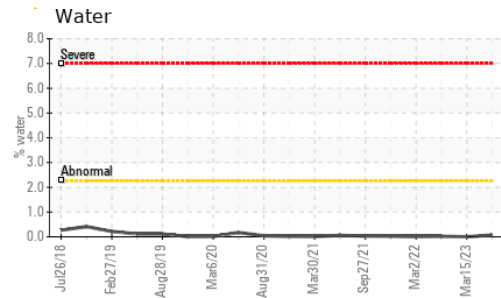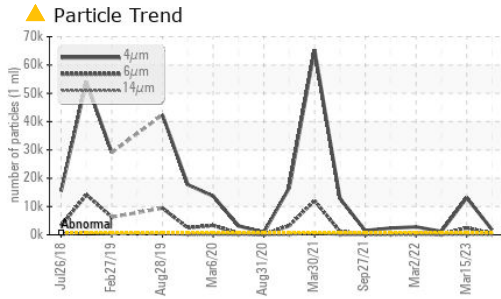






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2.26	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	97	100	105
Visc @ 100°C	cSt	ASTM D445	17.5	17.6	18.67
Viscosity Index (VI)	Scale	ASTM D2270	198	193	198

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

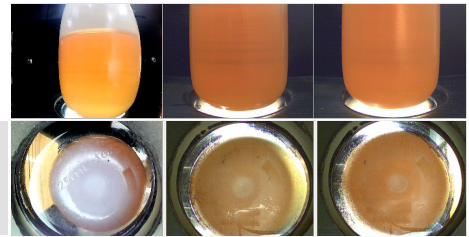

GRAPHS

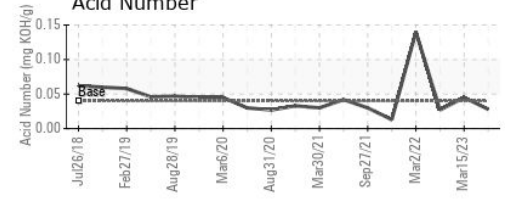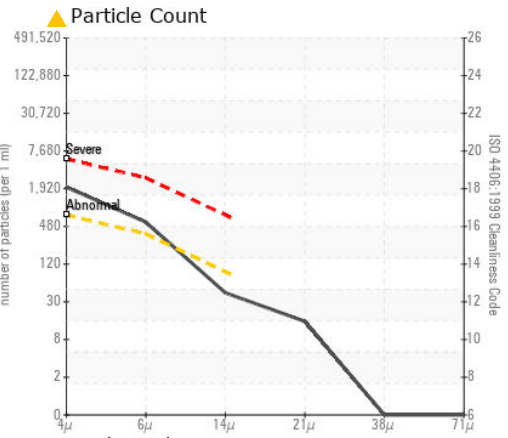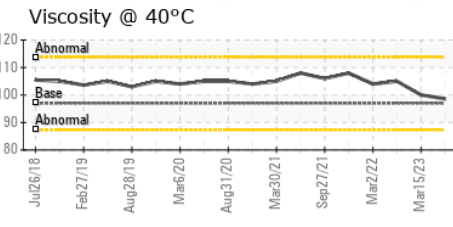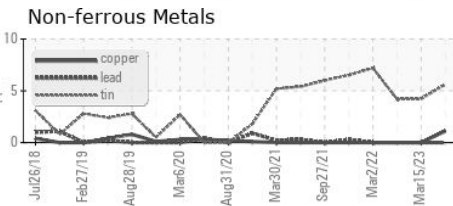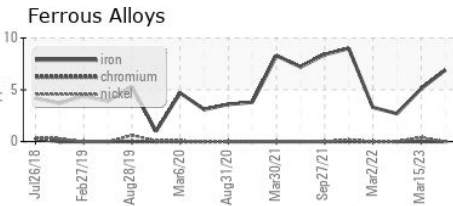

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO90002229 **Received** : 22 Aug 2023
Lab Number : 05931590 **Diagnosed** : 25 Aug 2023
Unique Number : 10616861 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KV100, PrtCount, VI)

TARGA RESOURCES - EDWARD
 1757 COUNTY ROAD 250
 MIDKIFF, TX
 US 79755
 Contact: BRANDON CERVANTES
 bcervantes@targaresources.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)