


PROBLEM SUMMARY

Sample Rating Trend




WATER

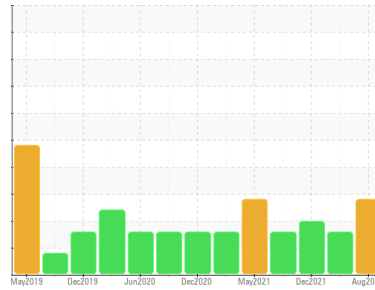


Area
DRIVER PLANT
Machine Id
C-2161 (S/N XC-6278)
Component
Refrigeration Compressor
Fluid
SUMMIT PGI 100 (250 GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

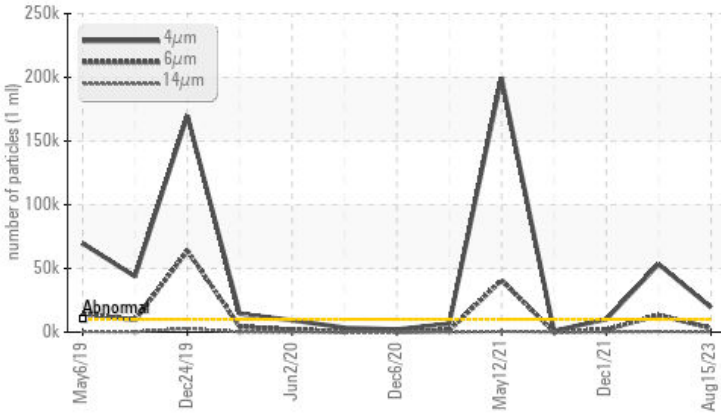

▲ Water

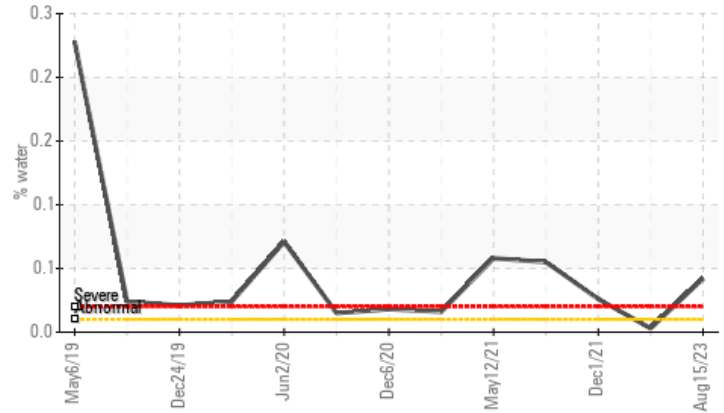

RECOMMENDATION

No corrective action is recommended at this time.
Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ATTENTION	ABNORMAL	ATTENTION
Water	%	ASTM D6304	>0.01	▲ 0.042	0.003	▲ 0.026
ppm Water	ppm	ASTM D6304	>100	▲ 428.1	30.1	▲ 263.3
Particles >4µm		ASTM D7647	>10000	▲ 19388	▲ 53337	▲ 10138
Particles >6µm		ASTM D7647	>2500	▲ 3176	▲ 13365	1858
Oil Cleanliness		ISO 4406 (c)	>20/18/15	▲ 21/19/13	▲ 23/21/16	▲ 21/18/13

Customer Id: TARDRIV
Sample No.: TO90002277
Lab Number: 05931594
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

16 Mar 2023 Diag: Doug Bogart

ISO



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



01 Dec 2021 Diag: Doug Bogart

WATER



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. There is a trace of moisture present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



27 Sep 2021 Diag: Doug Bogart

WATER




No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Area
DRIVER PLANT
 Machine Id
C-2161 (S/N XC-6278)
 Component
Refrigeration Compressor
 Fluid
SUMMIT PGI 100 (250 GAL)

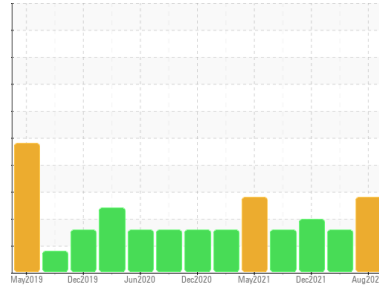

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. There is a trace of moisture present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	TO90002277	TO90002378	TO90001844
Sample Date	Client Info	15 Aug 2023	16 Mar 2023	01 Dec 2021
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ATTENTION	ABNORMAL	ATTENTION

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >8	15	11	8
Chromium	ppm	ASTM D5185m >2	0	0	0
Nickel	ppm	ASTM D5185m	0	<1	<1
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >3	0	1	0
Lead	ppm	ASTM D5185m >2	0	0	<1
Copper	ppm	ASTM D5185m >8	<1	0	0
Tin	ppm	ASTM D5185m >4	4	2	2
Antimony	ppm	ASTM D5185m	---	---	1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	4	0
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m	1	2	0
Calcium	ppm	ASTM D5185m	12	31	9
Phosphorus	ppm	ASTM D5185m	1184	1041	618
Zinc	ppm	ASTM D5185m	<1	10	0
Sulfur	ppm	ASTM D5185m	14	99	12

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	2	1	<1
Sodium	ppm	ASTM D5185m	2	0	<1
Potassium	ppm	ASTM D5185m >20	1	<1	<1
Water	%	ASTM D6304 >0.01	▲ 0.042	0.003	▲ 0.026
ppm Water	ppm	ASTM D6304 >100	▲ 428.1	30.1	▲ 263.3

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	▲ 19388	▲ 53337	▲ 10138
Particles >6µm	ASTM D7647 >2500	▲ 3176	▲ 13365	1858
Particles >14µm	ASTM D7647 >320	73	▲ 473	57
Particles >21µm	ASTM D7647 >80	11	75	8
Particles >38µm	ASTM D7647 >20	0	1	0
Particles >71µm	ASTM D7647 >4	0	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	▲ 21/19/13	▲ 23/21/16	▲ 21/18/13

FLUID DEGRADATION


method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974	0.026	0.045	0.028

OIL ANALYSIS REPORT


Particle Trend

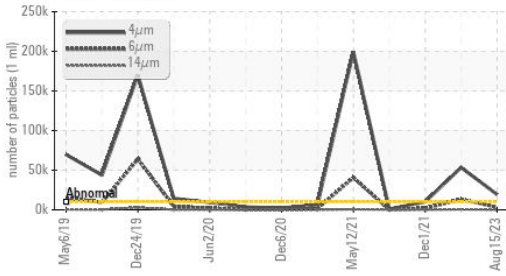


Water

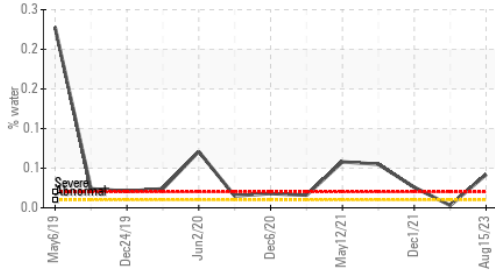


Viscosity @ 100°C

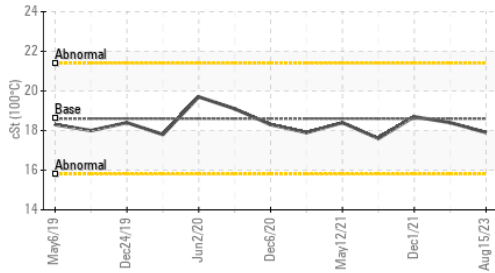

Acid Number

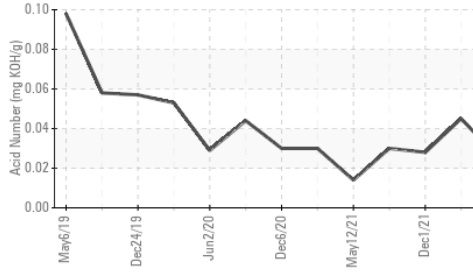


Viscosity @ 100°C

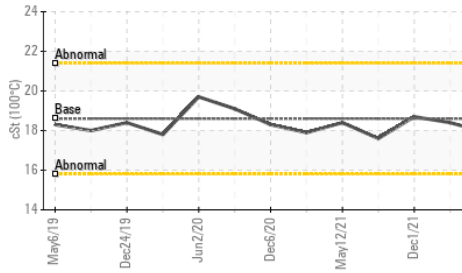

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	100	103	107
Visc @ 100°C	cSt	ASTM D445	18.6	17.9	18.4
Viscosity Index (VI)	Scale	ASTM D2270	185	192	198

SAMPLE IMAGES

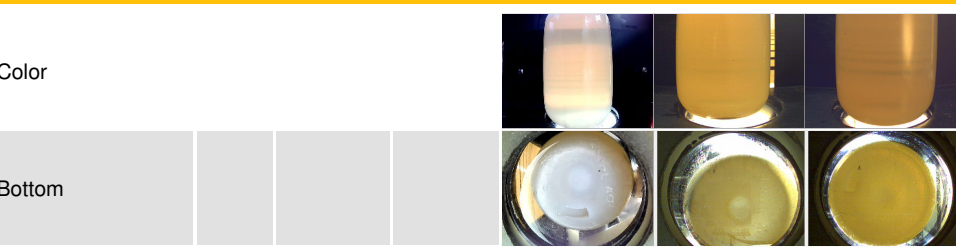


GRAPHS


Ferrous Alloys

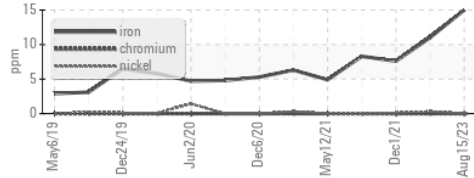


Non-ferrous Metals

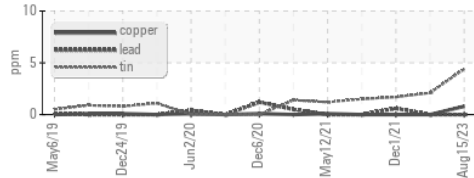


Viscosity @ 40°C

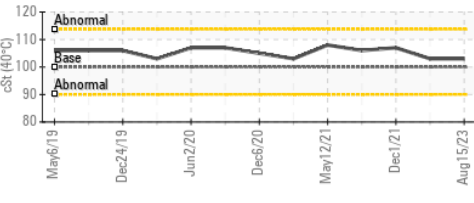

Particle Count

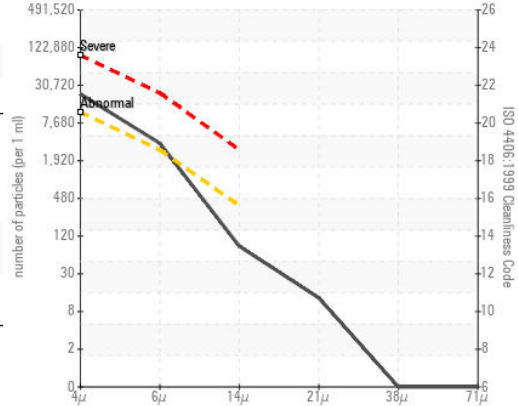

Acid Number

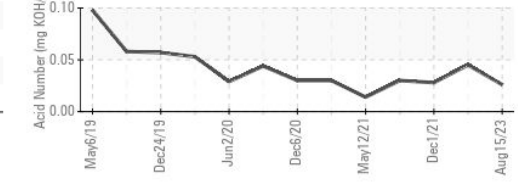

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO90002277 **Received** : 22 Aug 2023
Lab Number : 05931594 **Diagnosed** : 25 Aug 2023
Unique Number : 10616865 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KV100, PrtCount, VI)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

TARGA RESOURCES - DRIVER
 38003 FM 1379
 MIDLAND, TX
 US 78706
 Contact: JUSTIN WADDELL
 jwaddell@targaresources.com
 T: (432)967-7967
 F: