


PROBLEM SUMMARY

Area
JOHNSON PLANT
 Machine Id
C-201 (S/N SFFM058170)
 Component
Refrigeration Compressor
 Fluid
FRICK COMPRESSOR OIL #12B (250 GAL)

Sample Rating Trend

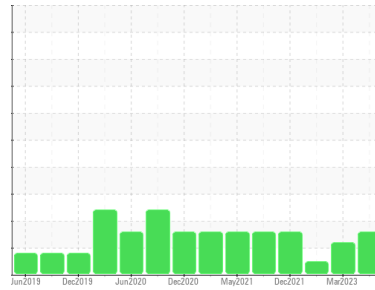


WATER



COMPONENT CONDITION SUMMARY

▲ Water

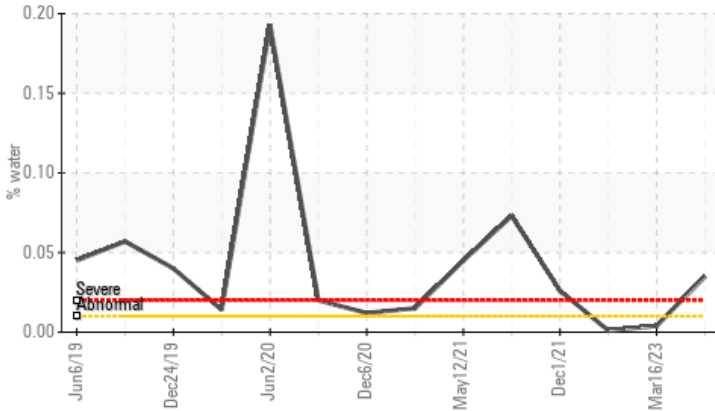

RECOMMENDATION

No corrective action is recommended at this time.
 Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				MARGINAL	ATTENTION	NORMAL
Water	%	ASTM D6304	>0.01	▲ 0.035	0.004	0.001
ppm Water	ppm	ASTM D6304	>100	▲ 357.1	43.8	0.00

Customer Id: TARJOHN
 Sample No.: TO90002277
 Lab Number: 05931595
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

16 Mar 2023 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



08 Mar 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



01 Dec 2021 Diag: Doug Bogart

WATER




No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a trace of moisture present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

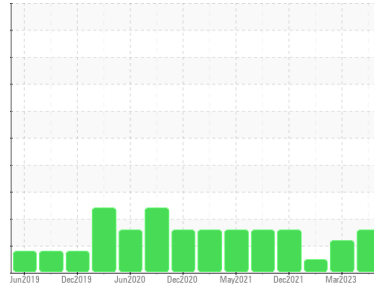

WATER



Area
JOHNSON PLANT
 Machine Id
C-201 (S/N SFFM058170)
 Component
Refrigeration Compressor
 Fluid
FRICK COMPRESSOR OIL #12B (250 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a trace of moisture present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	TO90002277	TO90002371	TO90000861
Sample Date	Client Info	15 Aug 2023	16 Mar 2023	08 Mar 2022
Machine Age	hrs	0	0	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		MARGINAL	ATTENTION	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >8	25	21	9
Chromium	ppm	ASTM D5185m >2	0	0	0
Nickel	ppm	ASTM D5185m	0	<1	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >3	0	1	<1
Lead	ppm	ASTM D5185m >2	0	0	0
Copper	ppm	ASTM D5185m >8	<1	<1	0
Tin	ppm	ASTM D5185m >4	1	<1	1
Antimony	ppm	ASTM D5185m	---	---	1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	2
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	<1	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m	1	3	0
Calcium	ppm	ASTM D5185m	2	14	0
Phosphorus	ppm	ASTM D5185m	617	447	31
Zinc	ppm	ASTM D5185m	4	18	10
Sulfur	ppm	ASTM D5185m	25	56	19

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	7	7	10
Sodium	ppm	ASTM D5185m	5	3	3
Potassium	ppm	ASTM D5185m >20	1	1	0
Water	%	ASTM D6304 >0.01	▲ 0.035	0.004	0.001
ppm Water	ppm	ASTM D6304 >100	▲ 357.1	43.8	0.00






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	4721	▲ 18325	5973
Particles >6µm	ASTM D7647 >2500	886	▲ 3982	1058
Particles >14µm	ASTM D7647 >320	32	99	27
Particles >21µm	ASTM D7647 >80	6	15	6
Particles >38µm	ASTM D7647 >20	0	0	0
Particles >71µm	ASTM D7647 >4	0	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	19/17/12	▲ 21/19/14	20/17/12

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974	0.015	0.015	0.015

OIL ANALYSIS REPORT

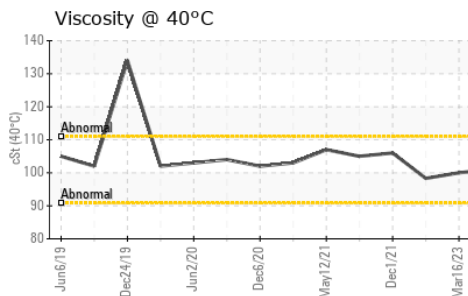
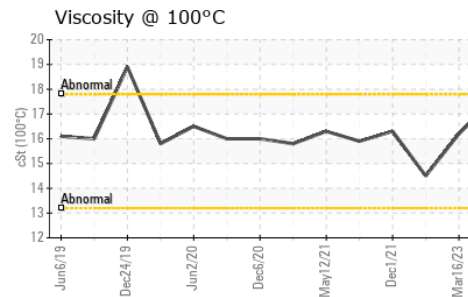
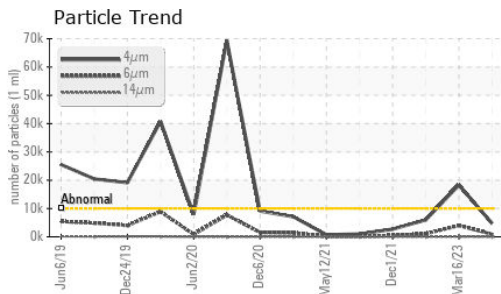
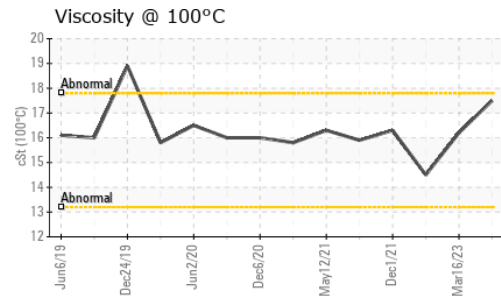
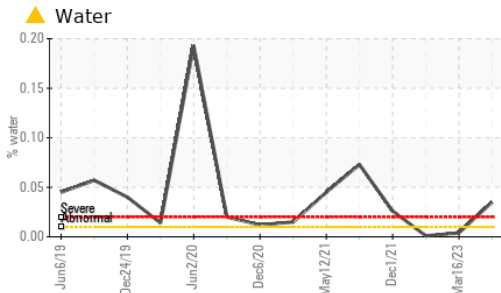


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	101	100	98.3
Visc @ 100°C	cSt	ASTM D445	17.5	16.2	14.5
Viscosity Index (VI)	Scale	ASTM D2270	190	174	152

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

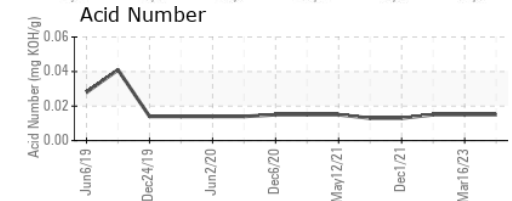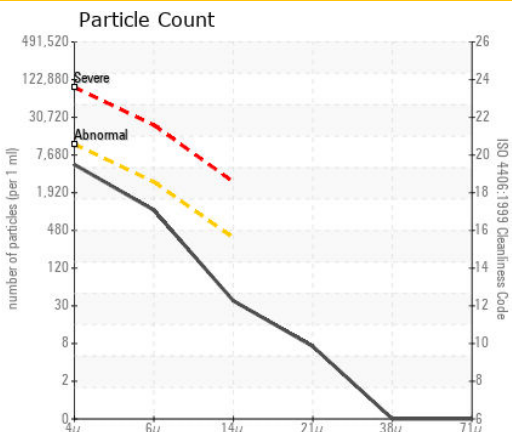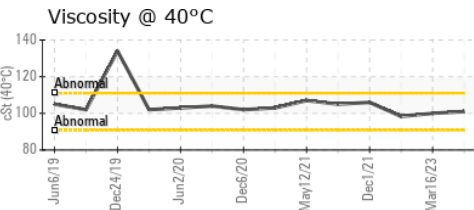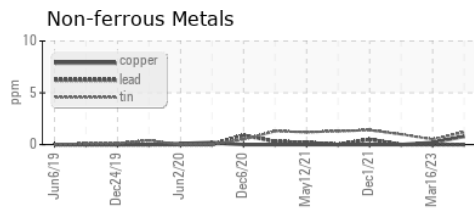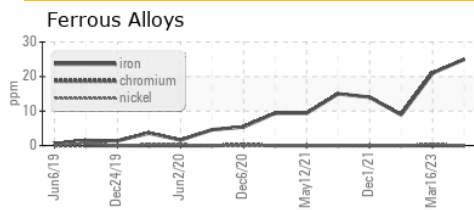

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO90002277 **Received** : 22 Aug 2023
Lab Number : 05931595 **Diagnosed** : 24 Aug 2023
Unique Number : 10616866 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KV100, PrtCount, VI)

TARGA RESOURCES - JOHNSON
 38003 FM 1379
 MIDLAND, TX
 US 78706
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: