


PROBLEM SUMMARY

Sample Rating Trend




WATER

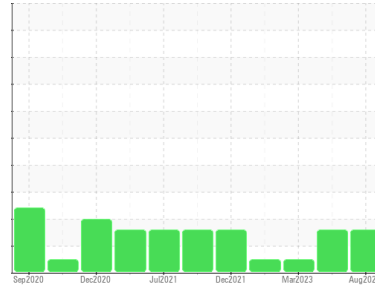

Machine Id
C-163 - PANTHER 1 C-163 - PANTHER 1
 Component
Refrigeration Compressor
 Fluid
CPI ENG. 1516-100 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Water

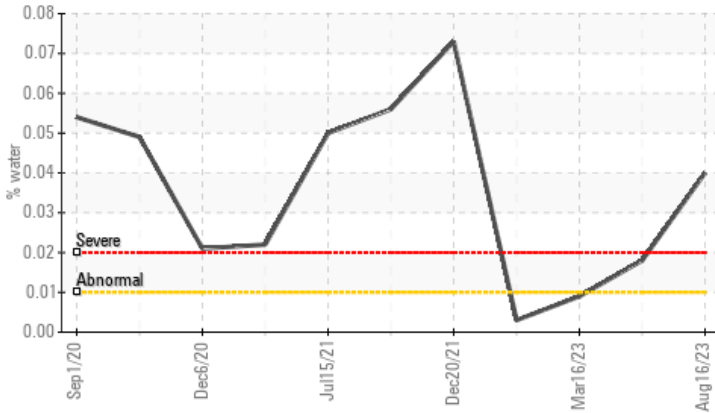

RECOMMENDATION

No corrective action is recommended at this time.
 Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				MARGINAL	MARGINAL	NORMAL
Water	%	ASTM D6304	>0.01	▲ 0.040	▲ 0.018	0.009
ppm Water	ppm	ASTM D6304	>100	▲ 400.2	▲ 189.9	99.0

Customer Id: ENERAN
 Sample No.: TO90002269
 Lab Number: 05931596
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

01 Jun 2023 Diag: Don Baldrige

WATER



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a trace of moisture present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



16 Mar 2023 Diag: Angela Borella

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



08 Mar 2022 Diag: Don Baldrige

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report





Machine Id
C-163 - PANTHER 1 C-163 - PANTHER 1
 Component
Refrigeration Compressor
 Fluid
CPI ENG. 1516-100 (--- GAL)

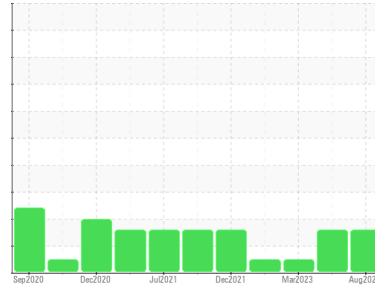

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a trace of moisture present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		TO90002269	TO90002387	TO90002366
Sample Date	Client Info		16 Aug 2023	01 Jun 2023	16 Mar 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			MARGINAL	MARGINAL	NORMAL

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	2	2	2
Chromium	ppm	ASTM D5185m >2	0	<1	0
Nickel	ppm	ASTM D5185m	0	<1	<1
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >3	0	0	1
Lead	ppm	ASTM D5185m >2	0	0	0
Copper	ppm	ASTM D5185m >8	<1	0	0
Tin	ppm	ASTM D5185m >4	1	<1	<1
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	0	0	0






ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	<1
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m	<1	0	4
Calcium	ppm	ASTM D5185m	1	<1	12
Phosphorus	ppm	ASTM D5185m	55	54	44
Zinc	ppm	ASTM D5185m	0	0	6
Sulfur	ppm	ASTM D5185m	8	15	27

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	2	<1	2
Sodium	ppm	ASTM D5185m	5	2	3
Potassium	ppm	ASTM D5185m >20	<1	<1	<1
Water	%	ASTM D6304 >0.01	▲ 0.040	▲ 0.018	0.009
ppm Water	ppm	ASTM D6304 >100	▲ 400.2	▲ 189.9	99.0

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	2527	2357	1555
Particles >6µm	ASTM D7647	>2500	646	660	490
Particles >14µm	ASTM D7647	>320	35	34	22
Particles >21µm	ASTM D7647	>80	10	7	6
Particles >38µm	ASTM D7647	>20	0	0	0
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	19/17/12	18/17/12	18/16/12

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.015	0.015	0.015


OIL ANALYSIS REPORT

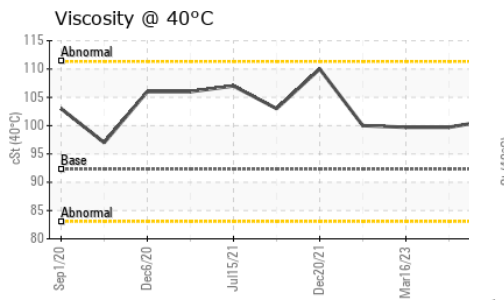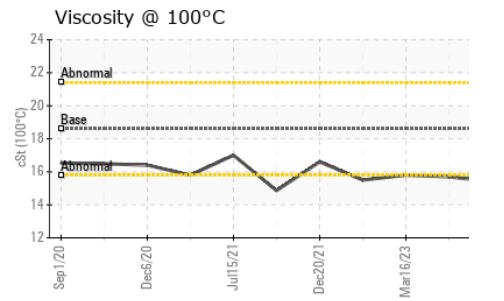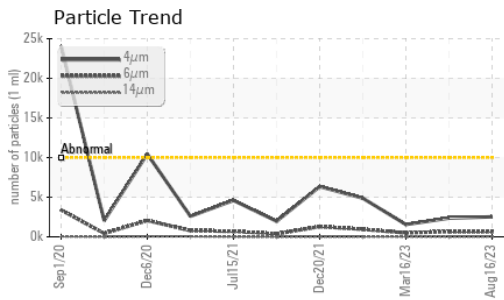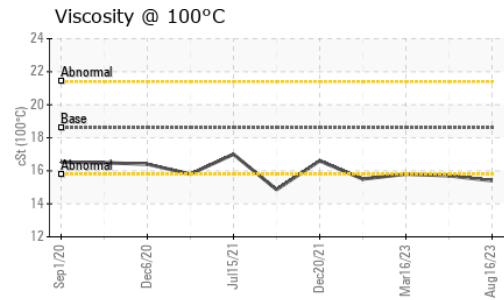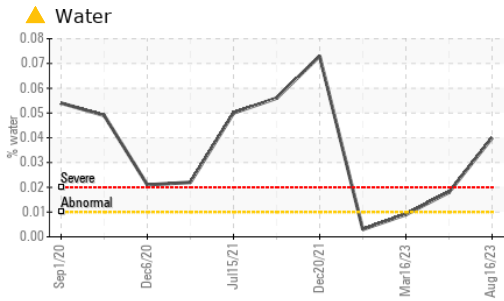






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	92.3	101	99.7
Visc @ 100°C	cSt	ASTM D445	18.6	15.4	15.8
Viscosity Index (VI)	Scale	ASTM D2270	223	161	167

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

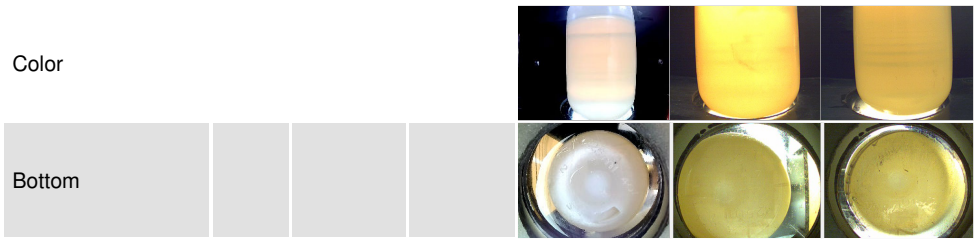

GRAPHS

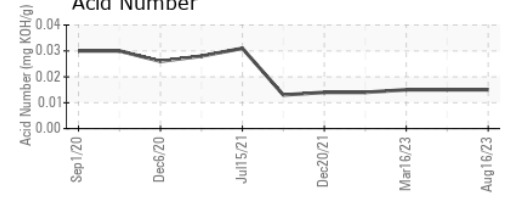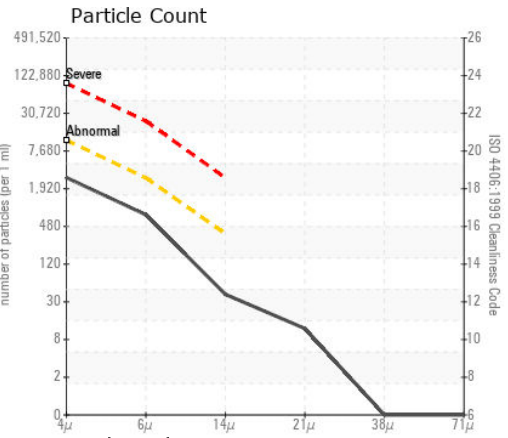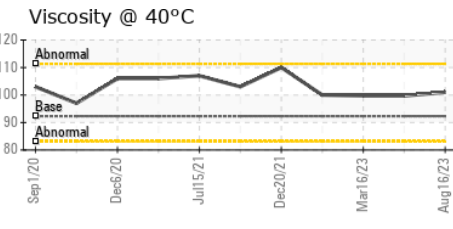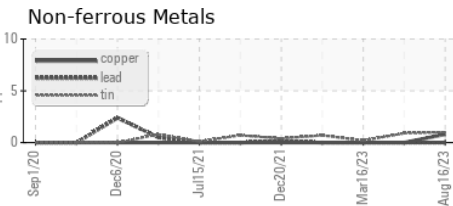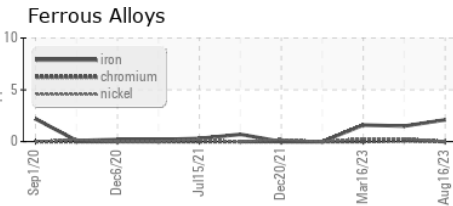

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO90002269 **Received** : 22 Aug 2023
Lab Number : 05931596 **Diagnosed** : 24 Aug 2023
Unique Number : 10616867 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KV100, PrtCount, VI)

ENERGY TRANSFER - PANTHER PLANT
 17106 FM 1492
 RANKIN, TX
 US 79778
 Contact: WOODY SALGE
 woody.salge@energytransfer.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)