




# PROBLEM SUMMARY


Area  
**ENGINE ROOM**  
 Machine Id  
**MYCUM C05-1 (S/N 2519367 / C990480F-2)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**FRICK COMPRESSOR OIL #3 (--- PNT)**

Sample Rating Trend

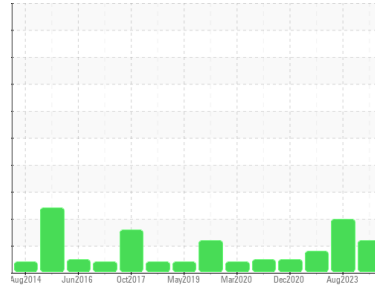

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

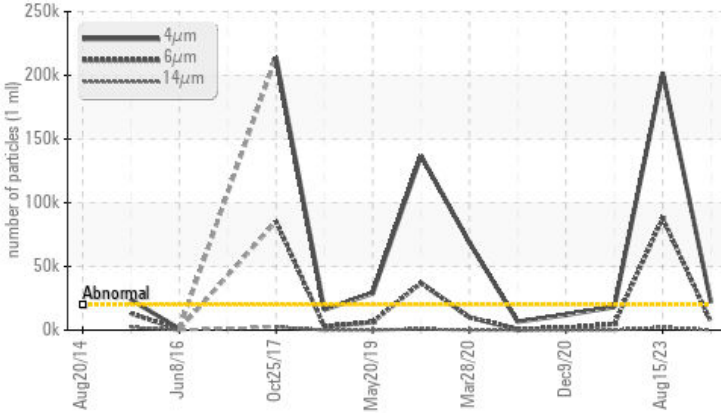

## RECOMMENDATION

Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>ABNORMAL</b>	ABNORMAL	ATTENTION
Particles >4µm	ASTM D7647	>20000	▲ <b>21782</b>	▲ 201970	18219
Particles >6µm	ASTM D7647	>2500	▲ <b>6392</b>	▲ 87786	▲ 4835
Oil Cleanliness	ISO 4406 (c)	>21/18/15	▲ <b>22/20/14</b>	▲ 25/24/18	▲ 21/19/15

Customer Id: PERPERUSP  
 Sample No.: USP245929  
 Lab Number: 05932140  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 15 Aug 2023 Diag: Doug Bogart

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 24 May 2022 Diag: Doug Bogart

ISO



Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 09 Dec 2020 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

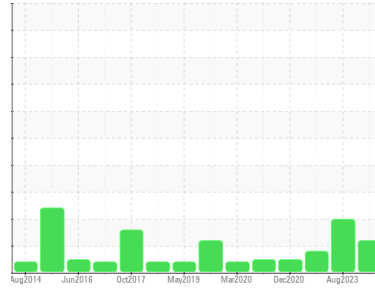

ISO



Area  
**ENGINE ROOM**  
Machine Id  
**MYCUM C05-1 (S/N 2519367 / C990480F-2)**  
Component  
**Refrigeration Compressor**  
Fluid  
**FRICK COMPRESSOR OIL #3 (--- PNT)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USP245929</b>	USP0000509	USP235742
Sample Date	Client Info	<b>19 Aug 2023</b>	15 Aug 2023	24 May 2022
Machine Age	hrs	Client Info	<b>5397</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	ABNORMAL	ATTENTION

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >8	<b>2</b>	14	<1
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >8	<b>0</b>	<1	0
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	<b>16</b>	10	62

## CONTAMINANTS






method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	<1	2
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Water	%	ASTM D6304 >0.01	<b>0.00</b>	0.004	0.001
ppm Water	ppm	ASTM D6304 >100	<b>0.00</b>	43.2	8.0

## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >20000	<b>▲ 21782</b>	▲ 201970	18219
Particles >6µm	ASTM D7647 >2500	<b>▲ 6392</b>	▲ 87786	▲ 4835
Particles >14µm	ASTM D7647 >320	<b>146</b>	▲ 2261	259
Particles >21µm	ASTM D7647 >80	<b>16</b>	▲ 227	46
Particles >38µm	ASTM D7647 >20	<b>1</b>	1	0
Particles >71µm	ASTM D7647 >4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >21/18/15	<b>▲ 22/20/14</b>	▲ 25/24/18	▲ 21/19/15

## FLUID DEGRADATION


method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.015</b>	0.014	0.012

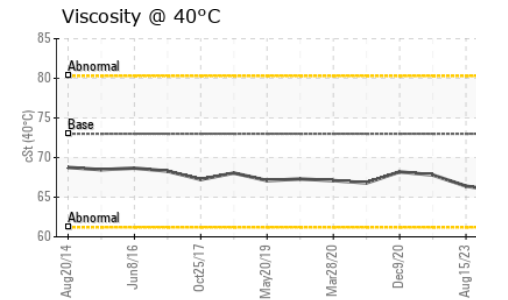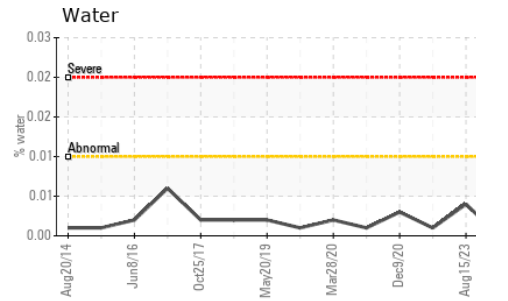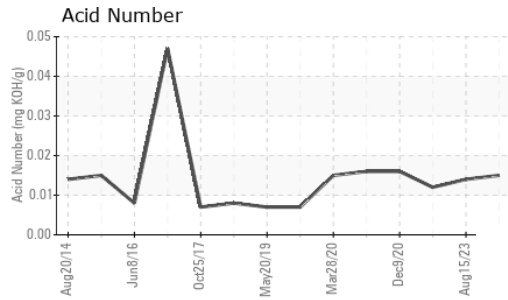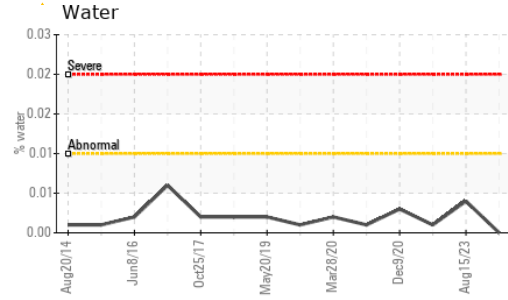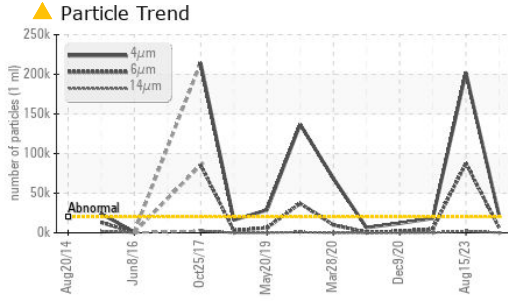





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	LIGHT	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 73	65.8	66.4	67.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

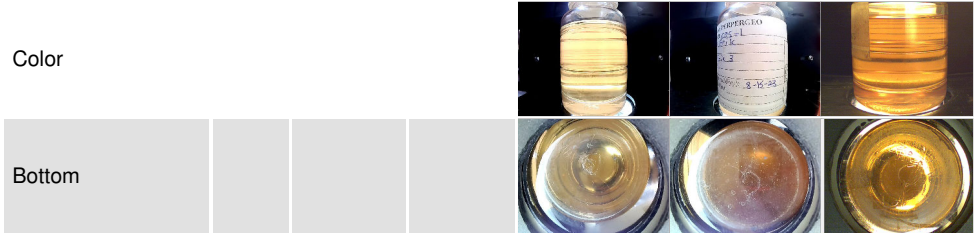

## GRAPHS

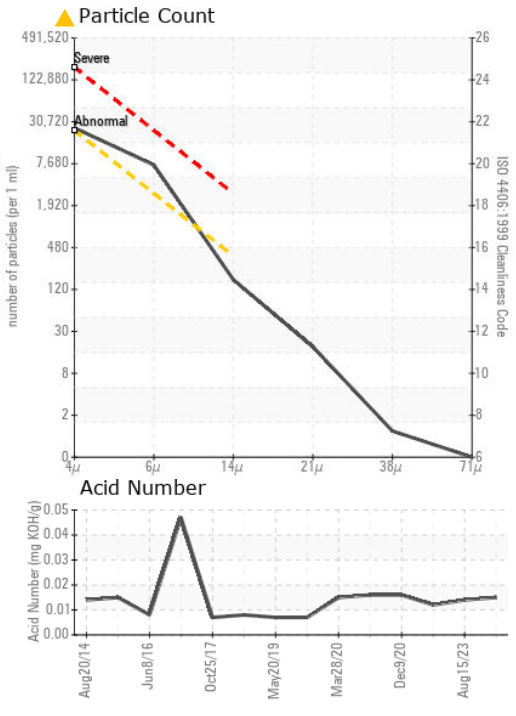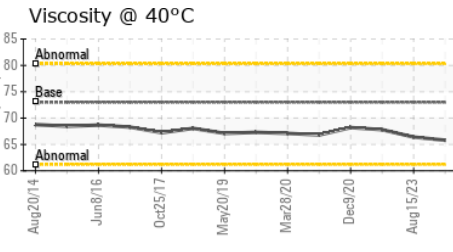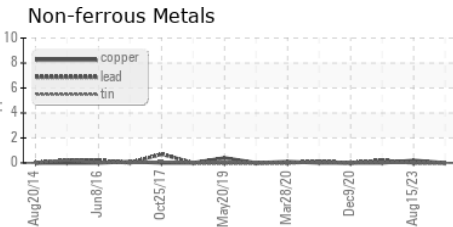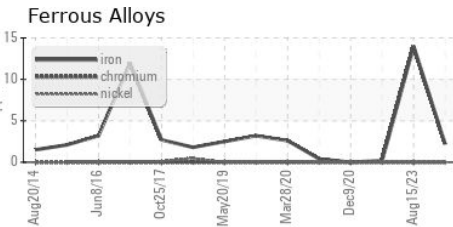

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP245929 **Received** : 23 Aug 2023  
**Lab Number** : 05932140 **Diagnosed** : 24 Aug 2023  
**Unique Number** : 10617411 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**PERDUE FARMS INC**  
 250 GEORGIA HWY 247 SPUR  
 PERRY, GA  
 US 31069  
 Contact: JAMES EAST  
 james.east@perdue.com  
 T: (478)988-6048  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)