PROBLEM SUMMARY

Sample Rating Trend

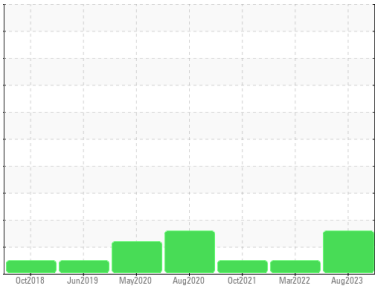

WATER

Area
PO-4030 [A13000316]
Machine Id
INGERSOLL RAND CBV422799 - FEDEX GROUND KENNESAW
Component
Compressor

COMPONENT CONDITION SUMMARY

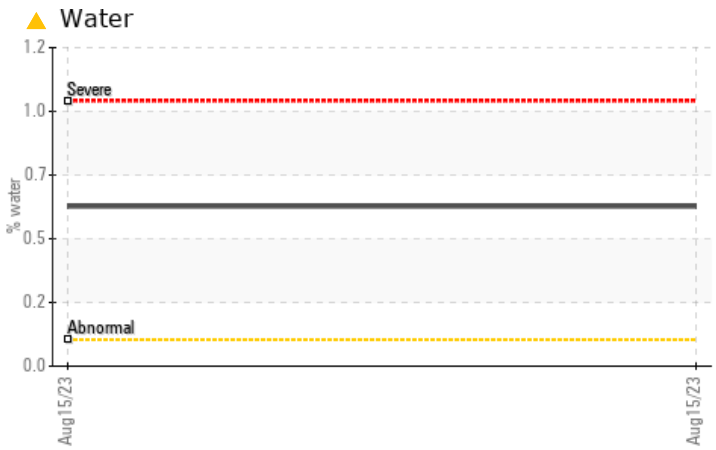

RECOMMENDATION

We advise that you follow the water drain-off procedure for this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				**ATTENTION**	NORMAL	NORMAL
Water	%	ASTM D6304	>0.1	▲ **0.602**	---	---
ppm Water	ppm	ASTM D6304	>1000	▲ **6020**	---	---
Emulsified Water	scalar	*Visual	>0.1	▲ **0.2%**	NEG	NEG

Customer Id: UCPATLIT
Sample No.: UCP05932173
Lab Number: 05932173
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldridge +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Water Drain-off	---	---	?	We advise that you follow the water drain-off procedure for this component.

HISTORICAL DIAGNOSIS

15 Mar 2022 Diag: Jonathan Hester

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

---

28 Oct 2021 Diag: Jonathan Hester

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

---

31 Aug 2020 Diag: Doug Bogart

DEGRADATION

We recommend that you drain the oil from the component if this has not already been done. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The oil viscosity is higher than normal. The AN level is above the recommended limit.

view report

Pattons

OIL ANALYSIS REPORT

Sample Rating Trend

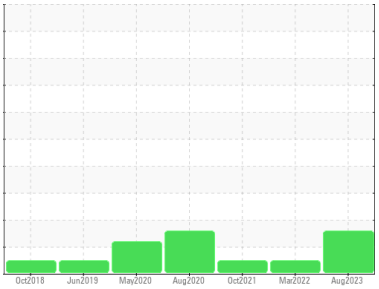

WATER

Area
PO-4030 [A13000316]
Machine Id
INGERSOLL RAND CBV422799 - FEDEX GROUND KENNESAW
Component
Compressor

DIAGNOSIS

Recommendation
We advise that you follow the water drain-off procedure for this component. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a moderate concentration of water present in the oil.

Fluid Condition
The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**UCP05932173**	UCP05498757	UCP05389857
Sample Date		Client Info		**15 Aug 2023**	15 Mar 2022	28 Oct 2021
Machine Age	hrs	Client Info		**46599**	37248	34340
Oil Age	hrs	Client Info		**0**	0	31972
Oil Changed		Client Info		**Not Changd**	N/A	Not Changd
Sample Status				**ATTENTION**	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**4**	2	<1
Chromium	ppm	ASTM D5185m	>10	**0**	0	0
Nickel	ppm	ASTM D5185m		**0**	0	0
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>25	**<1**	<1	0
Lead	ppm	ASTM D5185m	>25	**<1**	<1	0
Copper	ppm	ASTM D5185m	>50	**4**	1	<1
Tin	ppm	ASTM D5185m	>15	**<1**	1	0
Antimony	ppm	ASTM D5185m		**---**	---	0
Vanadium	ppm	ASTM D5185m		**<1**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	**0**	3	0
Barium	ppm	ASTM D5185m	0	**335**	406	455
Molybdenum	ppm	ASTM D5185m	0.1	**0**	0	0
Manganese	ppm	ASTM D5185m	0	**<1**	<1	0
Magnesium	ppm	ASTM D5185m	0	**<1**	0	0
Calcium	ppm	ASTM D5185m	0	**4**	4	3
Phosphorus	ppm	ASTM D5185m	225	**16**	10	5
Zinc	ppm	ASTM D5185m	0	**64**	58	51
Sulfur	ppm	ASTM D5185m	1193	**519**	337	235

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**3**	3	3
Sodium	ppm	ASTM D5185m		**47**	44	47
Potassium	ppm	ASTM D5185m	>20	**7**	<1	2
Water	%	ASTM D6304	>0.1	▲ **0.602**	---	---
ppm Water	ppm	ASTM D6304	>1000	▲ **6020**	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.136	**0.37**	0.30	0.313

OIL ANALYSIS REPORT

Pattons

Water

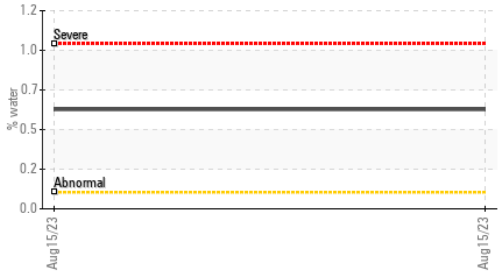

Acid Number

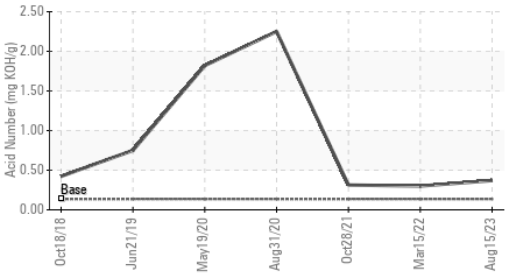

Viscosity @ 40°C

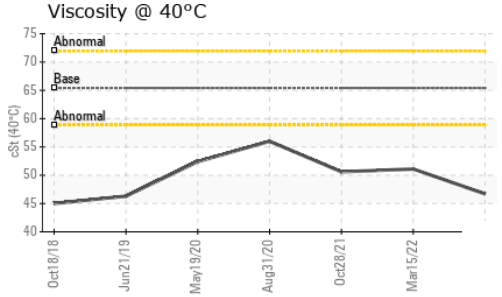

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**LIGHT**	LIGHT	LIGHT
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**LIGHT**	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	▲ **0.2%**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	65.42	**46.7**	51.1	50.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom			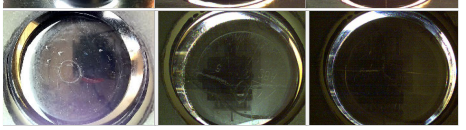		

GRAPHS

Ferrous Alloys

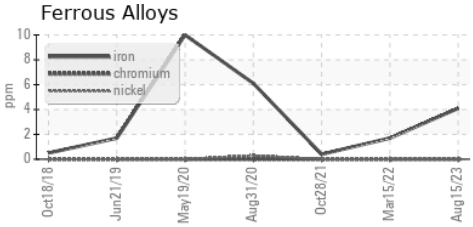

Non-ferrous Metals

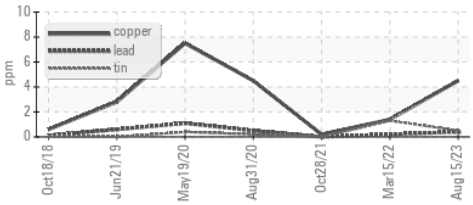

Viscosity @ 40°C

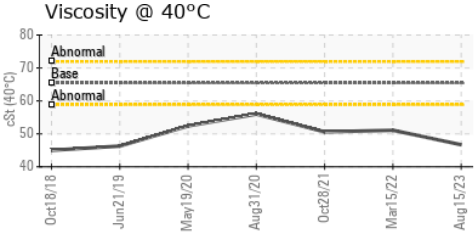

Acid Number

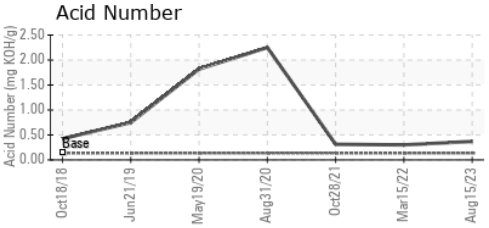

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCP05932173 **Received** : 23 Aug 2023
Lab Number : 05932173 **Diagnosed** : 24 Aug 2023
Unique Number : 10617444 **Diagnostician** : Don Baldridge
Test Package : IND 2 (Additional Tests: KF)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

PATTONS INC - LITHONIA
6709 TRIBBLE STREET
LITHONIA, GA
US 30058
Contact: CHRISSY HARBIN
chrissy.harbin@pattonsinc.com
T: (770)484-9226
F: (770)482-5522