




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**JBS-258-46**  
 Machine Id  
**GARDNER DENVER S085005 - DTR TN**  
 Component  
**Compressor**

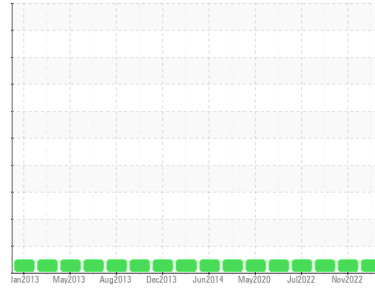

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH05932176</b>	UCH05700366	UCH05652180
Sample Date	Client Info		<b>21 Aug 2023</b>	01 Nov 2022	16 Sep 2022
Machine Age	hrs	Client Info	<b>1594</b>	96460	95442
Oil Age	hrs	Client Info	<b>1065</b>	6589	4900
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	<1
Lead	ppm	ASTM D5185m >25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>1</b>	<1	<1
Tin	ppm	ASTM D5185m >15	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0.0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0.0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m 0.0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m 0.0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 966	<b>115</b>	135	128
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	4
Sulfur	ppm	ASTM D5185m 1309	<b>1461</b>	1113	736

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>4</b>	4	5
Sodium	ppm	ASTM D5185m	<b>0</b>	0	1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	<1

## FLUID DEGRADATION



	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.172	<b>0.15</b>	0.16	0.17

## VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual NONE	<b>NONE</b>	LIGHT	NONE
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual >0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual	<b>NEG</b>	NEG	NEG



# OIL ANALYSIS REPORT



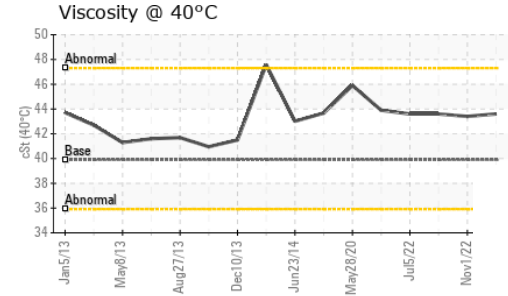
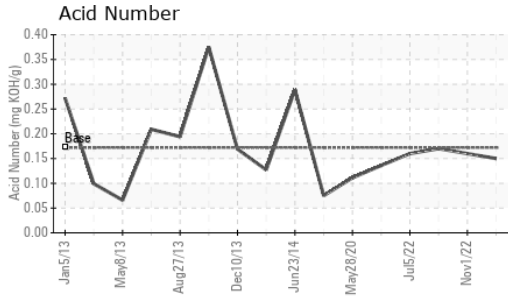


FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	39.9	<b>43.6</b>	43.4	43.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



## GRAPHS

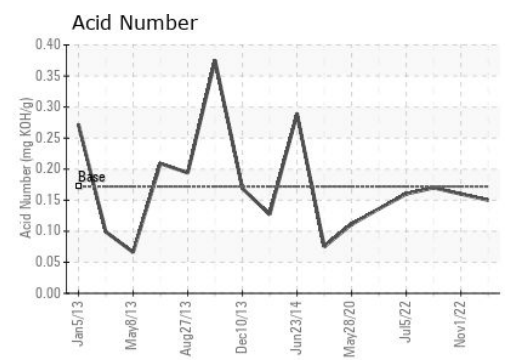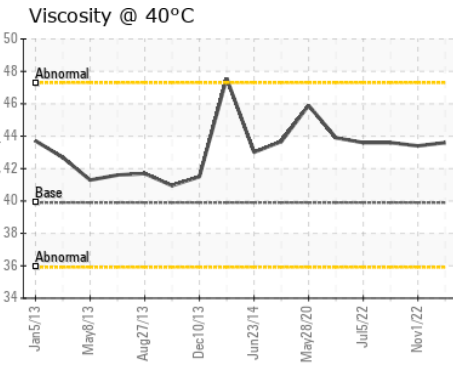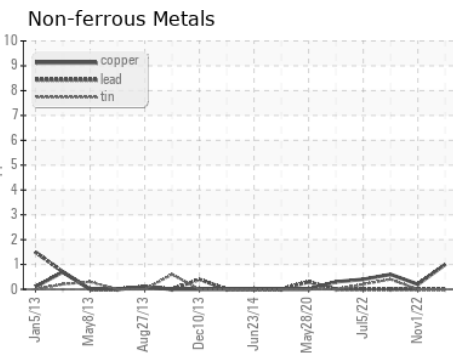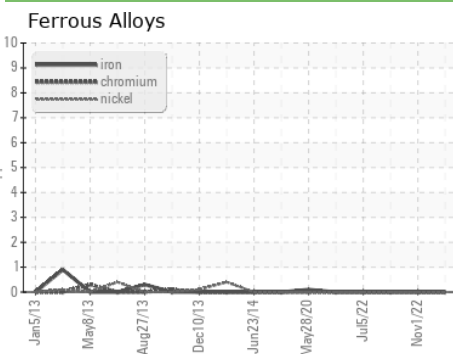

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05932176 **Received** : 23 Aug 2023  
**Lab Number** : **05932176** **Diagnosed** : 24 Aug 2023  
**Unique Number** : 10617447 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**JOHN BOUCHARD & SONS**  
 1024 HARRISON ST.  
 NASHVILLE, TN  
 US 37203  
 Contact: STEVE SANDERS  
 Steve.sanders@jbouchard.com  
 T:  
 F: (865)544-1400

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)