




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

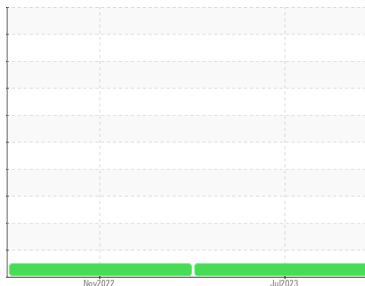

Area  
**SYNOIL 8K**  
 Machine Id  
**ATLAS COPCO API486519 - PLATINUM CONVERTING**  
 Component  
**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCZ05932183</b>	UCZ05703772	---
Sample Date	Client Info			<b>27 Jul 2023</b>	18 Nov 2022	---
Machine Age	hrs	Client Info		<b>30928</b>	30142	---
Oil Age	hrs	Client Info		<b>800</b>	8000	---
Oil Changed	Client Info			<b>Not Changed</b>	Changed	---
Sample Status				<b>NORMAL</b>	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	---
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m		<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>15	<b>&lt;1</b>	1	---
Lead	ppm	ASTM D5185m	>65	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>65	<b>&lt;1</b>	<1	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.3	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	0.3	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	0.9	<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m	0.2	<b>0</b>	0	---
Calcium	ppm	ASTM D5185m	0.1	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m	429	<b>236</b>	9	---
Zinc	ppm	ASTM D5185m	0.3	<b>19</b>	20	---
Sulfur	ppm	ASTM D5185m	1336	<b>242</b>	42	---



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	<b>&lt;1</b>	2	---
Sodium	ppm	ASTM D5185m		<b>1</b>	7	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.622	<b>0.643</b>	0.82	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual		<b>NEG</b>	NEG	---







# OIL ANALYSIS REPORT

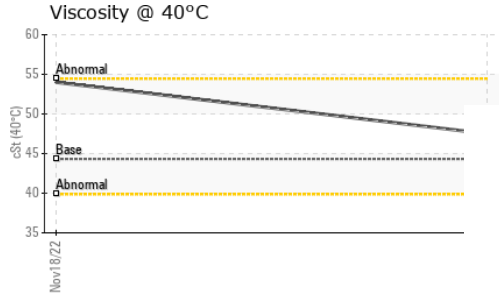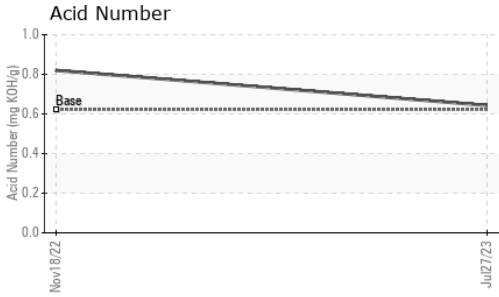

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	44.32	<b>47.5</b>	54.0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					no image
Bottom					no image

## GRAPHS

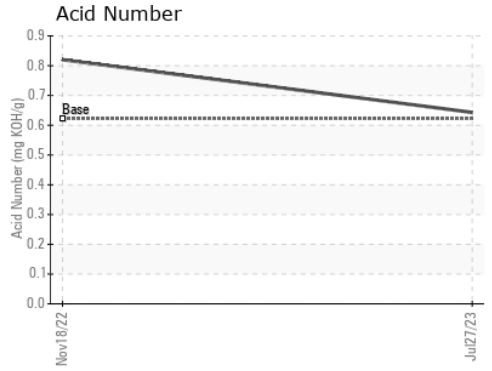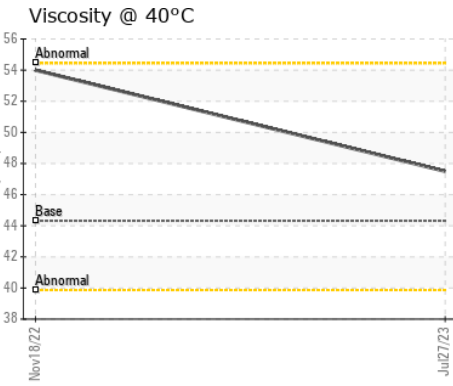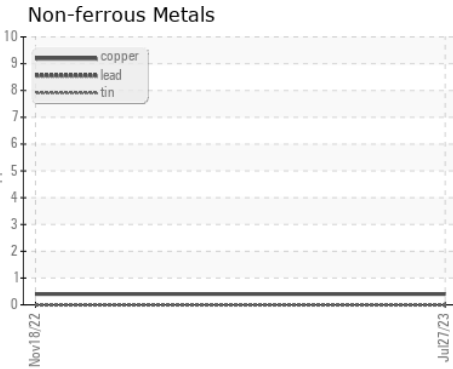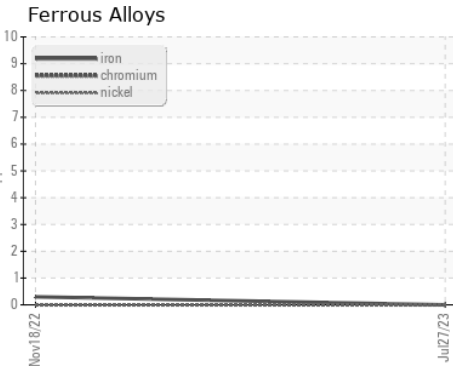

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCZ05932183 **Received** : 23 Aug 2023  
**Lab Number** : **05932183** **Diagnosed** : 24 Aug 2023  
**Unique Number** : 10617454 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**ZORN COMPRESSOR EQUIPMENT**  
 227 AMBROSIO DR, SUITE A  
 GURNEE, IL  
 US 60031  
 Contact: Rachel Pesnikov  
 rachel.pesnikov@zornair.com  
 T: (847)599-1333  
 F: x:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)