



PROBLEM SUMMARY

Sample Rating Trend




ISO



Machine Id
KAESER SFC75S 6527794 (S/N 1099)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- LTR)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

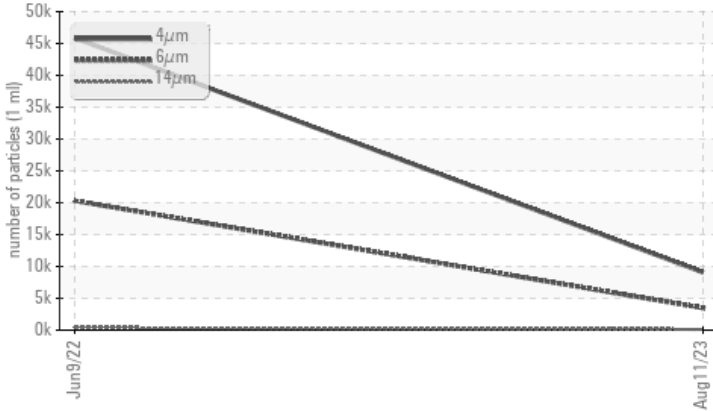

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

| Sample Status | | | ABNORMAL | ABNORMAL | --- |
|-----------------|--------------|-----------|-------------------|------------|-----|
| Particles >6µm | ASTM D7647 | >1300 | ▲ 3475 | ▲ 20316 | --- |
| Particles >14µm | ASTM D7647 | >80 | ▲ 107 | ▲ 386 | --- |
| Oil Cleanliness | ISO 4406 (c) | >--/17/13 | ▲ 20/19/14 | ▲ 23/22/16 | --- |

Customer Id: DHIOCO
 Sample No.: KCPA004311
 Lab Number: 05932754
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

09 Jun 2022 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

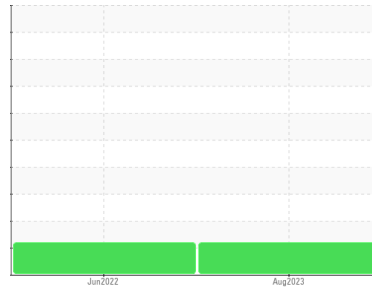

ISO



Machine Id
KAESER SFC75S 6527794 (S/N 1099)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- LTR)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|----------|
| Sample Number | Client Info | | | KCPA004311 | KCP40596 | --- |
| Sample Date | Client Info | | | 11 Aug 2023 | 09 Jun 2022 | --- |
| Machine Age | hrs | Client Info | | 9160 | 3436 | --- |
| Oil Age | hrs | Client Info | | 0 | 3436 | --- |
| Oil Changed | Client Info | | | N/A | Changed | --- |
| Sample Status | | | | ABNORMAL | ABNORMAL | --- |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >50 | <1 | 1 | --- |
| Chromium | ppm | ASTM D5185m | >10 | 0 | 0 | --- |
| Nickel | ppm | ASTM D5185m | >3 | 0 | 0 | --- |
| Titanium | ppm | ASTM D5185m | >3 | 0 | 0 | --- |
| Silver | ppm | ASTM D5185m | >2 | 0 | <1 | --- |
| Aluminum | ppm | ASTM D5185m | >10 | 1 | 2 | --- |
| Lead | ppm | ASTM D5185m | >10 | 0 | 0 | --- |
| Copper | ppm | ASTM D5185m | >50 | 4 | 7 | --- |
| Tin | ppm | ASTM D5185m | >10 | 0 | <1 | --- |
| Vanadium | ppm | ASTM D5185m | | <1 | 0 | --- |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | --- |





| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | 0 | 0 | 0 | --- |
| Barium | ppm | ASTM D5185m | 90 | 0 | 0 | --- |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | 0 | --- |
| Manganese | ppm | ASTM D5185m | | <1 | <1 | --- |
| Magnesium | ppm | ASTM D5185m | 100 | <1 | 18 | --- |
| Calcium | ppm | ASTM D5185m | 0 | 0 | 0 | --- |
| Phosphorus | ppm | ASTM D5185m | 0 | 2 | 3 | --- |
| Zinc | ppm | ASTM D5185m | 0 | 0 | 34 | --- |
| Sulfur | ppm | ASTM D5185m | 23500 | 22315 | 18194 | --- |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >25 | <1 | <1 | --- |
| Sodium | ppm | ASTM D5185m | | <1 | 6 | --- |
| Potassium | ppm | ASTM D5185m | >20 | 0 | 3 | --- |
| Water | % | ASTM D6304 | >0.05 | 0.008 | 0.005 | --- |
| ppm Water | ppm | ASTM D6304 | >500 | 86.2 | 51.5 | --- |

| FLUID CLEANLINESS | | method | limit/base | current | history1 | history2 |
|-------------------|--|--------------|------------|-------------------|------------|----------|
| Particles >4µm | | ASTM D7647 | | 9075 | 45872 | --- |
| Particles >6µm | | ASTM D7647 | >1300 | ▲ 3475 | ▲ 20316 | --- |
| Particles >14µm | | ASTM D7647 | >80 | ▲ 107 | ▲ 386 | --- |
| Particles >21µm | | ASTM D7647 | >20 | 13 | 17 | --- |
| Particles >38µm | | ASTM D7647 | >4 | 0 | 1 | --- |
| Particles >71µm | | ASTM D7647 | >3 | 0 | 0 | --- |
| Oil Cleanliness | | ISO 4406 (c) | >--/17/13 | ▲ 20/19/14 | ▲ 23/22/16 | --- |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 1.0 | 0.53 | 0.43 | --- |


OIL ANALYSIS REPORT

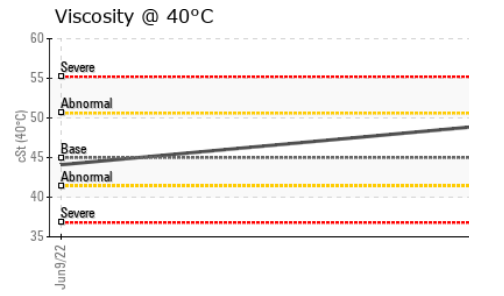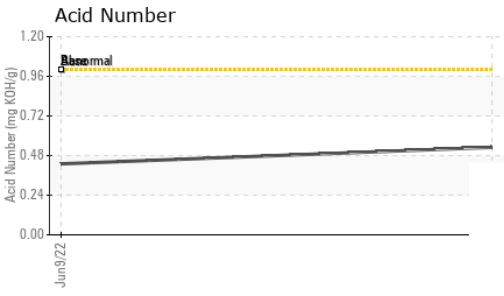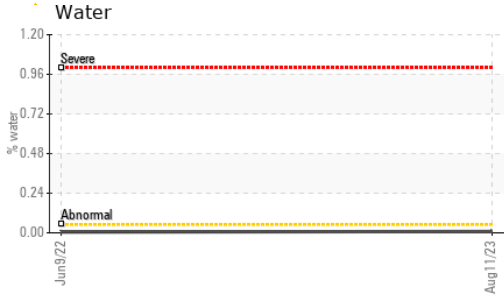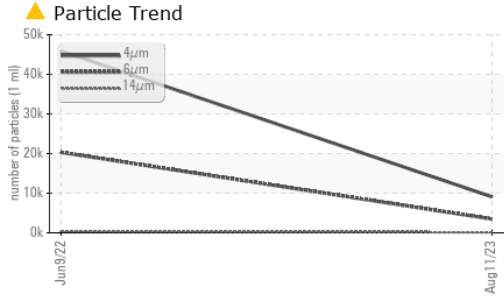





| PARAMETER | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- |
| Silt | scalar | *Visual | NONE | NONE | --- |
| Debris | scalar | *Visual | NONE | NONE | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.05 | NEG | --- |
| Free Water | scalar | *Visual | | NEG | --- |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 45 | 49.1 | 44.1 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

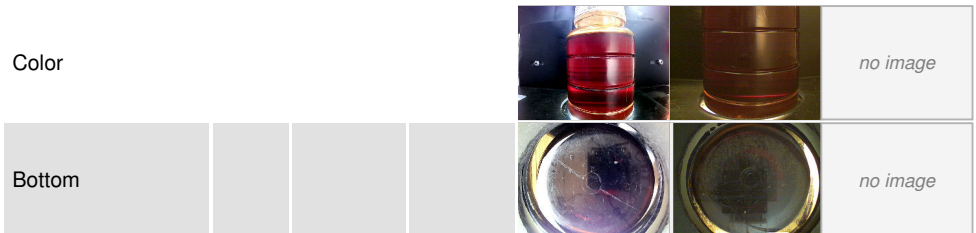

GRAPHS

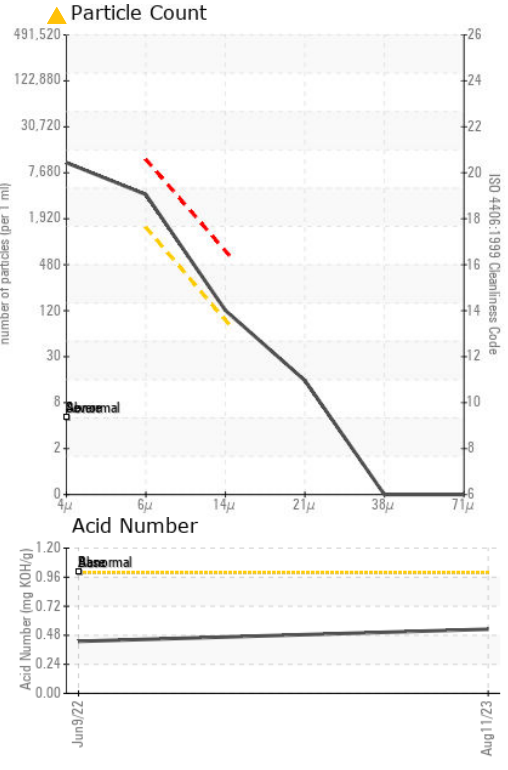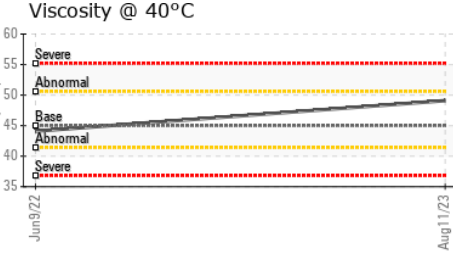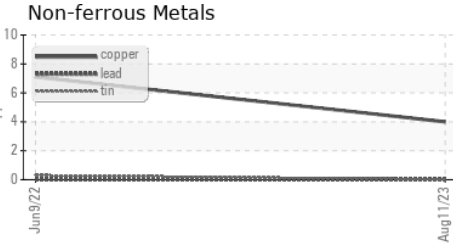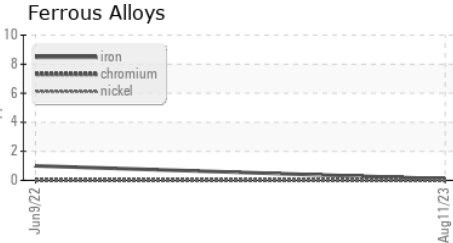

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA004311 **Received** : 23 Aug 2023
Lab Number : 05932754 **Diagnosed** : 25 Aug 2023
Unique Number : 10618025 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

D & H INDUSTRIES
 1880 EXECUTIVE DR
 OCONOMOWOC, WI
 US 53066
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: